

STORMWATER MANAGEMENT REPORT

Geoffrey Park
Off Indian Ridge Road South
Holliston, Massachusetts


May 14, 2020


Prepared for:

Indian Ridge Realty Trust
223 Courtland Street
Holliston, Massachusetts

Prepared by:

GLM Engineering Consultants, Inc.
19 Exchange Street
Holliston, Massachusetts 01746
(508) 429 - 1100


Paul E. Truax, PE
Registered Professional Engineer


Robert S. Truax
Design Engineer

CONTENTS

<u>DESCRIPTION</u>	<u>PAGE</u>
Introduction, Description & Summary	1-5
U.S.G.S. Map	6
NRCS Soils Map and Information	7-8
Checklist for Stormwater Report	9-15
Appendix – A Hydrological Calculations for Pre- & Post-Development (Standard 2) Routing Diagram <ul style="list-style-type: none">• 2-year storm• 10-year storm• 25-year storm• 100-year storm	
Appendix – B Hydraulic Calculations and Design (Manning’s Equation) Time of Flow, Average CN values	
Appendix – C Stormwater Recharge Calcs, Water Quality Volumes, TSS Removal & Infiltration BMP Drain Times (Standard’s 3 & 4) Groundwater Mounding Calculations	
Appendix – D Stormwater Operation & Maintenance Plan and Long Term Pollution Prevention Plan(Standard 9)	
Appendix – E Illicit Discharge Statement (Standard 10)	
Appendix – F Supplemental Plans <ul style="list-style-type: none">• Pre-Development Subcatchment Areas• Post-Development Subcatchment Areas• Hydraulic Subcatchment Areas	

Project Introduction:

The applicant, Indian Ridge Realty Trust, is proposing to develop a 24 Unit Residential development, located off Indian Ridge Road South, in Holliston Massachusetts. The proposed project was filed with Massachusetts Housing pursuant to Massachusetts General Laws Chapter 40B. The 24 Units will be single family and duplex style dwellings. The existing property is undeveloped wooded area and consists of 12.67 acres.

The proposal is to construct a roadway from the end of Indian Ridge Road South to provide access and egress. The Project will be serviced by Town water, available public utilities and a common onsite sewage disposal system. The stormwater generated from the Project will be captured, conveyed, treated and mitigated on-site utilizing Best Management Practices.

The purpose of these calculations is to demonstrate design compliance of the Project's stormwater management system for water quality and quantity, specifically post-development peak discharge rates per the DEP's Stormwater Management Policy, the Town of Holliston Land Subdivision Regulations. As designed, the system will mitigate peak rates of runoff for storms up to and including the 100-year event under post-construction conditions.

Methodology/Sources of Data:

The overall storm water management plan for the project is designed to maintain the peak rate of storm water runoff and runoff volumes from the site after development. The Soil Conservation Service Modified Soil Cover Complex Method, the computer program "HydroCAD" by Applied Microcomputer Systems, and the procedures specified in Urban Hydrology for storm Small Watersheds were used to determine pre-and post-developed peak flow rates of runoff from the site. The storm events have been compiled from the Soil Conservation Services Technical Report No. 55 and the U.S. Department of Commerce Technical Paper (TP 40). The 2-year, 10-year, 25-year and 100-year storm events have been utilized for hydrology calculations. The rainfall data for the Type III, 24-hour storm events follow:

<u>24-Hour Storm</u>	<u>Rainfall (inches)</u>
2	3.20
10	4.80
25	5.50
100	7.0

The storm water runoff will be controlled through the use of "Best Management Practices" and in conformance with the MADEP Stormwater Management Policy. The proposed Project will result in an improvement over the existing conditions, by constructing a storm water management system that will provide treatment, groundwater recharge and reduce the peak rates of runoff and offsite runoff volumes.

The piped drainage system has been designed utilizing the Rational Method for the 25 year storm event to size street drains.

Soils:

The Natural Resources Conservation Service (NRCS), Hydrologic Soils Group Map for Middlesex county, Massachusetts indicates that the on-site soils consist of Charlton Hollis Rock-103D, and Canton Fine sandy loam-424C. Soil testing was conducted onsite to confirm soil conditions. The results were consistent with sandy-loam and percolation rates of 15.0 minutes per inch. The test concluded large boulders in the test holes and surface boulders throughout the site. Based on the soil testing it is opinion that the soil throughout the site area is consistent with a "B" type hydrologic Rating. Therefore the design for pre- and post-development was performed using a "B" soil type.

Existing Conditions Overview:

The Project is located at the end of Indian Ridge Road South and identified as Assessor Map 14, Block 3, Lot 1 containing approximately 12.6 +/- acres. The site is currently undeveloped wooded land. There is a bordering vegetated wetland area located along the southerly and easterly boundaries. The site slopes from the northwest portion to the southeast.

The existing site is divided into three (3) existing watershed subcatchment areas. The three subcatchment areas converge at the southeast portion of the property. See the attached Pre-Development Subcatchment Area Plan for delineations. Subcatchment E1 flows overland towards the southern wetland to an intermittent stream. E2 is centrally located and flows to the south and E3 flows toward the westerly wetland. The three subcatchments flow via. overland and brooks to the southeast portion of the site and are combined with Link DP1.

Proposed Conditions Overview:

The proposal is to construct 24 Residential homes, both single family and duplex style. The proposed roadway is an extension of Indian Ridge Road South. The extension is a total length of 1,640 feet of roadway that loops around on itself within the site. The proposed stormwater drainage system is designed to capture the runoff utilizing catch basins, manholes and culverts to convey the stormwater to a drainage basin located at the beginning of the proposed roadway.

The proposed runoff areas have been divided into three (3) subcatchments. Subcatchment P1 discharges via overland flow towards southern wetland, Subcatchment P2 is centrally located and discharges to the drainage basin and Subcatchment P3 flows via overland to the westerly wetlands. The overall stormwater discharge from the site is combine in link DP2.

The proposed systems will reduce all post-development flow rates of runoff up to and including the 100-year event to existing levels at all abutting areas. Existing uncaptured off-site runoff not associated with the Project will continue to flow overland without change.

The following is summary comparison of Pre- and Post-Developed Rates and Volumes of Runoff:

<u>Summary of Peak Stormwater Runoff Rates:</u>								
<u>Design Point</u>	<u>2-Yr Peak Flow (cfs)</u>		<u>10-Yr Peak Flow (cfs)</u>		<u>25-Yr Peak Flow (cfs)</u>		<u>100-Yr Peak Flow (cfs)</u>	
	<u>Existing</u>	<u>Proposed</u>	<u>Existing</u>	<u>Proposed</u>	<u>Existing</u>	<u>Proposed</u>	<u>Existing</u>	<u>Proposed</u>
DP1/ DP2	1.10	1.08	6.76	6.62	8.23	7.70	19.29	17.47

The following is a summary of the Retention Basin:


<u>Summary of Retention Basin</u>								
<u>Design Point</u>	<u>2-Yr Volume (cu.ft.)</u>		<u>10-Yr Volume (ac-ft)</u>		<u>25-Yr Volume (ac-ft)</u>		<u>100-Yr Volume (ac-ft)</u>	
	<u>Peak Elev.Ft.</u>	<u>Outflow (cfs)</u>	<u>Peak Elev. Ft.</u>	<u>Outflow (cfs)</u>	<u>Peak Elev.Ft.</u>	<u>Outflow (cfs)</u>	<u>Peak Elev.Ft.</u>	<u>Outflow (cfs)</u>
1P	269.29	0.46	270.69	3.12	270.97	3.50	272.39	8.65

Summary:


The calculations performed for all design storm events indicate that the total peak rates and volumes of runoff for the Project as proposed will not exceed those of existing conditions with the implementation of the stormwater management system. With the implementation of the stormwater management system as designed, along with the Operation and Maintenance plan contained herein, all of the objectives of the DEP's Stormwater Management Regulations are satisfied.

Horizontal Datum: NAD27

Map Center: 042° 14' 03.0487" N,

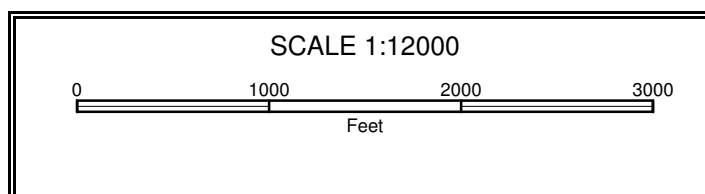

Hydrologic Soil Group—Middlesex County, Massachusetts
(Indian Ridge Holliston)

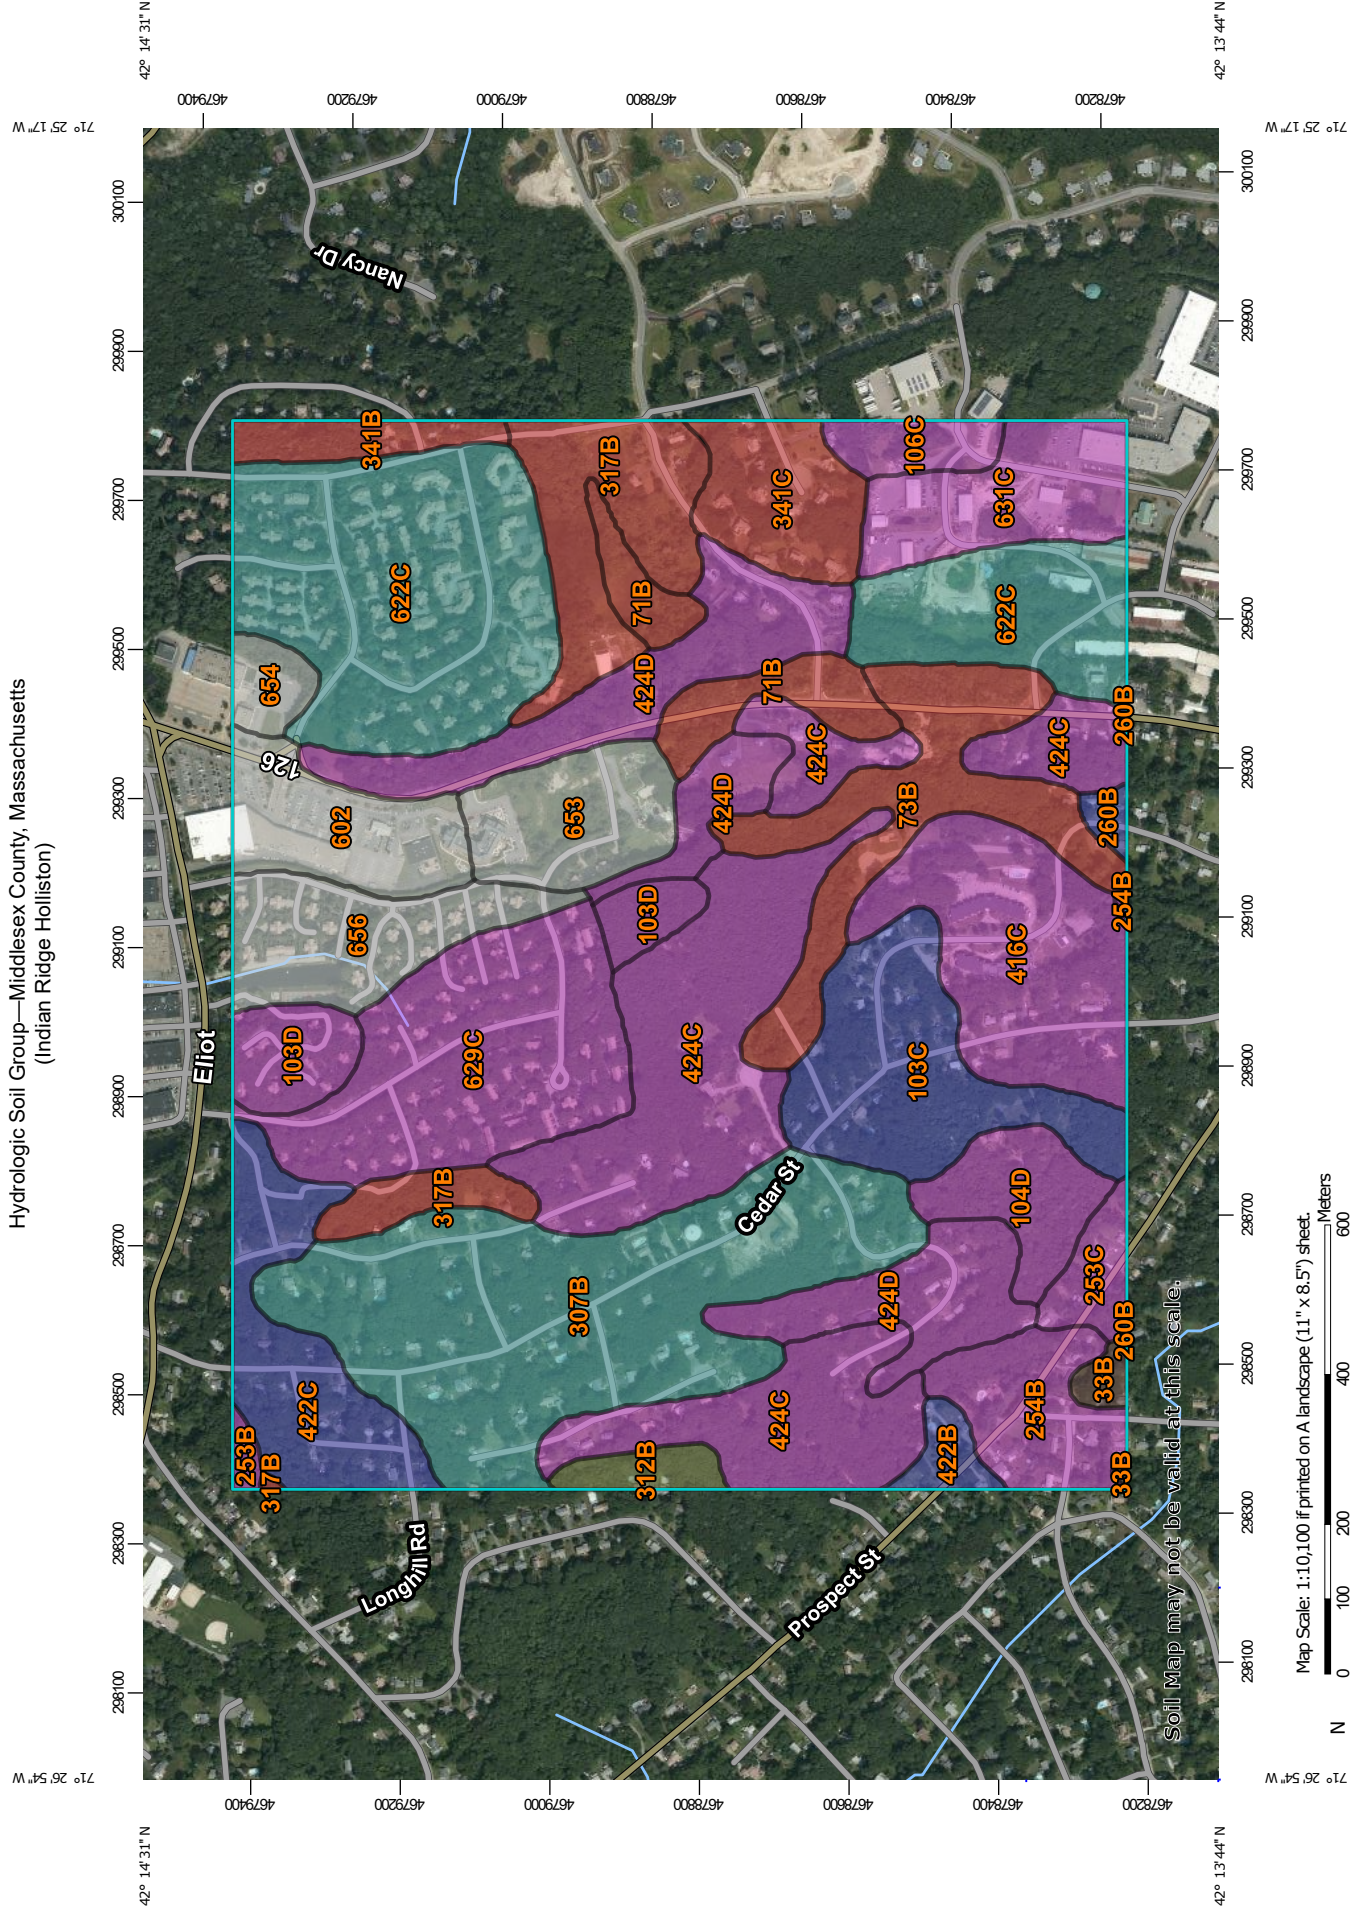


Natural Resources
Conservation Service

Web Soil Survey
National Cooperative Soil Survey

1/8/2020
Page 1 of 5

MAP LEGEND

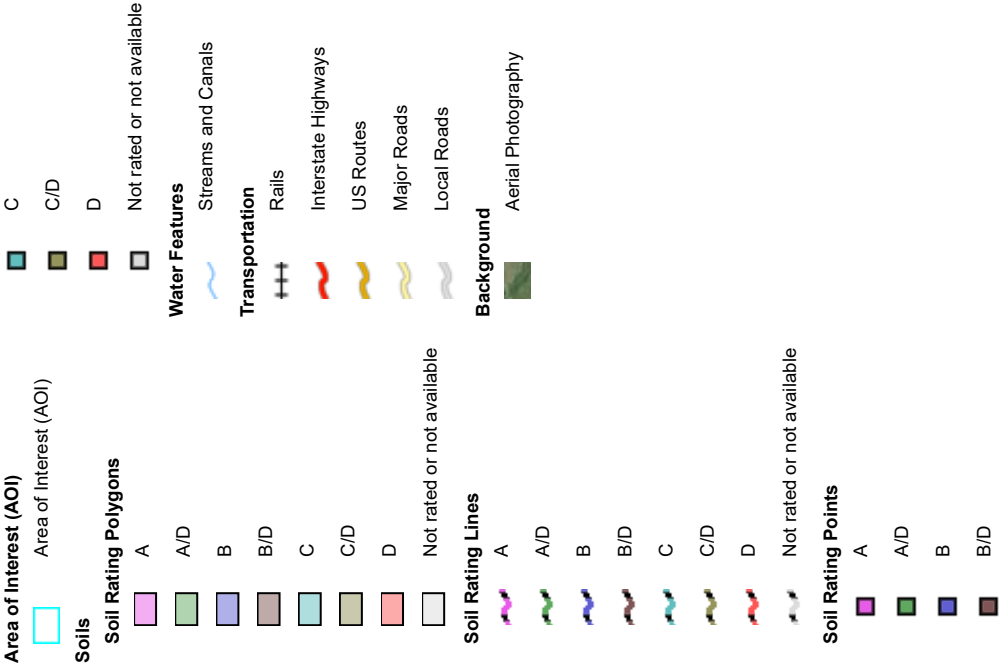

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:25,000.

Warning: Soil Map may not be valid at this scale.
Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
Web Soil Survey URL:
Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Middlesex County, Massachusetts
Survey Area Data: Version 19, Sep 12, 2019

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Jul 28, 2019—Aug 15, 2019

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Hydrologic Soil Group

Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
33B	Raypol silt loam, 0 to 5 percent slopes	B/D	1.4	0.3%
71B	Ridgebury fine sandy loam, 3 to 8 percent slopes, extremely stony	D	9.0	2.1%
73B	Whitman fine sandy loam, 0 to 3 percent slopes, extremely stony	D	19.7	4.6%
103C	Charlton-Hollis-Rock outcrop complex, 8 to 15 percent slopes	B	19.8	4.7%
103D	Charlton-Hollis-Rock outcrop complex, 15 to 25 percent slopes	A	8.3	1.9%
104D	Hollis-Rock outcrop-Charlton complex, 15 to 25 percent slopes	A	8.0	1.9%
106C	Narragansett-Hollis-Rock outcrop complex, 3 to 15 percent slopes	A	3.9	0.9%
253B	Hinckley loamy sand, 3 to 8 percent slopes	A	0.8	0.2%
253C	Hinckley loamy sand, 8 to 15 percent slopes	A	3.7	0.9%
254B	Merrimac fine sandy loam, 3 to 8 percent slopes	A	10.2	2.4%
260B	Sudbury fine sandy loam, 3 to 8 percent slopes	B	1.2	0.3%
307B	Paxton fine sandy loam, 0 to 8 percent slopes, extremely stony	C	50.1	11.8%
312B	Woodbridge fine sandy loam, 0 to 8 percent slopes, extremely stony	C/D	2.8	0.7%
317B	Scituate fine sandy loam, 3 to 8 percent slopes, extremely stony	D	18.7	4.4%

Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
341B	Broadbrook very fine sandy loam, 3 to 8 percent slopes, very stony	D	4.3	1.0%
341C	Broadbrook very fine sandy loam, 8 to 15 percent slopes, very stony	D	10.0	2.4%
416C	Narragansett silt loam, 8 to 15 percent slopes, very stony	A	22.0	5.2%
422B	Canton fine sandy loam, 0 to 8 percent slopes, extremely stony	B	2.4	0.6%
422C	Canton fine sandy loam, 8 to 15 percent slopes, extremely stony	B	15.1	3.6%
424C	Canton fine sandy loam, 8 to 15 percent slopes, extremely bouldery	A	51.9	12.2%
424D	Canton fine sandy loam, 15 to 25 percent slopes, extremely bouldery	A	31.1	7.3%
602	Urban land		11.5	2.7%
622C	Paxton-Urban land complex, 3 to 15 percent slopes	C	51.9	12.2%
629C	Canton-Charlton-Urban land complex, 3 to 15 percent slopes	A	28.1	6.6%
631C	Charlton-Urban land-Hollis complex, 3 to 15 percent slopes, rocky	A	12.2	2.9%
653	Udorthents, sandy		11.2	2.6%
654	Udorthents, loamy		3.1	0.7%
656	Udorthents-Urban land complex		13.0	3.0%
Totals for Area of Interest			425.6	100.0%

Description

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.

Rating Options

Aggregation Method: Dominant Condition

Component Percent Cutoff: None Specified


Tie-break Rule: Higher



Checklist for Stormwater Report

A. Introduction

Important: When filling out forms on the computer, use only the tab key to move your cursor - do not use the return key.



A Stormwater Report must be submitted with the Notice of Intent permit application to document compliance with the Stormwater Management Standards. The following checklist is NOT a substitute for the Stormwater Report (which should provide more substantive and detailed information) but is offered here as a tool to help the applicant organize their Stormwater Management documentation for their Report and for the reviewer to assess this information in a consistent format. As noted in the Checklist, the Stormwater Report must contain the engineering computations and supporting information set forth in Volume 3 of the [Massachusetts Stormwater Handbook](#). The Stormwater Report must be prepared and certified by a Registered Professional Engineer (RPE) licensed in the Commonwealth.

The Stormwater Report must include:

- The Stormwater Checklist completed and stamped by a Registered Professional Engineer (see page 2) that certifies that the Stormwater Report contains all required submittals.¹ This Checklist is to be used as the cover for the completed Stormwater Report.
- Applicant/Project Name
- Project Address
- Name of Firm and Registered Professional Engineer that prepared the Report
- Long-Term Pollution Prevention Plan required by Standards 4-6
- Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan required by Standard 8²
- Operation and Maintenance Plan required by Standard 9

In addition to all plans and supporting information, the Stormwater Report must include a brief narrative describing stormwater management practices, including environmentally sensitive site design and LID techniques, along with a diagram depicting runoff through the proposed BMP treatment train. Plans are required to show existing and proposed conditions, identify all wetland resource areas, NRCS soil types, critical areas, Land Uses with Higher Potential Pollutant Loads (LUHPPL), and any areas on the site where infiltration rate is greater than 2.4 inches per hour. The Plans shall identify the drainage areas for both existing and proposed conditions at a scale that enables verification of supporting calculations.

As noted in the Checklist, the Stormwater Management Report shall document compliance with each of the Stormwater Management Standards as provided in the Massachusetts Stormwater Handbook. The soils evaluation and calculations shall be done using the methodologies set forth in Volume 3 of the Massachusetts Stormwater Handbook.

To ensure that the Stormwater Report is complete, applicants are required to fill in the Stormwater Report Checklist by checking the box to indicate that the specified information has been included in the Stormwater Report. If any of the information specified in the checklist has not been submitted, the applicant must provide an explanation. The completed Stormwater Report Checklist and Certification must be submitted with the Stormwater Report.

¹ The Stormwater Report may also include the Illicit Discharge Compliance Statement required by Standard 10. If not included in the Stormwater Report, the Illicit Discharge Compliance Statement must be submitted prior to the discharge of stormwater runoff to the post-construction best management practices.

² For some complex projects, it may not be possible to include the Construction Period Erosion and Sedimentation Control Plan in the Stormwater Report. In that event, the issuing authority has the discretion to issue an Order of Conditions that approves the project and includes a condition requiring the proponent to submit the Construction Period Erosion and Sedimentation Control Plan before commencing any land disturbance activity on the site.



Checklist for Stormwater Report

B. Stormwater Checklist and Certification

The following checklist is intended to serve as a guide for applicants as to the elements that ordinarily need to be addressed in a complete Stormwater Report. The checklist is also intended to provide conservation commissions and other reviewing authorities with a summary of the components necessary for a comprehensive Stormwater Report that addresses the ten Stormwater Standards.

Note: Because stormwater requirements vary from project to project, it is possible that a complete Stormwater Report may not include information on some of the subjects specified in the Checklist. If it is determined that a specific item does not apply to the project under review, please note that the item is not applicable (N.A.) and provide the reasons for that determination.

A complete checklist must include the Certification set forth below signed by the Registered Professional Engineer who prepared the Stormwater Report.

Registered Professional Engineer's Certification

I have reviewed the Stormwater Report, including the soil evaluation, computations, Long-term Pollution Prevention Plan, the Construction Period Erosion and Sedimentation Control Plan (if included), the Long-term Post-Construction Operation and Maintenance Plan, the Illicit Discharge Compliance Statement (if included) and the plans showing the stormwater management system, and have determined that they have been prepared in accordance with the requirements of the Stormwater Management Standards as further elaborated by the Massachusetts Stormwater Handbook. I have also determined that the information presented in the Stormwater Checklist is accurate and that the information presented in the Stormwater Report accurately reflects conditions at the site as of the date of this permit application.

Registered Professional Engineer Block and Signature

Signature and Date

Checklist

Project Type: Is the application for new development, redevelopment, or a mix of new and redevelopment?

- ☒ New development
- ☐ Redevelopment
- ☐ Mix of New Development and Redevelopment



Checklist for Stormwater Report

Checklist (continued)

LID Measures: Stormwater Standards require LID measures to be considered. Document what environmentally sensitive design and LID Techniques were considered during the planning and design of the project:

- ☐ No disturbance to any Wetland Resource Areas
- ☒ Site Design Practices (e.g. clustered development, reduced frontage setbacks)
- ☐ Reduced Impervious Area (Redevelopment Only)
- ☐ Minimizing disturbance to existing trees and shrubs
- ☐ LID Site Design Credit Requested:
 - ☐ Credit 1
 - ☐ Credit 2
 - ☐ Credit 3
- ☐ Use of “country drainage” versus curb and gutter conveyance and pipe
- ☐ Bioretention Cells (includes Rain Gardens)
- ☐ Constructed Stormwater Wetlands (includes Gravel Wetlands designs)
- ☐ Treebox Filter
- ☐ Water Quality Swale
- ☐ Grass Channel
- ☐ Green Roof
- ☐ Other (describe): _____

Standard 1: No New Untreated Discharges

- ☒ No new untreated discharges
- ☒ Outlets have been designed so there is no erosion or scour to wetlands and waters of the Commonwealth
- ☒ Supporting calculations specified in Volume 3 of the Massachusetts Stormwater Handbook included.



Checklist for Stormwater Report

Checklist (continued)

Standard 2: Peak Rate Attenuation

- ☐ Standard 2 waiver requested because the project is located in land subject to coastal storm flowage and stormwater discharge is to a wetland subject to coastal flooding.
- ☐ Evaluation provided to determine whether off-site flooding increases during the 100-year 24-hour storm.
- ☒ Calculations provided to show that post-development peak discharge rates do not exceed pre-development rates for the 2-year and 10-year 24-hour storms. If evaluation shows that off-site flooding increases during the 100-year 24-hour storm, calculations are also provided to show that post-development peak discharge rates do not exceed pre-development rates for the 100-year 24-hour storm.

Standard 3: Recharge

- ☒ Soil Analysis provided.
- ☒ Required Recharge Volume calculation provided.
- ☐ Required Recharge volume reduced through use of the LID site Design Credits.
- ☒ Sizing the infiltration, BMPs is based on the following method: Check the method used.
 - ☐ Static
 - ☒ Simple Dynamic
 - ☐ Dynamic Field¹
- ☐ Runoff from all impervious areas at the site discharging to the infiltration BMP.
- ☒ Runoff from all impervious areas at the site is *not* discharging to the infiltration BMP and calculations are provided showing that the drainage area contributing runoff to the infiltration BMPs is sufficient to generate the required recharge volume.
- ☒ Recharge BMPs have been sized to infiltrate the Required Recharge Volume.
- ☐ Recharge BMPs have been sized to infiltrate the Required Recharge Volume *only* to the maximum extent practicable for the following reason:
 - ☐ Site is comprised solely of C and D soils and/or bedrock at the land surface
 - ☐ M.G.L. c. 21E sites pursuant to 310 CMR 40.0000
 - ☐ Solid Waste Landfill pursuant to 310 CMR 19.000
 - ☐ Project is otherwise subject to Stormwater Management Standards only to the maximum extent practicable.
- ☒ Calculations showing that the infiltration BMPs will drain in 72 hours are provided.
- ☐ Property includes a M.G.L. c. 21E site or a solid waste landfill and a mounding analysis is included.

¹ 80% TSS removal is required prior to discharge to infiltration BMP if Dynamic Field method is used.



Checklist for Stormwater Report

Checklist (continued)

Standard 3: Recharge (continued)

- ☒ The infiltration BMP is used to attenuate peak flows during storms greater than or equal to the 10-year 24-hour storm and separation to seasonal high groundwater is less than 4 feet and a mounding analysis is provided.
- ☐ Documentation is provided showing that infiltration BMPs do not adversely impact nearby wetland resource areas.

Standard 4: Water Quality

The Long-Term Pollution Prevention Plan typically includes the following:

- Good housekeeping practices;
 - Provisions for storing materials and waste products inside or under cover;
 - Vehicle washing controls;
 - Requirements for routine inspections and maintenance of stormwater BMPs;
 - Spill prevention and response plans;
 - Provisions for maintenance of lawns, gardens, and other landscaped areas;
 - Requirements for storage and use of fertilizers, herbicides, and pesticides;
 - Pet waste management provisions;
 - Provisions for operation and management of septic systems;
 - Provisions for solid waste management;
 - Snow disposal and plowing plans relative to Wetland Resource Areas;
 - Winter Road Salt and/or Sand Use and Storage restrictions;
 - Street sweeping schedules;
 - Provisions for prevention of illicit discharges to the stormwater management system;
 - Documentation that Stormwater BMPs are designed to provide for shutdown and containment in the event of a spill or discharges to or near critical areas or from LUHPPL;
 - Training for staff or personnel involved with implementing Long-Term Pollution Prevention Plan;
 - List of Emergency contacts for implementing Long-Term Pollution Prevention Plan.
- ☒ A Long-Term Pollution Prevention Plan is attached to Stormwater Report and is included as an attachment to the Wetlands Notice of Intent.
 - ☐ Treatment BMPs subject to the 44% TSS removal pretreatment requirement and the one inch rule for calculating the water quality volume are included, and discharge:
 - ☐ is within the Zone II or Interim Wellhead Protection Area
 - ☐ is near or to other critical areas
 - ☐ is within soils with a rapid infiltration rate (greater than 2.4 inches per hour)
 - ☐ involves runoff from land uses with higher potential pollutant loads.
 - ☐ The Required Water Quality Volume is reduced through use of the LID site Design Credits.
 - ☒ Calculations documenting that the treatment train meets the 80% TSS removal requirement and, if applicable, the 44% TSS removal pretreatment requirement, are provided.



Checklist for Stormwater Report

Checklist (continued)

Standard 4: Water Quality (continued)

- ☒ The BMP is sized (and calculations provided) based on:
 - ☒ The ½" or 1" Water Quality Volume or
 - ☐ The equivalent flow rate associated with the Water Quality Volume and documentation is provided showing that the BMP treats the required water quality volume.
- ☐ The applicant proposes to use proprietary BMPs, and documentation supporting use of proprietary BMP and proposed TSS removal rate is provided. This documentation may be in the form of the propriety BMP checklist found in Volume 2, Chapter 4 of the Massachusetts Stormwater Handbook and submitting copies of the TARP Report, STEP Report, and/or other third party studies verifying performance of the proprietary BMPs.
- ☐ A TMDL exists that indicates a need to reduce pollutants other than TSS and documentation showing that the BMPs selected are consistent with the TMDL is provided.

Standard 5: Land Uses With Higher Potential Pollutant Loads (LUHPPLs)

- ☐ The NPDES Multi-Sector General Permit covers the land use and the Stormwater Pollution Prevention Plan (SWPPP) has been included with the Stormwater Report.
- ☐ The NPDES Multi-Sector General Permit covers the land use and the SWPPP will be submitted **prior to** the discharge of stormwater to the post-construction stormwater BMPs.
- ☐ The NPDES Multi-Sector General Permit does **not** cover the land use.
- ☐ LUHPPLs are located at the site and industry specific source control and pollution prevention measures have been proposed to reduce or eliminate the exposure of LUHPPLs to rain, snow, snow melt and runoff, and been included in the long term Pollution Prevention Plan.
- ☐ All exposure has been eliminated.
- ☐ All exposure has **not** been eliminated and all BMPs selected are on MassDEP LUHPPL list.
- ☐ The LUHPPL has the potential to generate runoff with moderate to higher concentrations of oil and grease (e.g. all parking lots with >1000 vehicle trips per day) and the treatment train includes an oil grit separator, a filtering bioretention area, a sand filter or equivalent.

Standard 6: Critical Areas

- ☐ The discharge is near or to a critical area and the treatment train includes only BMPs that MassDEP has approved for stormwater discharges to or near that particular class of critical area.
- ☐ Critical areas and BMPs are identified in the Stormwater Report.



Checklist for Stormwater Report

Checklist (continued)

Standard 7: Redevelopments and Other Projects Subject to the Standards only to the maximum extent practicable

- ☐ The project is subject to the Stormwater Management Standards only to the maximum Extent Practicable as a:
 - ☐ Limited Project
 - ☐ Small Residential Projects: 5-9 single family houses or 5-9 units in a multi-family development provided there is no discharge that may potentially affect a critical area.
 - ☐ Small Residential Projects: 2-4 single family houses or 2-4 units in a multi-family development with a discharge to a critical area
 - ☐ Marina and/or boatyard provided the hull painting, service and maintenance areas are protected from exposure to rain, snow, snow melt and runoff
 - ☐ Bike Path and/or Foot Path
 - ☐ Redevelopment Project
 - ☐ Redevelopment portion of mix of new and redevelopment.
- ☐ Certain standards are not fully met (Standard No. 1, 8, 9, and 10 must always be fully met) and an explanation of why these standards are not met is contained in the Stormwater Report.
- ☐ The project involves redevelopment and a description of all measures that have been taken to improve existing conditions is provided in the Stormwater Report. The redevelopment checklist found in Volume 2 Chapter 3 of the Massachusetts Stormwater Handbook may be used to document that the proposed stormwater management system (a) complies with Standards 2, 3 and the pretreatment and structural BMP requirements of Standards 4-6 to the maximum extent practicable and (b) improves existing conditions.

Standard 8: Construction Period Pollution Prevention and Erosion and Sedimentation Control

A Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan must include the following information:

- Narrative;
 - Construction Period Operation and Maintenance Plan;
 - Names of Persons or Entity Responsible for Plan Compliance;
 - Construction Period Pollution Prevention Measures;
 - Erosion and Sedimentation Control Plan Drawings;
 - Detail drawings and specifications for erosion control BMPs, including sizing calculations;
 - Vegetation Planning;
 - Site Development Plan;
 - Construction Sequencing Plan;
 - Sequencing of Erosion and Sedimentation Controls;
 - Operation and Maintenance of Erosion and Sedimentation Controls;
 - Inspection Schedule;
 - Maintenance Schedule;
 - Inspection and Maintenance Log Form.
- ☒ A Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan containing the information set forth above has been included in the Stormwater Report.



Checklist for Stormwater Report

Checklist (continued)

Standard 8: Construction Period Pollution Prevention and Erosion and Sedimentation Control (continued)

- ☐ The project is highly complex and information is included in the Stormwater Report that explains why it is not possible to submit the Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan with the application. A Construction Period Pollution Prevention and Erosion and Sedimentation Control has **not** been included in the Stormwater Report but will be submitted **before** land disturbance begins.
- ☐ The project is **not** covered by a NPDES Construction General Permit.
- ☐ The project is covered by a NPDES Construction General Permit and a copy of the SWPPP is in the Stormwater Report.
- ☒ The project is covered by a NPDES Construction General Permit but no SWPPP been submitted. The SWPPP will be submitted BEFORE land disturbance begins.

Standard 9: Operation and Maintenance Plan

- ☒ The Post Construction Operation and Maintenance Plan is included in the Stormwater Report and includes the following information:
 - ☒ Name of the stormwater management system owners;
 - ☒ Party responsible for operation and maintenance;
 - ☒ Schedule for implementation of routine and non-routine maintenance tasks;
 - ☒ Plan showing the location of all stormwater BMPs maintenance access areas;
 - ☒ Description and delineation of public safety features;
 - ☒ Estimated operation and maintenance budget; and
 - ☒ Operation and Maintenance Log Form.
- ☐ The responsible party is **not** the owner of the parcel where the BMP is located and the Stormwater Report includes the following submissions:
 - ☐ A copy of the legal instrument (deed, homeowner's association, utility trust or other legal entity) that establishes the terms of and legal responsibility for the operation and maintenance of the project site stormwater BMPs;
 - ☐ A plan and easement deed that allows site access for the legal entity to operate and maintain BMP functions.

Standard 10: Prohibition of Illicit Discharges

- ☐ The Long-Term Pollution Prevention Plan includes measures to prevent illicit discharges;
- ☒ An Illicit Discharge Compliance Statement is attached;
- ☐ NO Illicit Discharge Compliance Statement is attached but will be submitted **prior to** the discharge of any stormwater to post-construction BMPs.


APPENDIX – A

Hydrogeological Calculations for Pre & Post Development Hydraulic Design (Manning's Equation)

Standard 2

Subcatchment E1: PreDev

Hydrograph

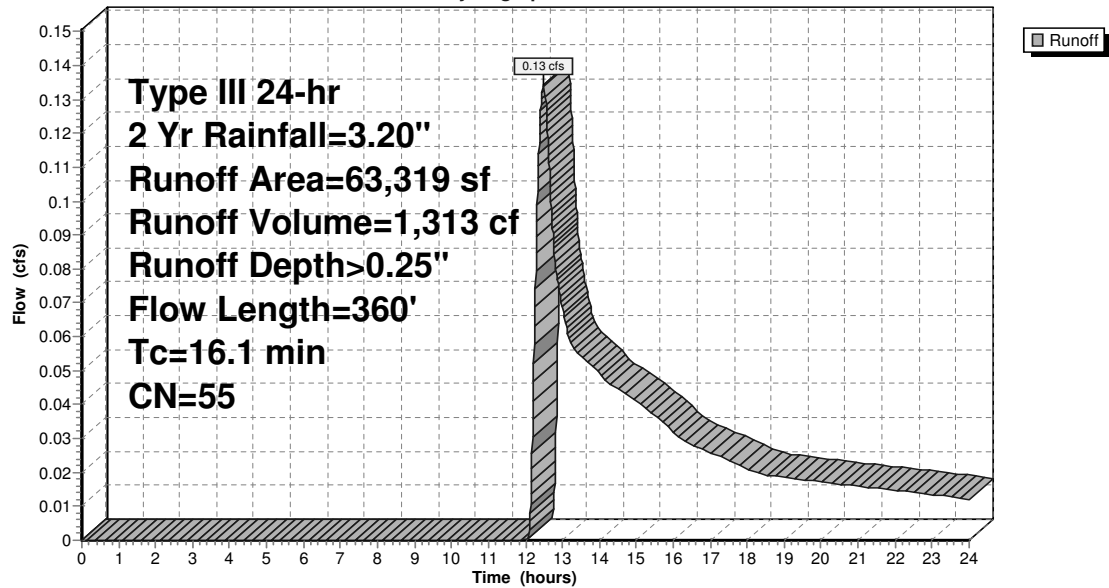

Summary for Subcatchment E2: PreDev

Runoff = 0.52 cfs @ 12.59 hrs, Volume= 5,647 cf, Depth> 0.25"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
 Type III 24-hr 2 Yr Rainfall=3.20"

Area (sf)	CN	Description
273,208	55	Woods, Good, HSG B
273,208		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.5	50	0.0300	0.08		Sheet Flow, A-B
					Woods: Light underbrush n= 0.400 P2= 3.20"
12.4	790	0.0450	1.06		Shallow Concentrated Flow, B-C
					Woodland Kv= 5.0 fps
22.9	840	Total			

Subcatchment E2: PreDev

Hydrograph

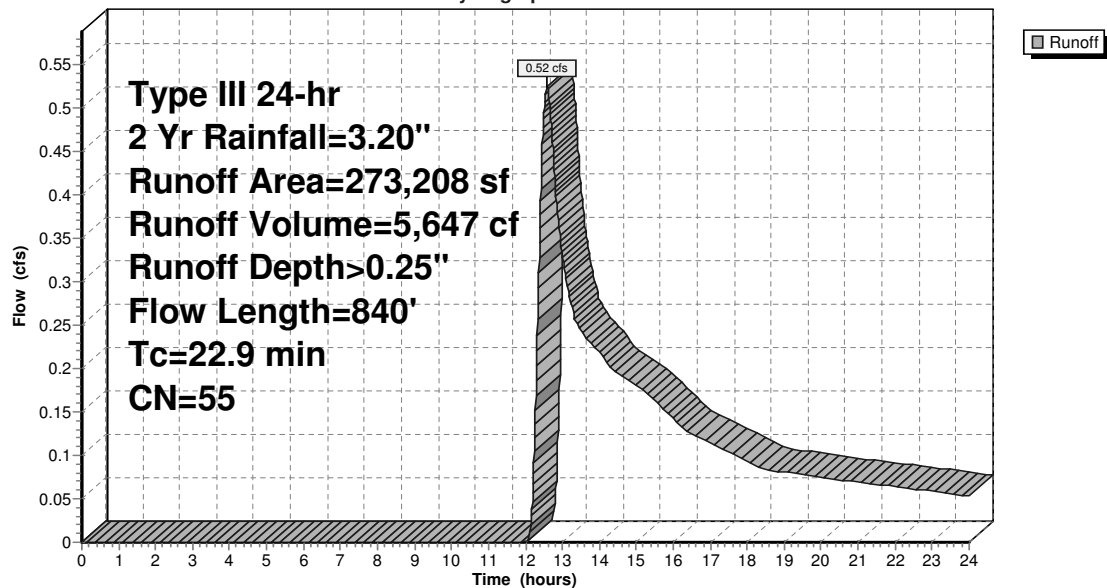

Summary for Subcatchment E3: PreDev

Runoff = 0.46 cfs @ 12.67 hrs, Volume= 5,296 cf, Depth> 0.25"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
 Type III 24-hr 2 Yr Rainfall=3.20"

Area (sf)	CN	Description
256,975	55	Woods, Good, HSG B
256,975		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.9	50	0.0600	0.10		Sheet Flow, A-B Woods: Light underbrush n= 0.400 P2= 3.20"
5.3	450	0.0800	1.41		Shallow Concentrated Flow, B-C Woodland Kv= 5.0 fps
15.1	495	0.0120	0.55		Shallow Concentrated Flow, C-D Woodland Kv= 5.0 fps
28.3	995	Total			

Subcatchment E3: PreDev

Hydrograph

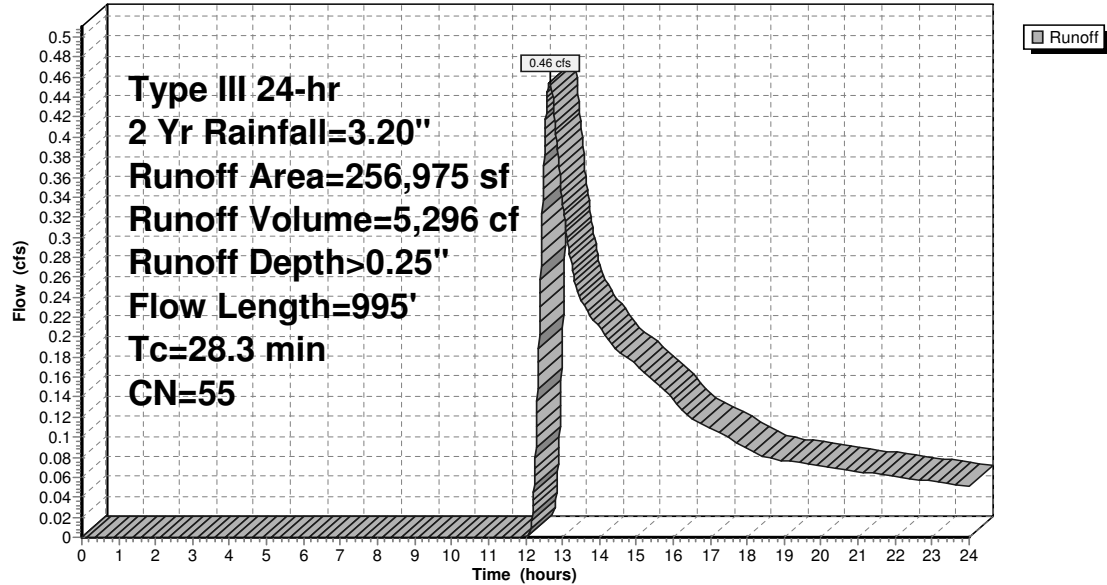

Summary for Subcatchment P1: Post Dev

Runoff = 0.15 cfs @ 12.39 hrs, Volume= 1,266 cf, Depth> 0.28"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
 Type III 24-hr 2 Yr Rainfall=3.20"

Area (sf)	CN	Description
848	98	Roofs, HSG B
4,300	61	>75% Grass cover, Good, HSG B
49,461	55	Woods, Good, HSG B
54,609	56	Weighted Average
53,761		98.45% Pervious Area
848		1.55% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.2	50	0.0200	0.10		Sheet Flow, A-B Grass: Dense n= 0.240 P2= 3.20"
0.2	60	0.0800	4.55		Shallow Concentrated Flow, B-C Unpaved Kv= 16.1 fps
2.9	235	0.0750	1.37		Shallow Concentrated Flow, C-D Woodland Kv= 5.0 fps
11.3	345	Total			

Subcatchment P1: Post Dev

Hydrograph

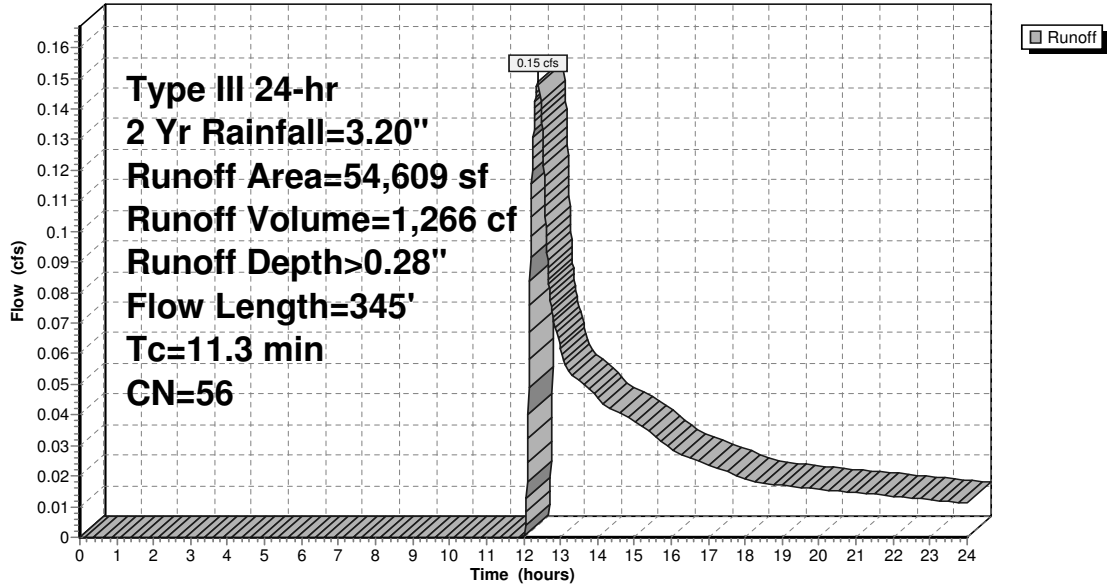

Summary for Subcatchment P2: Post Dev

Runoff = 5.93 cfs @ 12.18 hrs, Volume= 24,514 cf, Depth> 0.93"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
 Type III 24-hr 2 Yr Rainfall=3.20"

Area (sf)	CN	Description
* 28,527	98	Paved Road, HSG B
* 7,666	98	Paved Sidewalk, HSG B
* 27,215	98	Paved Drives, HSG B
30,966	98	Roofs, HSG B
223,133	61	>75% Grass cover, Good, HSG B
317,507	72	Weighted Average
223,133		70.28% Pervious Area
94,374		29.72% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.8	50	0.0100	0.08		Sheet Flow, A-B Grass: Dense n= 0.240 P2= 3.20"
0.4	80	0.0500	3.60		Shallow Concentrated Flow, B-C Unpaved Kv= 16.1 fps
0.7	220	0.0700	5.37		Shallow Concentrated Flow, C-D Paved Kv= 20.3 fps
0.4	310	0.0800	12.83	10.08	Pipe Channel, C-D 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.013
12.3	660	Total			

Subcatchment P2: Post Dev

Hydrograph

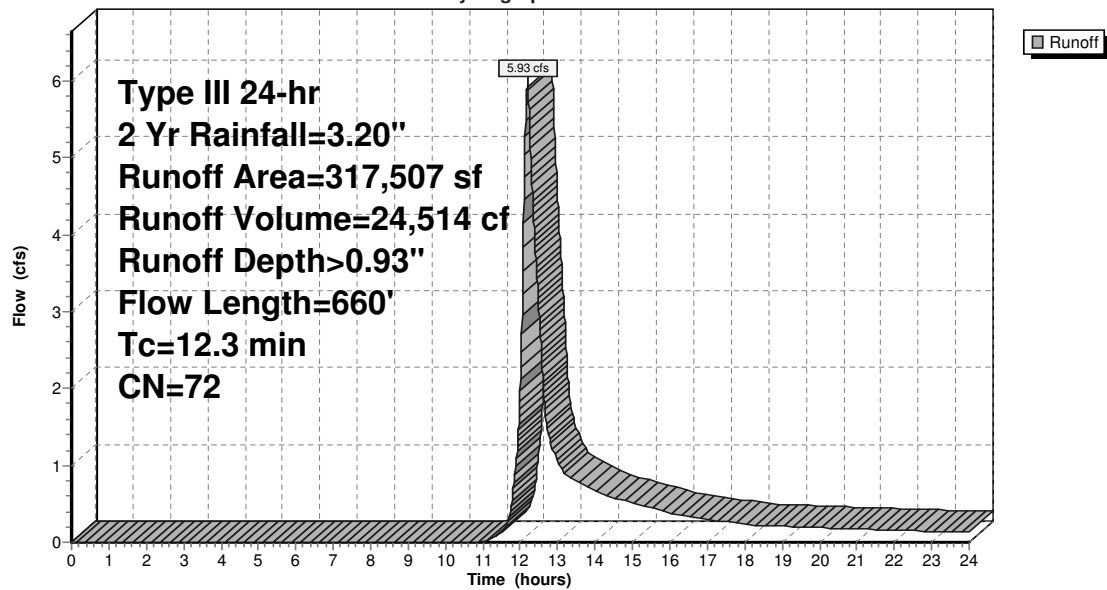

Summary for Subcatchment P3: Roof Front

Runoff = 0.59 cfs @ 12.62 hrs, Volume= 5,854 cf, Depth> 0.31"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
Type III 24-hr 2 Yr Rainfall=3.20"

Area (sf)	CN	Description
4,976	98	Roofs, HSG B
54,253	61	>75% Grass cover, Good, HSG B
170,616	55	Woods, Good, HSG B
229,845	57	Weighted Average
224,869		97.84% Pervious Area
4,976		2.16% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.2	50	0.0200	0.10		Sheet Flow, A-B Grass: Dense n= 0.240 P2= 3.20"
5.4	460	0.0800	1.41		Shallow Concentrated Flow, B-C Woodland Kv= 5.0 fps
15.1	495	0.0120	0.55		Shallow Concentrated Flow, C-D Woodland Kv= 5.0 fps
28.7	1,005	Total			

Subcatchment P3: Roof Front

Hydrograph

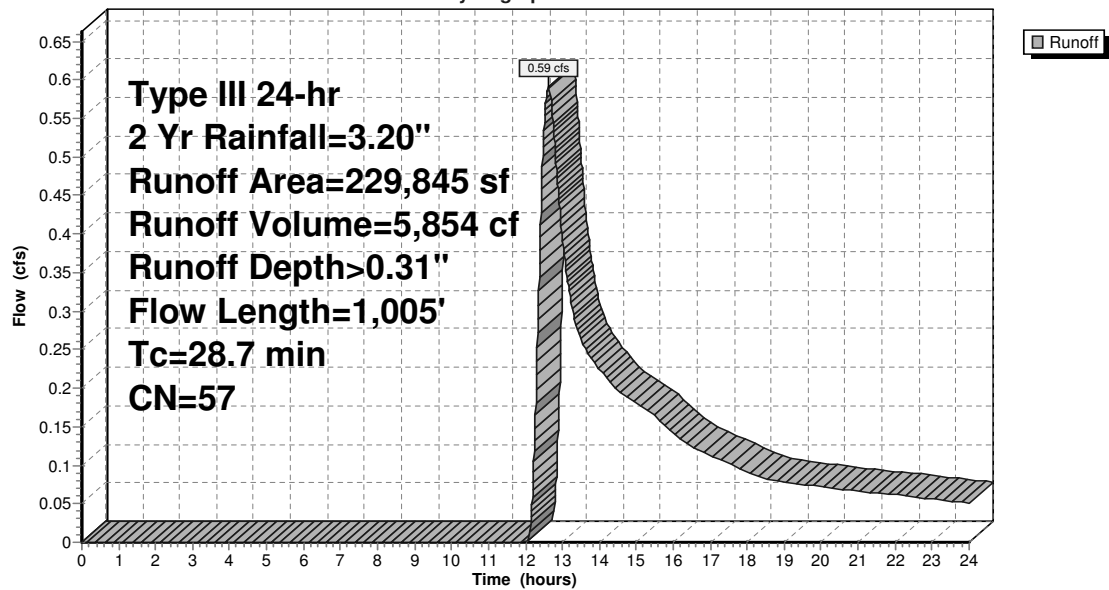

Summary for Reach 1R: Stream

Inflow Area = 63,319 sf, 0.00% Impervious, Inflow Depth > 0.25" for 2 Yr event
 Inflow = 0.13 cfs @ 12.49 hrs, Volume= 1,313 cf
 Outflow = 0.13 cfs @ 12.57 hrs, Volume= 1,307 cf, Atten= 1%, Lag= 4.8 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs

Max. Velocity= 1.73 fps, Min. Travel Time= 2.9 min

Avg. Velocity = 1.06 fps, Avg. Travel Time= 4.7 min

Peak Storage= 23 cf @ 12.52 hrs

Average Depth at Peak Storage= 0.10'

Bank-Full Depth= 1.00' Flow Area= 2.3 sf, Capacity= 16.68 cfs

3.50' x 1.00' deep Parabolic Channel, n= 0.040 Winding stream, pools & shoals


Length= 300.0' Slope= 0.0800 '/'

Inlet Invert= 298.00', Outlet Invert= 274.00'



Reach 1R: Stream

Hydrograph

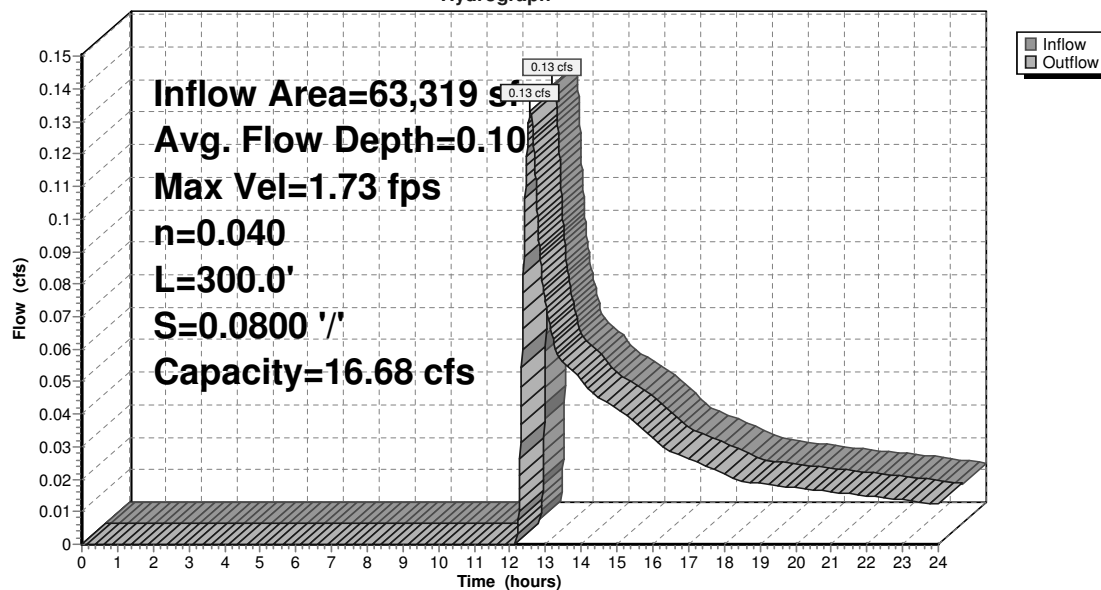

Summary for Reach 2R: Stream

Inflow Area = 336,527 sf, 0.00% Impervious, Inflow Depth > 0.25" for 2 Yr event
 Inflow = 0.66 cfs @ 12.59 hrs, Volume= 6,953 cf
 Outflow = 0.65 cfs @ 12.68 hrs, Volume= 6,908 cf, Atten= 1%, Lag= 5.6 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs

Max. Velocity= 1.93 fps, Min. Travel Time= 3.5 min

Avg. Velocity = 1.11 fps, Avg. Travel Time= 6.2 min

Peak Storage= 138 cf @ 12.62 hrs

Average Depth at Peak Storage= 0.12'

Bank-Full Depth= 2.00' Flow Area= 13.0 sf, Capacity= 118.99 cfs

2.50' x 2.00' deep channel, n= 0.040 Winding stream, pools & shoals

Side Slope Z-value= 2.0 '/' Top Width= 10.50'


Length= 410.0' Slope= 0.0512 '/

Inlet Invert= 274.00', Outlet Invert= 253.00'



Reach 2R: Stream

Hydrograph

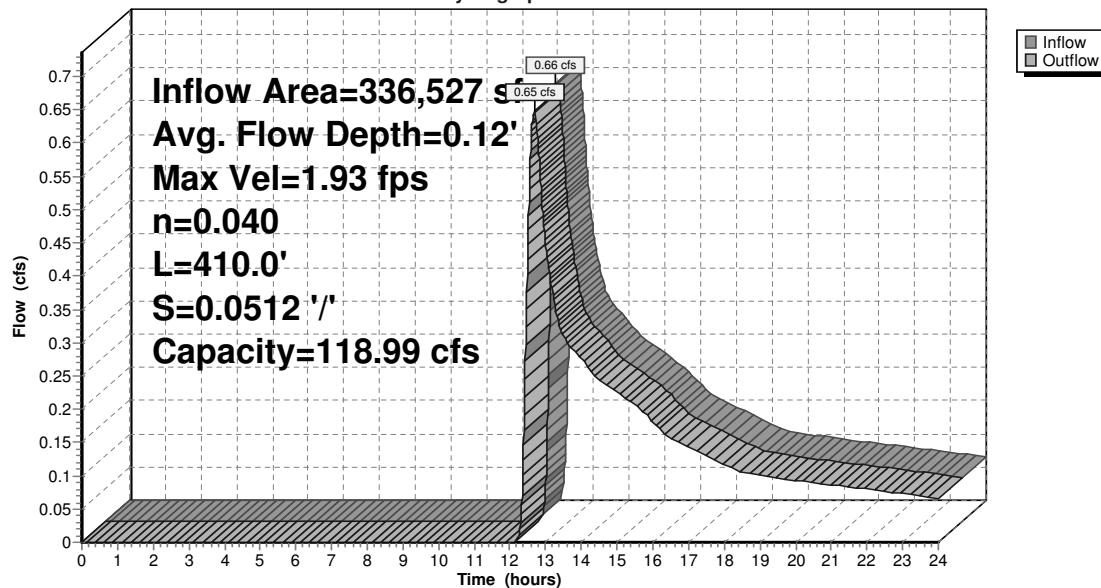

Summary for Reach 3R: Stream

Inflow Area = 54,609 sf, 1.55% Impervious, Inflow Depth > 0.28" for 2 Yr event
 Inflow = 0.15 cfs @ 12.39 hrs, Volume= 1,266 cf
 Outflow = 0.15 cfs @ 12.47 hrs, Volume= 1,260 cf, Atten= 1%, Lag= 4.9 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs

Max. Velocity= 1.79 fps, Min. Travel Time= 2.8 min

Avg. Velocity = 1.04 fps, Avg. Travel Time= 4.8 min

Peak Storage= 25 cf @ 12.43 hrs

Average Depth at Peak Storage= 0.11'

Bank-Full Depth= 1.00' Flow Area= 2.3 sf, Capacity= 16.68 cfs

3.50' x 1.00' deep Parabolic Channel, n= 0.040 Winding stream, pools & shoals


Length= 300.0' Slope= 0.0800 '/'

Inlet Invert= 298.00', Outlet Invert= 274.00'



Reach 3R: Stream

Hydrograph

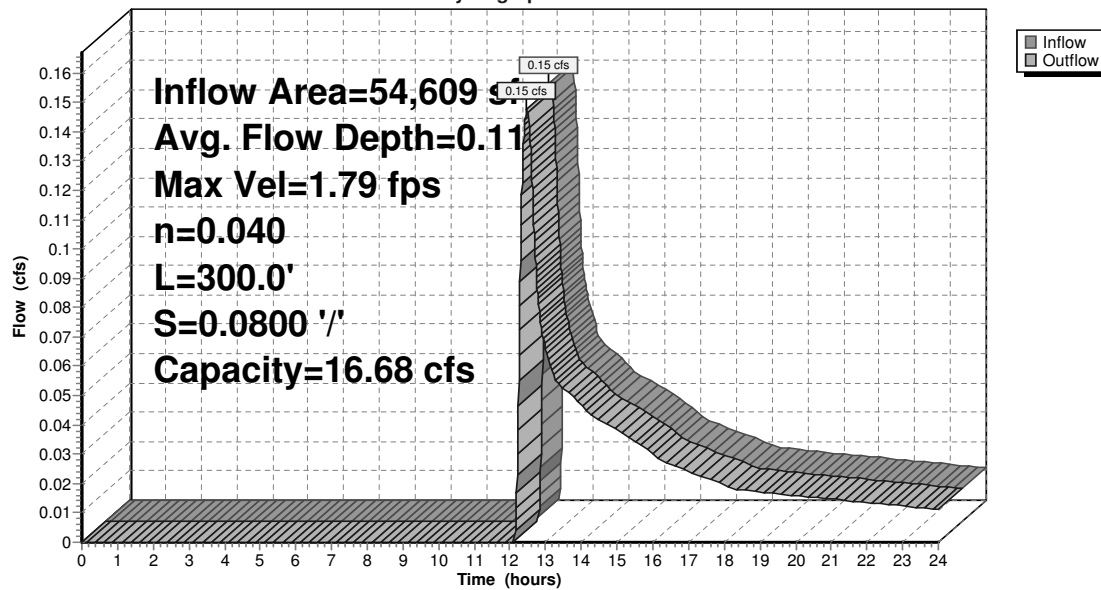

Summary for Reach 4R: Stream

Inflow Area = 54,609 sf, 1.55% Impervious, Inflow Depth > 0.28" for 2 Yr event
 Inflow = 0.15 cfs @ 12.47 hrs, Volume= 1,260 cf
 Outflow = 0.14 cfs @ 12.66 hrs, Volume= 1,248 cf, Atten= 5%, Lag= 10.9 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs

Max. Velocity= 1.11 fps, Min. Travel Time= 6.2 min

Avg. Velocity = 0.66 fps, Avg. Travel Time= 10.3 min

Peak Storage= 52 cf @ 12.55 hrs

Average Depth at Peak Storage= 0.05'

Bank-Full Depth= 2.00' Flow Area= 13.0 sf, Capacity= 118.99 cfs

2.50' x 2.00' deep channel, n= 0.040 Winding stream, pools & shoals

Side Slope Z-value= 2.0 '/' Top Width= 10.50'


Length= 410.0' Slope= 0.0512 '/'

Inlet Invert= 274.00', Outlet Invert= 253.00'



Reach 4R: Stream

Hydrograph

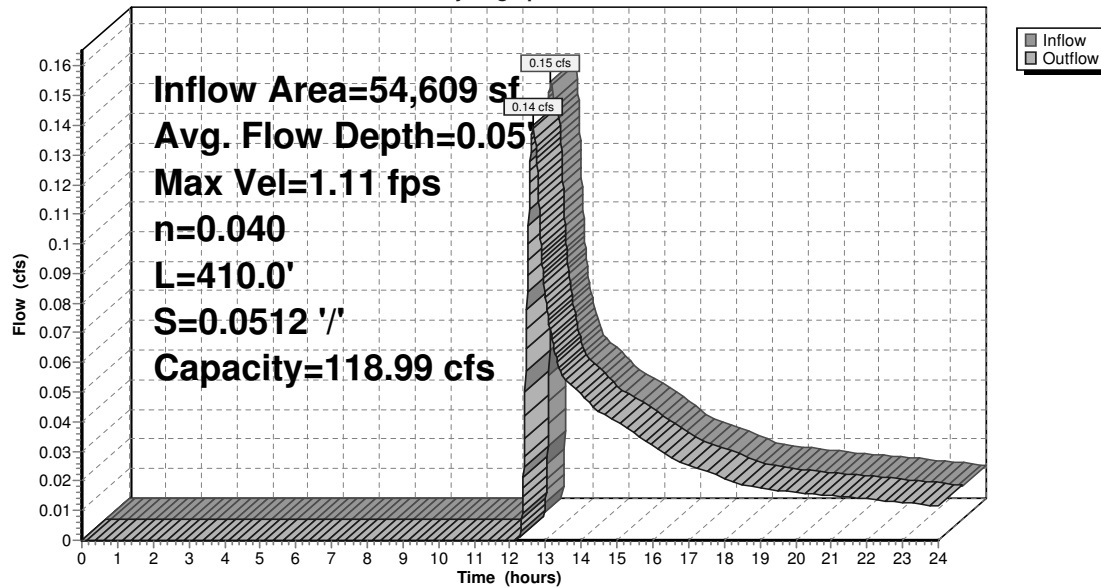

Summary for Pond 1P: Det Basin

Inflow Area = 317,507 sf, 29.72% Impervious, Inflow Depth > 0.93" for 2 Yr event
 Inflow = 5.93 cfs @ 12.18 hrs, Volume= 24,514 cf
 Outflow = 0.71 cfs @ 13.86 hrs, Volume= 18,709 cf, Atten= 88%, Lag= 100.3 min
 Discarded = 0.24 cfs @ 13.86 hrs, Volume= 8,482 cf
 Primary = 0.46 cfs @ 13.86 hrs, Volume= 10,226 cf

Routing by Stor-Ind method, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
 Peak Elev= 269.29' @ 13.86 hrs Surf.Area= 5,984 sf Storage= 10,887 cf

Plug-Flow detention time= 226.3 min calculated for 18,701 cf (76% of inflow)
 Center-of-Mass det. time= 135.8 min (1,008.5 - 872.6)

Volume	Invert	Avail.Storage	Storage Description		
#1	266.00'	46,058 cf	Custom Stage Data (Irregular) Listed below (Recalc)		
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
266.00	1,320	147.0	0	0	1,320
268.00	3,623	243.0	4,753	4,753	4,325
270.00	7,534	370.0	10,921	15,674	10,550
272.00	11,140	448.0	18,557	34,231	15,693
273.00	12,527	468.0	11,827	46,058	17,221

Device	Routing	Invert	Outlet Devices	
#1	Discarded	266.00'	1.020 in/hr Exfiltration over Surface area Conductivity to Groundwater Elevation = 264.00'	
#2	Primary	265.00'	24.0" Round Culvert L= 45.0' RCP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 265.00' / 259.00' S= 0.1333 '/ Cc= 0.900 n= 0.013, Flow Area= 3.14 sf	
#3	Device 2	268.20'	4.0" Vert. Orifice/Grate C= 0.600	
#4	Device 2	269.20'	0.7' long Sharp-Crested Rectangular Weir 2 End Contraction(s) 4.5' Crest Height	
#5	Device 2	272.30'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads	

16181

Prepared by Microsoft

HydroCAD® 10.00-18 s/n 07559 © 2016 HydroCAD Software Solutions LLC

Type III 24-hr 2 Yr Rainfall=3.20"

Printed 5/14/2020

Page 23

Discarded OutFlow Max=0.24 cfs @ 13.86 hrs HW=269.29' (Free Discharge)

1=Exfiltration (Controls 0.24 cfs)

Primary OutFlow Max=0.46 cfs @ 13.86 hrs HW=269.29' (Free Discharge)

2=Culvert (Passes 0.46 cfs of 27.44 cfs potential flow)


3=Orifice/Grate (Orifice Controls 0.40 cfs @ 4.63 fps)

4=Sharp-Crested Rectangular Weir (Weir Controls 0.06 cfs @ 0.98 fps)

5=Orifice/Grate (Controls 0.00 cfs)

Pond 1P: Det Basin

Hydrograph

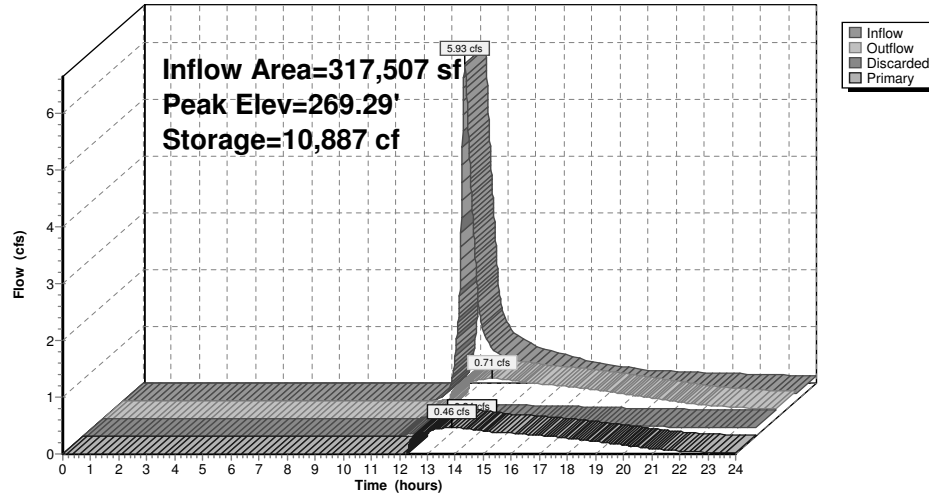

16181

Prepared by Microsoft

HydroCAD® 10.00-18 s/n 07559 © 2016 HydroCAD Software Solutions LLC

Type III 24-hr 2 Yr Rainfall=3.20"

Printed 5/14/2020

Page 24

Summary for Pond 6P: Det Pond #1

Volume	Invert	Avail. Storage	Storage Description			
#1	108.50'	18,111 cf	Custom Stage Data (Irregular) Listed below (Recalc)			
Elevation (feet)	Surf. Area (sq-ft)	Perim. (feet)	Inc. Store (cubic-feet)	Cum. Store (cubic-feet)	Wet. Area (sq-ft)	
108.50	50	100.0	0	0	50	
108.70	1,481	179.0	120	120	1,804	
109.00	4,194	326.0	817	937	7,712	
110.00	5,261	371.0	4,717	5,654	10,232	
111.00	6,223	387.0	5,735	11,390	11,269	
112.00	7,233	402.0	6,722	18,111	12,290	

Device	Routing	Invert	Outlet Devices			
#1	Primary	108.50'	18.0" Round Culvert L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 108.50' / 108.00' S= 0.0250' / Cc= 0.900 n= 0.013, Flow Area= 1.77 sf			
#2	Device 1	108.50'	2.0" Vert. Orifice/Grate C= 0.600			
#3	Device 1	111.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads			
#4	Device 1	110.00'	2.5' long Sharp-Crested Rectangular Weir 2 End Contraction(s) 1.0' Crest Height			

Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=0.00' (Free Discharge)

1=Culvert (Controls 0.00 cfs)


2=Orifice/Grate (Controls 0.00 cfs)

3=Orifice/Grate (Controls 0.00 cfs)

4=Sharp-Crested Rectangular Weir (Controls 0.00 cfs)

Pond 6P: Det Pond #1

Hydrograph

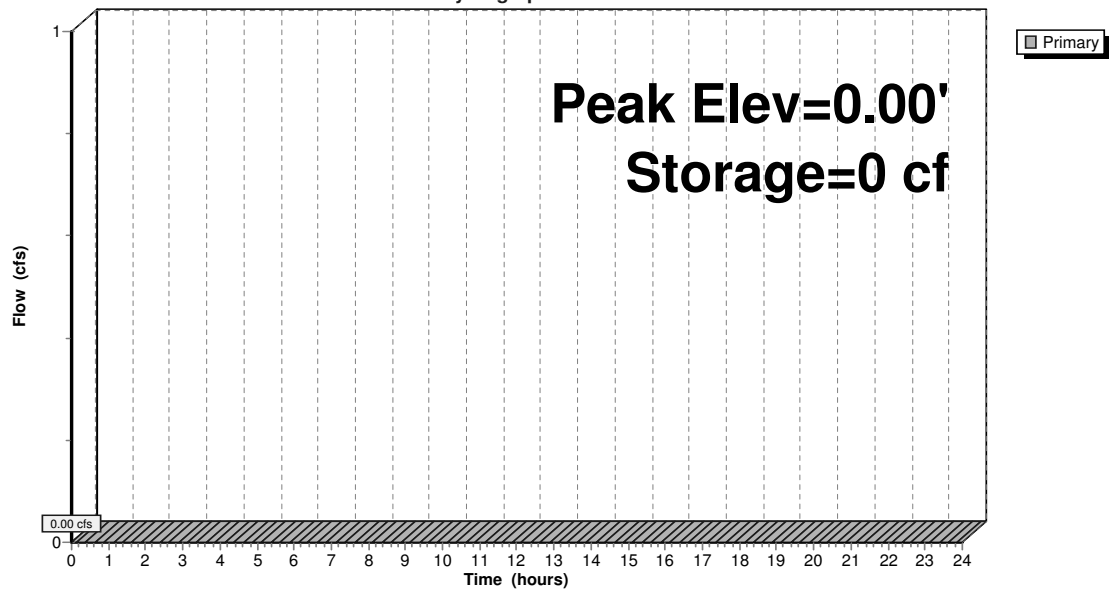


Summary for Link DP1: PreDev

Inflow Area = 593,502 sf, 0.00% Impervious, Inflow Depth > 0.25" for 2 Yr event
Inflow = 1.10 cfs @ 12.67 hrs, Volume= 12,203 cf
Primary = 1.10 cfs @ 12.67 hrs, Volume= 12,203 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs

Link DP1: PreDev


Hydrograph

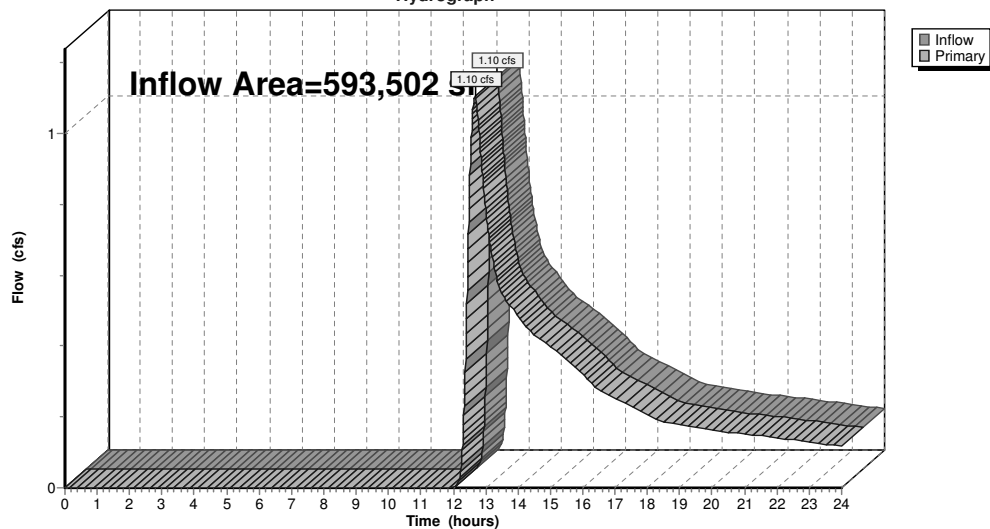

Summary for Link DP2: Post Offsite

Inflow Area = 601,961 sf, 16.65% Impervious, Inflow Depth > 0.35" for 2 Yr event
 Inflow = 1.08 cfs @ 12.66 hrs, Volume= 17,328 cf
 Primary = 1.08 cfs @ 12.66 hrs, Volume= 17,328 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs

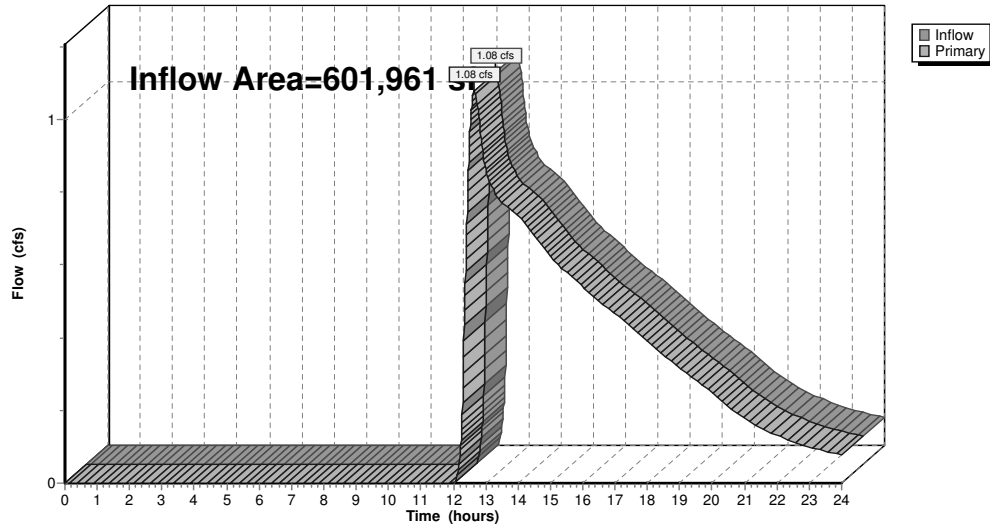Link DP2: Post Offsite**Hydrograph****Summary for Subcatchment E1: PreDev**

Runoff = 0.84 cfs @ 12.27 hrs, Volume= 4,629 cf, Depth> 0.88"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
 Type III 24-hr 10 Yr Rainfall=4.80"

Area (sf)	CN	Description
63,319	55	Woods, Good, HSG B
63,319		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.3	50	0.0200	0.07		Sheet Flow, A-B
					Woods: Light underbrush n= 0.400 P2= 3.20"
3.8	310	0.0750	1.37		Shallow Concentrated Flow, B-C
					Woodland Kv= 5.0 fps
16.1	360	Total			

Subcatchment E1: PreDev

Hydrograph

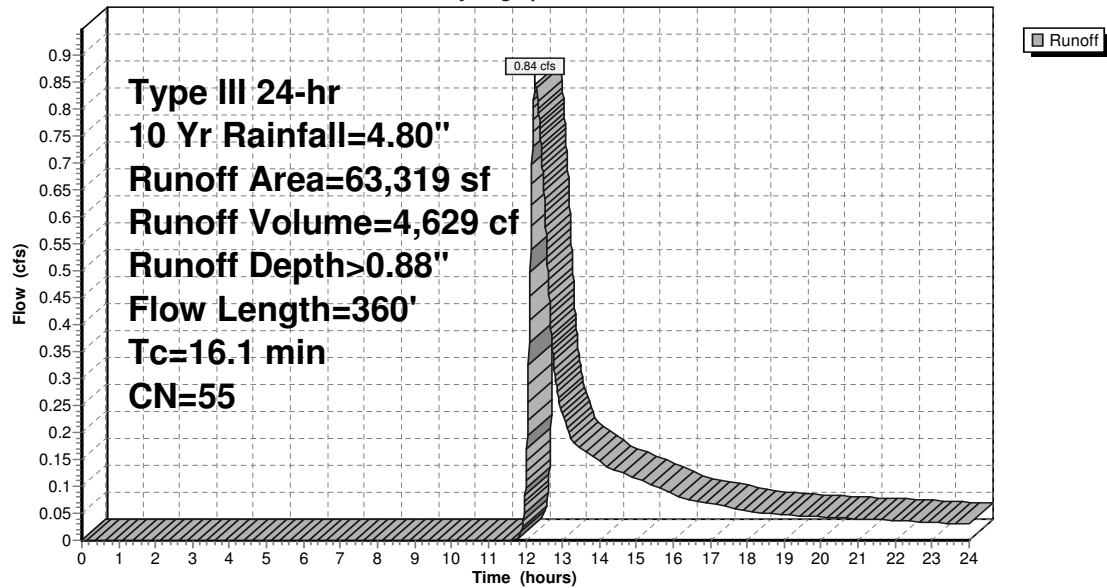

Summary for Subcatchment E2: PreDev

Runoff = 3.22 cfs @ 12.39 hrs, Volume= 19,925 cf, Depth> 0.88"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
Type III 24-hr 10 Yr Rainfall=4.80"

Area (sf)	CN	Description
273,208	55	Woods, Good, HSG B
273,208		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.5	50	0.0300	0.08		Sheet Flow, A-B
					Woods: Light underbrush n= 0.400 P2= 3.20"
12.4	790	0.0450	1.06		Shallow Concentrated Flow, B-C
					Woodland Kv= 5.0 fps
22.9	840	Total			

Subcatchment E2: PreDev

Hydrograph

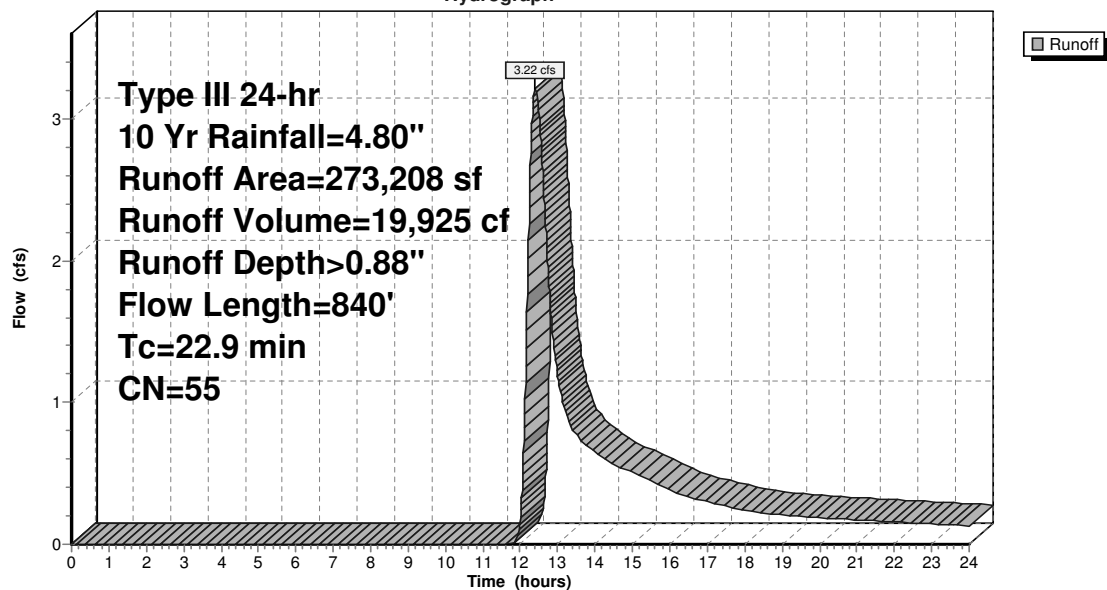

Summary for Subcatchment E3: PreDev

Runoff = 2.79 cfs @ 12.48 hrs, Volume= 18,704 cf, Depth> 0.87"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
Type III 24-hr 10 Yr Rainfall=4.80"

Area (sf)	CN	Description
256,975	55	Woods, Good, HSG B
256,975		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.9	50	0.0600	0.10		Sheet Flow, A-B Woods: Light underbrush n= 0.400 P2= 3.20"
5.3	450	0.0800	1.41		Shallow Concentrated Flow, B-C Woodland Kv= 5.0 fps
15.1	495	0.0120	0.55		Shallow Concentrated Flow, C-D Woodland Kv= 5.0 fps
28.3	995	Total			

Subcatchment E3: PreDev

Hydrograph

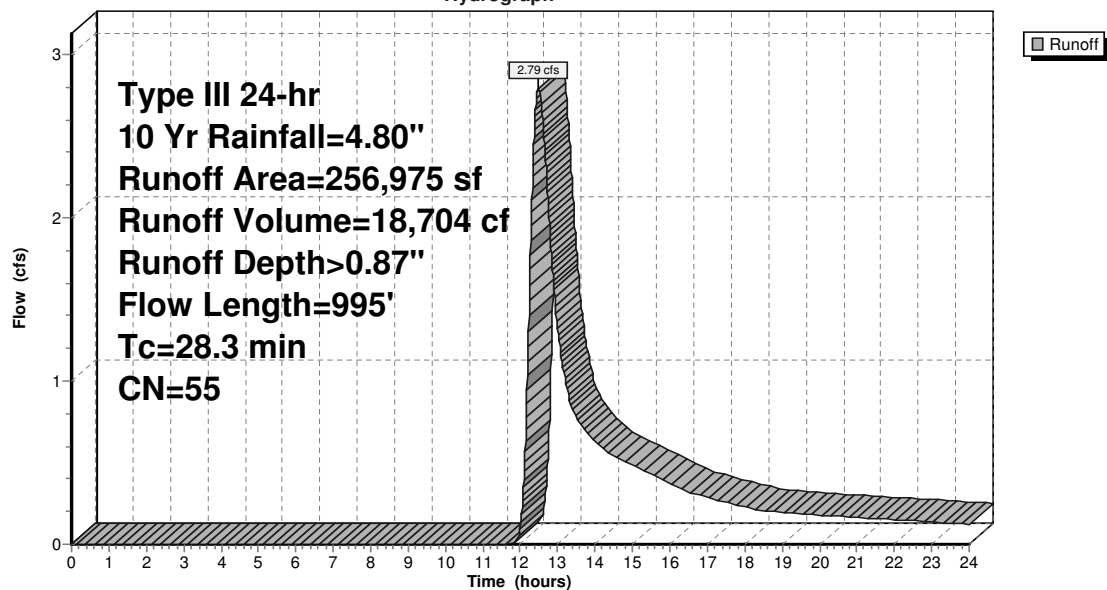

Summary for Subcatchment P1: Post Dev

Runoff = 0.91 cfs @ 12.19 hrs, Volume= 4,263 cf, Depth> 0.94"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
 Type III 24-hr 10 Yr Rainfall=4.80"

Area (sf)	CN	Description
848	98	Roofs, HSG B
4,300	61	>75% Grass cover, Good, HSG B
49,461	55	Woods, Good, HSG B
54,609	56	Weighted Average
53,761		98.45% Pervious Area
848		1.55% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.2	50	0.0200	0.10		Sheet Flow, A-B
					Grass: Dense n= 0.240 P2= 3.20"
0.2	60	0.0800	4.55		Shallow Concentrated Flow, B-C
					Unpaved Kv= 16.1 fps
2.9	235	0.0750	1.37		Shallow Concentrated Flow, C-D
					Woodland Kv= 5.0 fps
11.3	345				Total

Subcatchment P1: Post Dev

Hydrograph

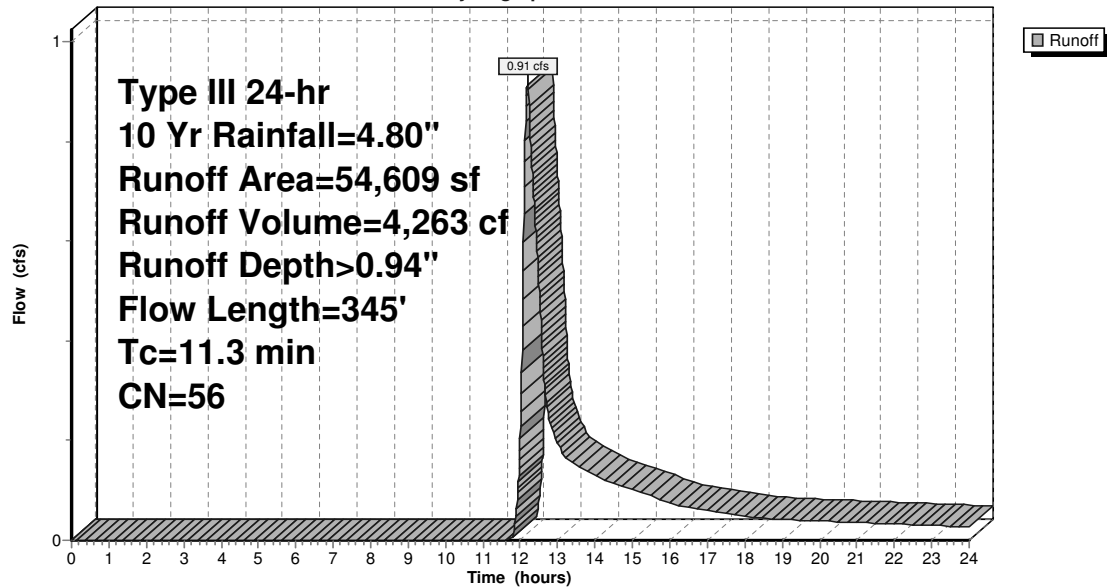

Summary for Subcatchment P2: Post Dev

Runoff = 14.00 cfs @ 12.18 hrs, Volume= 53,955 cf, Depth> 2.04"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
 Type III 24-hr 10 Yr Rainfall=4.80"

Area (sf)	CN	Description
* 28,527	98	Paved Road, HSG B
* 7,666	98	Paved Sidewalk, HSG B
* 27,215	98	Paved Drives, HSG B
30,966	98	Roofs, HSG B
223,133	61	>75% Grass cover, Good, HSG B
317,507	72	Weighted Average
223,133		70.28% Pervious Area
94,374		29.72% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.8	50	0.0100	0.08		Sheet Flow, A-B Grass: Dense n= 0.240 P2= 3.20"
0.4	80	0.0500	3.60		Shallow Concentrated Flow, B-C Unpaved Kv= 16.1 fps
0.7	220	0.0700	5.37		Shallow Concentrated Flow, C-D Paved Kv= 20.3 fps
0.4	310	0.0800	12.83	10.08	Pipe Channel, C-D 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.013
12.3	660	Total			

Subcatchment P2: Post Dev

Hydrograph

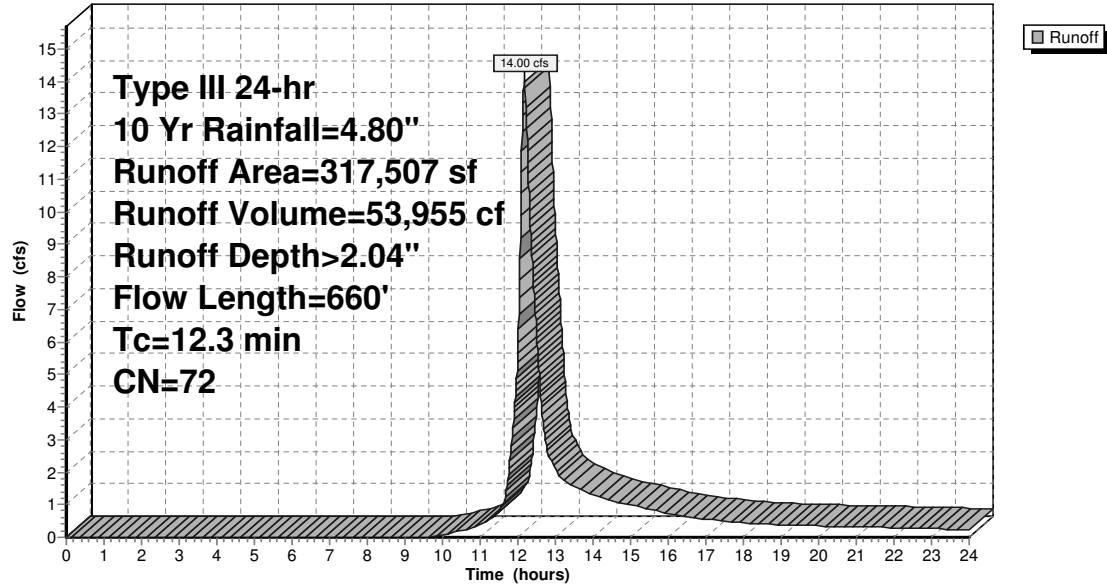

Summary for Subcatchment P3: Roof Front

Runoff = 2.97 cfs @ 12.47 hrs, Volume= 18,966 cf, Depth> 0.99"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
Type III 24-hr 10 Yr Rainfall=4.80"

Area (sf)	CN	Description
4,976	98	Roofs, HSG B
54,253	61	>75% Grass cover, Good, HSG B
170,616	55	Woods, Good, HSG B
229,845	57	Weighted Average
224,869		97.84% Pervious Area
4,976		2.16% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.2	50	0.0200	0.10		Sheet Flow, A-B Grass: Dense n= 0.240 P2= 3.20"
5.4	460	0.0800	1.41		Shallow Concentrated Flow, B-C Woodland Kv= 5.0 fps
15.1	495	0.0120	0.55		Shallow Concentrated Flow, C-D Woodland Kv= 5.0 fps
28.7	1,005	Total			

Subcatchment P3: Roof Front

Hydrograph

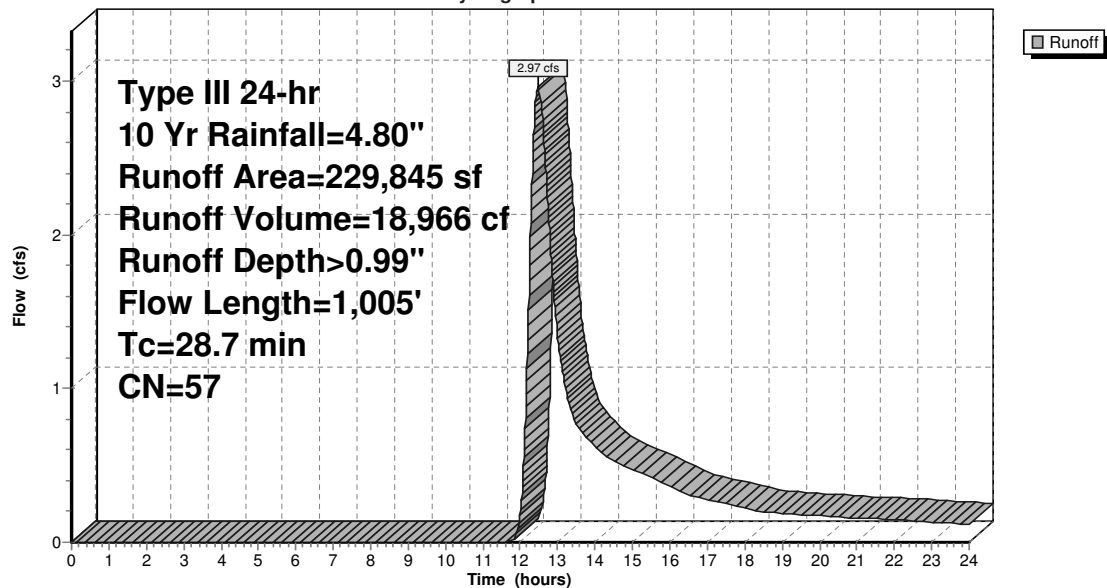

Summary for Reach 1R: Stream

Inflow Area = 63,319 sf, 0.00% Impervious, Inflow Depth > 0.88" for 10 Yr event
 Inflow = 0.84 cfs @ 12.27 hrs, Volume= 4,629 cf
 Outflow = 0.84 cfs @ 12.32 hrs, Volume= 4,618 cf, Atten= 1%, Lag= 3.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs

Max. Velocity= 3.02 fps, Min. Travel Time= 1.7 min

Avg. Velocity = 1.47 fps, Avg. Travel Time= 3.4 min

Peak Storage= 83 cf @ 12.30 hrs

Average Depth at Peak Storage= 0.24'

Bank-Full Depth= 1.00' Flow Area= 2.3 sf, Capacity= 16.68 cfs

3.50' x 1.00' deep Parabolic Channel, n= 0.040 Winding stream, pools & shoals


Length= 300.0' Slope= 0.0800 '/'

Inlet Invert= 298.00', Outlet Invert= 274.00'



Reach 1R: Stream

Hydrograph

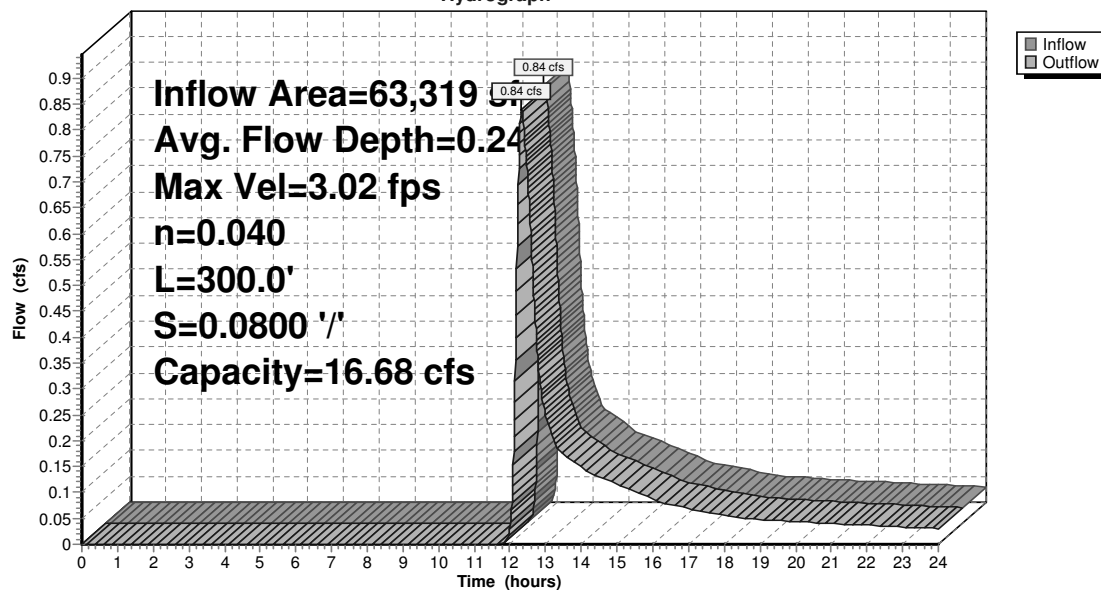

Summary for Reach 2R: Stream

Inflow Area = 336,527 sf, 0.00% Impervious, Inflow Depth > 0.88" for 10 Yr event
 Inflow = 4.02 cfs @ 12.39 hrs, Volume= 24,543 cf
 Outflow = 4.00 cfs @ 12.44 hrs, Volume= 24,468 cf, Atten= 1%, Lag= 3.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs

Max. Velocity= 3.56 fps, Min. Travel Time= 1.9 min

Avg. Velocity = 1.64 fps, Avg. Travel Time= 4.2 min

Peak Storage= 460 cf @ 12.41 hrs

Average Depth at Peak Storage= 0.35'

Bank-Full Depth= 2.00' Flow Area= 13.0 sf, Capacity= 118.99 cfs

2.50' x 2.00' deep channel, n= 0.040 Winding stream, pools & shoals

Side Slope Z-value= 2.0 '/' Top Width= 10.50'


Length= 410.0' Slope= 0.0512 '/'

Inlet Invert= 274.00', Outlet Invert= 253.00'



Reach 2R: Stream

Hydrograph

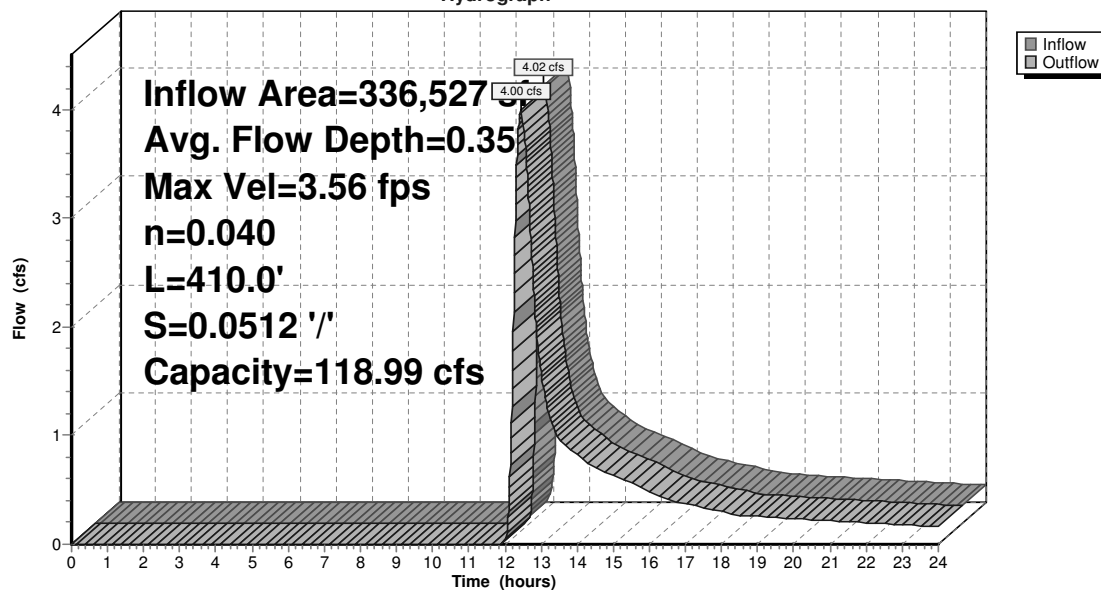

Summary for Reach 3R: Stream

Inflow Area = 54,609 sf, 1.55% Impervious, Inflow Depth > 0.94" for 10 Yr event
 Inflow = 0.91 cfs @ 12.19 hrs, Volume= 4,263 cf
 Outflow = 0.90 cfs @ 12.23 hrs, Volume= 4,253 cf, Atten= 1%, Lag= 2.9 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs

Max. Velocity= 3.08 fps, Min. Travel Time= 1.6 min

Avg. Velocity = 1.42 fps, Avg. Travel Time= 3.5 min

Peak Storage= 88 cf @ 12.21 hrs

Average Depth at Peak Storage= 0.25'

Bank-Full Depth= 1.00' Flow Area= 2.3 sf, Capacity= 16.68 cfs

3.50' x 1.00' deep Parabolic Channel, n= 0.040 Winding stream, pools & shoals


Length= 300.0' Slope= 0.0800 '/'

Inlet Invert= 298.00', Outlet Invert= 274.00'



Reach 3R: Stream

Hydrograph

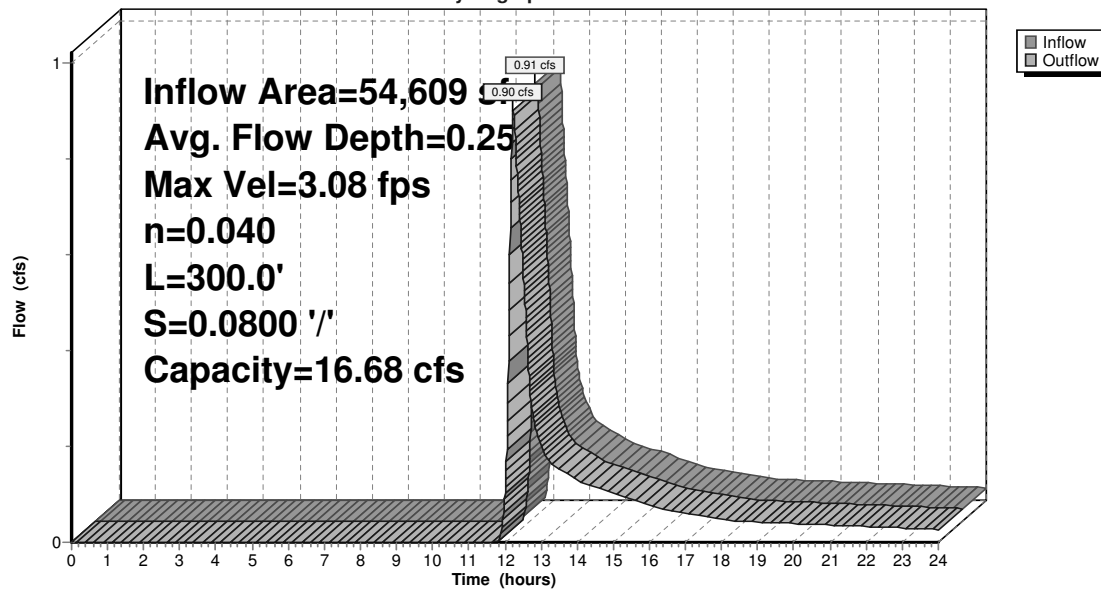

Summary for Reach 4R: Stream

Inflow Area = 54,609 sf, 1.55% Impervious, Inflow Depth > 0.93" for 10 Yr event
 Inflow = 0.90 cfs @ 12.23 hrs, Volume= 4,253 cf
 Outflow = 0.86 cfs @ 12.33 hrs, Volume= 4,230 cf, Atten= 4%, Lag= 5.9 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs

Max. Velocity= 2.14 fps, Min. Travel Time= 3.2 min

Avg. Velocity = 0.86 fps, Avg. Travel Time= 7.9 min

Peak Storage= 165 cf @ 12.28 hrs

Average Depth at Peak Storage= 0.14'

Bank-Full Depth= 2.00' Flow Area= 13.0 sf, Capacity= 118.99 cfs

2.50' x 2.00' deep channel, n= 0.040 Winding stream, pools & shoals

Side Slope Z-value= 2.0 '/' Top Width= 10.50'


Length= 410.0' Slope= 0.0512 '/'

Inlet Invert= 274.00', Outlet Invert= 253.00'



Reach 4R: Stream

Hydrograph

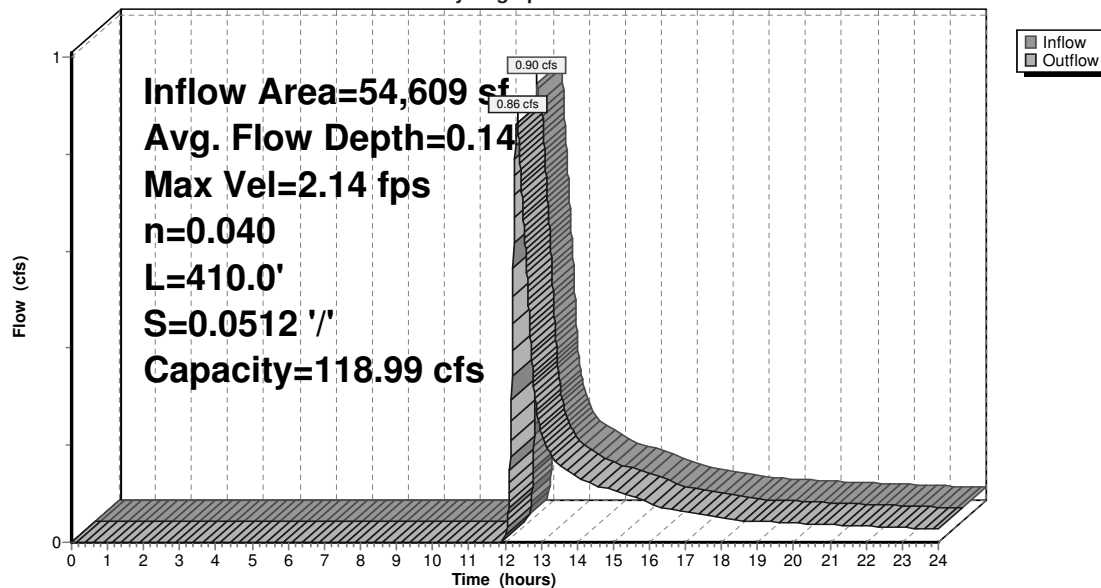

Summary for Pond 1P: Det Basin

Inflow Area = 317,507 sf, 29.72% Impervious, Inflow Depth > 2.04" for 10 Yr event
 Inflow = 14.00 cfs @ 12.18 hrs, Volume= 53,955 cf
 Outflow = 3.50 cfs @ 12.67 hrs, Volume= 47,068 cf, Atten= 75%, Lag= 29.5 min
 Discarded = 0.38 cfs @ 12.67 hrs, Volume= 11,010 cf
 Primary = 3.12 cfs @ 12.67 hrs, Volume= 36,058 cf

Routing by Stor-Ind method, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
 Peak Elev= 270.69' @ 12.67 hrs Surf.Area= 8,693 sf Storage= 21,243 cf

Plug-Flow detention time= 148.1 min calculated for 47,068 cf (87% of inflow)
 Center-of-Mass det. time= 90.2 min (939.0 - 848.8)

Volume	Invert	Avail.Storage	Storage Description		
#1	266.00'	46,058 cf	Custom Stage Data (Irregular) Listed below (Recalc)		
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
266.00	1,320	147.0	0	0	1,320
268.00	3,623	243.0	4,753	4,753	4,325
270.00	7,534	370.0	10,921	15,674	10,550
272.00	11,140	448.0	18,557	34,231	15,693
273.00	12,527	468.0	11,827	46,058	17,221

Device	Routing	Invert	Outlet Devices	
#1	Discarded	266.00'	1.020 in/hr Exfiltration over Surface area Conductivity to Groundwater Elevation = 264.00'	
#2	Primary	265.00'	24.0" Round Culvert L= 45.0' RCP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 265.00' / 259.00' S= 0.1333 '/ Cc= 0.900 n= 0.013, Flow Area= 3.14 sf	
#3	Device 2	268.20'	4.0" Vert. Orifice/Grate C= 0.600	
#4	Device 2	269.20'	0.7' long Sharp-Crested Rectangular Weir 2 End Contraction(s) 4.5' Crest Height	
#5	Device 2	272.30'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads	

16181

Prepared by Microsoft

HydroCAD® 10.00-18 s/n 07559 © 2016 HydroCAD Software Solutions LLC

Type III 24-hr 10 Yr Rainfall=4.80"

Printed 5/14/2020

Page 49

Discarded OutFlow Max=0.38 cfs @ 12.67 hrs HW=270.69' (Free Discharge)

1=Exfiltration (Controls 0.38 cfs)

Primary OutFlow Max=3.12 cfs @ 12.67 hrs HW=270.69' (Free Discharge)

2=Culvert (Passes 3.12 cfs of 32.75 cfs potential flow)


3=Orifice/Grate (Orifice Controls 0.64 cfs @ 7.33 fps)

4=Sharp-Crested Rectangular Weir (Weir Controls 2.48 cfs @ 4.15 fps)

5=Orifice/Grate (Controls 0.00 cfs)

Pond 1P: Det Basin

Hydrograph

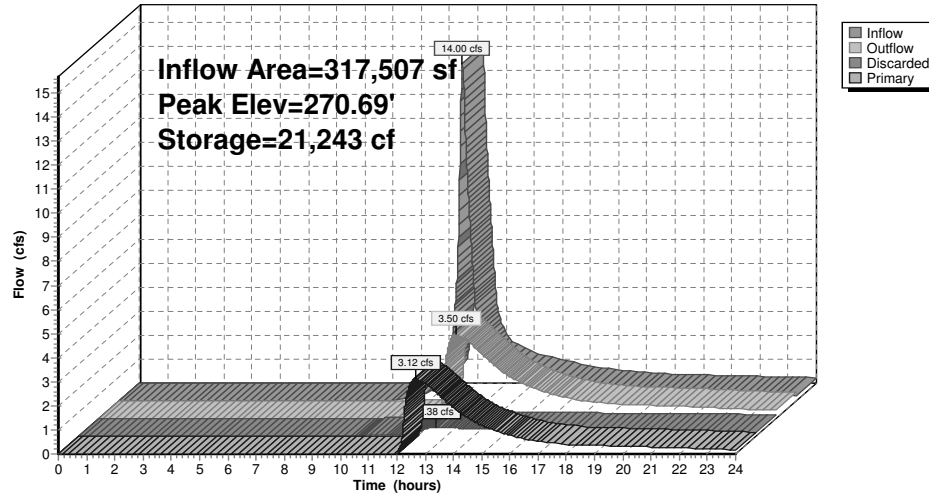

16181

Prepared by Microsoft

HydroCAD® 10.00-18 s/n 07559 © 2016 HydroCAD Software Solutions LLC

Type III 24-hr 10 Yr Rainfall=4.80"

Printed 5/14/2020

Page 50

Summary for Pond 6P: Det Pond #1

Volume	Invert	Avail. Storage	Storage Description		
#1	108.50'	18,111 cf	Custom Stage Data (Irregular) Listed below (Recalc)		
Elevation (feet)	Surf. Area (sq-ft)	Perim. (feet)	Inc. Store (cubic-feet)	Cum. Store (cubic-feet)	Wet. Area (sq-ft)
108.50	50	100.0	0	0	50
108.70	1,481	179.0	120	120	1,804
109.00	4,194	326.0	817	937	7,712
110.00	5,261	371.0	4,717	5,654	10,232
111.00	6,223	387.0	5,735	11,390	11,269
112.00	7,233	402.0	6,722	18,111	12,290

Device	Routing	Invert	Outlet Devices		
#1	Primary	108.50'	18.0" Round Culvert L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 108.50' / 108.00' S= 0.0250' /' Cc= 0.900 n= 0.013, Flow Area= 1.77 sf		
#2	Device 1	108.50'	2.0" Vert. Orifice/Grate C= 0.600		
#3	Device 1	111.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads		
#4	Device 1	110.00'	2.5' long Sharp-Crested Rectangular Weir 2 End Contraction(s) 1.0' Crest Height		

Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=0.00' (Free Discharge)

1=Culvert (Controls 0.00 cfs)

2=Orifice/Grate (Controls 0.00 cfs)

3=Orifice/Grate (Controls 0.00 cfs)

4=Sharp-Crested Rectangular Weir (Controls 0.00 cfs)

16181

Prepared by Microsoft

HydroCAD® 10.00-18 s/n 07559 © 2016 HydroCAD Software Solutions LLC


Type III 24-hr 10 Yr Rainfall=4.80"

Printed 5/14/2020

Page 51

Pond 6P: Det Pond #1

Hydrograph

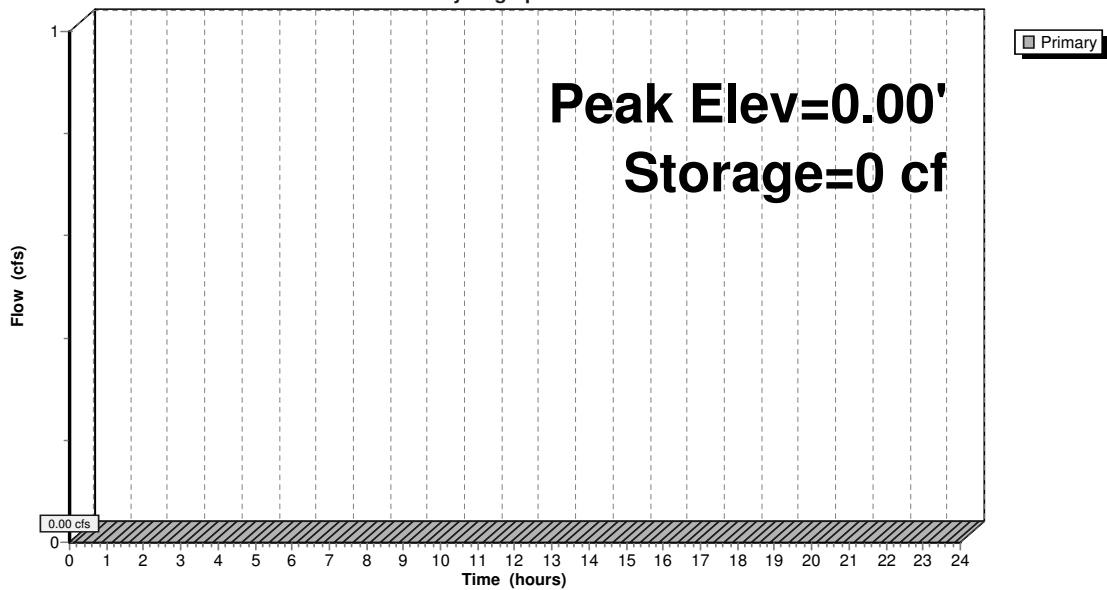

16181

Prepared by Microsoft

HydroCAD® 10.00-18 s/n 07559 © 2016 HydroCAD Software Solutions LLC

Type III 24-hr 10 Yr Rainfall=4.80"

Printed 5/14/2020

Page 52


Summary for Link DP1: PreDev

Inflow Area = 593,502 sf, 0.00% Impervious, Inflow Depth > 0.87" for 10 Yr event
Inflow = 6.76 cfs @ 12.46 hrs, Volume= 43,172 cf
Primary = 6.76 cfs @ 12.46 hrs, Volume= 43,172 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs

Link DP1: PreDev


Hydrograph

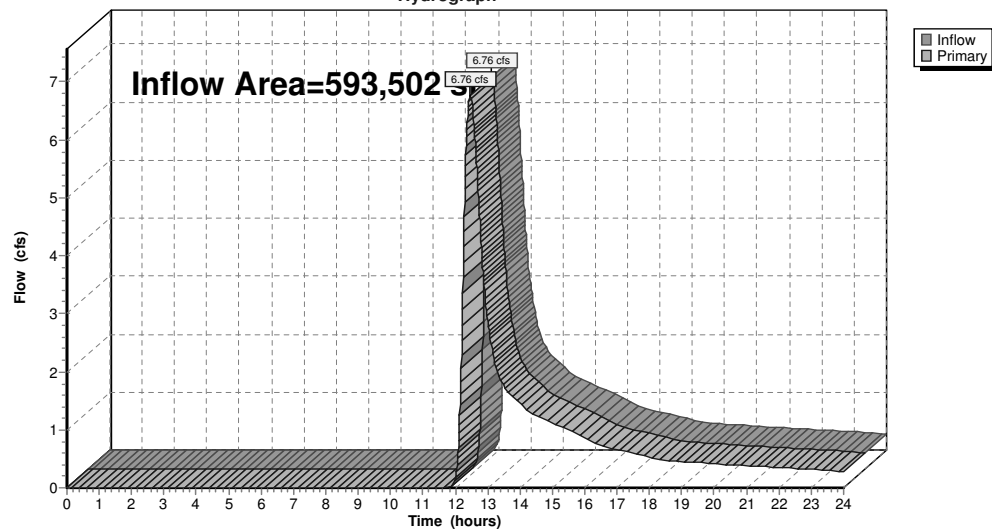

Summary for Link DP2: Post Offsite

Inflow Area = 601,961 sf, 16.65% Impervious, Inflow Depth > 1.18" for 10 Yr event
 Inflow = 6.62 cfs @ 12.50 hrs, Volume= 59,253 cf
 Primary = 6.62 cfs @ 12.50 hrs, Volume= 59,253 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs

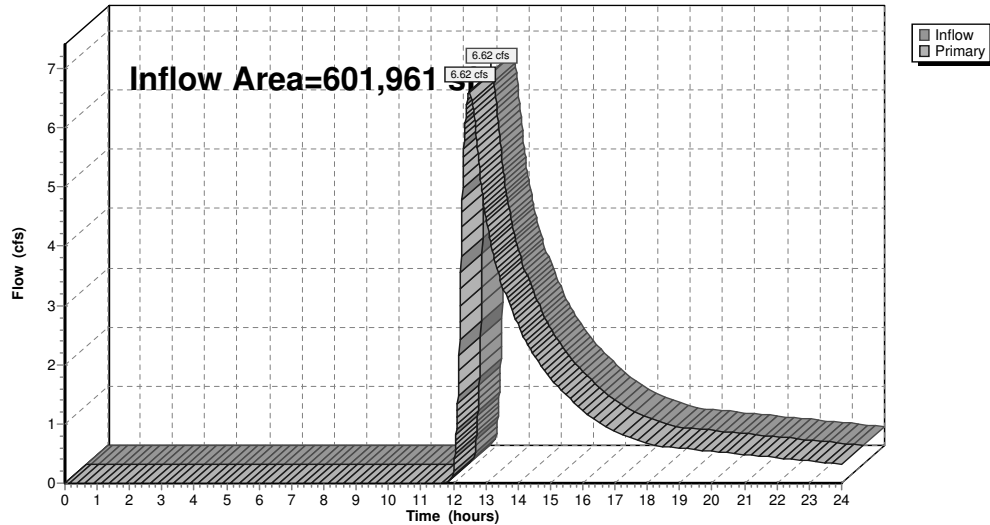Link DP2: Post Offsite**Hydrograph****Summary for Subcatchment E1: PreDev**

Runoff = 1.04 cfs @ 12.26 hrs, Volume= 5,407 cf, Depth> 1.02"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
 Type III 24-hr 25 Yr Rainfall=5.10"

Area (sf)	CN	Description
63,319	55	Woods, Good, HSG B
63,319		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.3	50	0.0200	0.07		Sheet Flow, A-B
					Woods: Light underbrush n= 0.400 P2= 3.20"
3.8	310	0.0750	1.37		Shallow Concentrated Flow, B-C
					Woodland Kv= 5.0 fps
16.1	360	Total			

Subcatchment E1: PreDev

Hydrograph

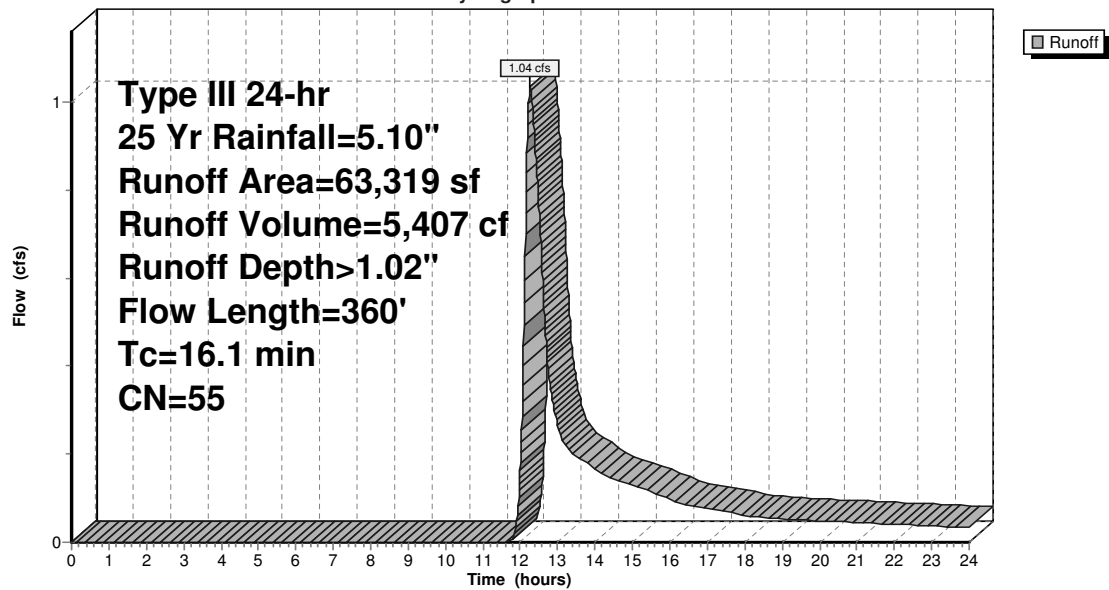

Summary for Subcatchment E2: PreDev

Runoff = 3.92 cfs @ 12.39 hrs, Volume= 23,275 cf, Depth> 1.02"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
 Type III 24-hr 25 Yr Rainfall=5.10"

Area (sf)	CN	Description
273,208	55	Woods, Good, HSG B
273,208		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.5	50	0.0300	0.08		Sheet Flow, A-B
					Woods: Light underbrush n= 0.400 P2= 3.20"
12.4	790	0.0450	1.06		Shallow Concentrated Flow, B-C
					Woodland Kv= 5.0 fps
22.9	840	Total			

Subcatchment E2: PreDev

Hydrograph

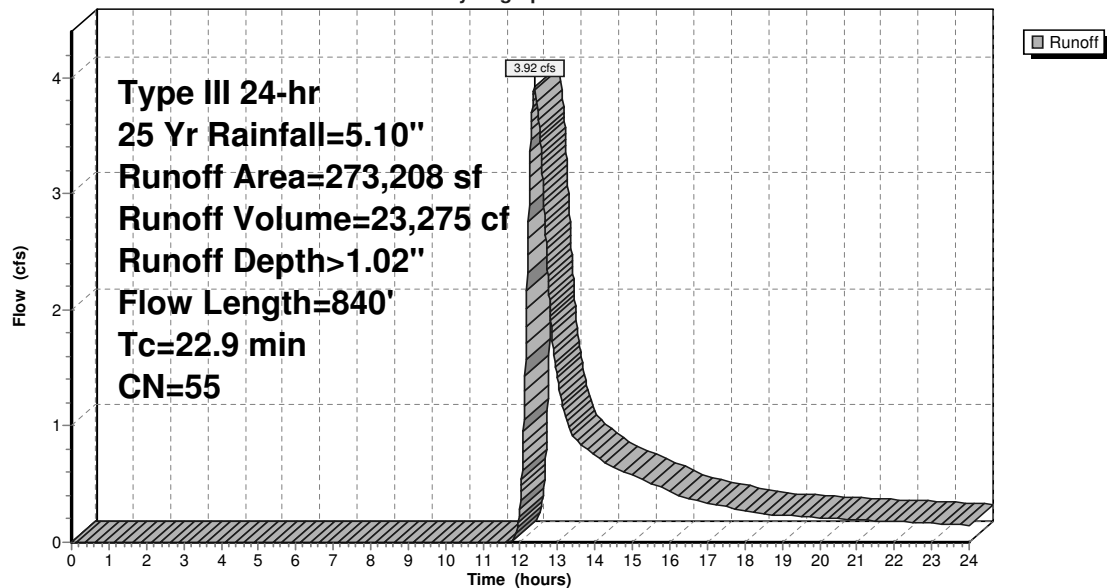

Summary for Subcatchment E3: PreDev

Runoff = 3.39 cfs @ 12.48 hrs, Volume= 21,851 cf, Depth> 1.02"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
Type III 24-hr 25 Yr Rainfall=5.10"

Area (sf)	CN	Description
256,975	55	Woods, Good, HSG B
256,975		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.9	50	0.0600	0.10		Sheet Flow, A-B
					Woods: Light underbrush n= 0.400 P2= 3.20"
5.3	450	0.0800	1.41		Shallow Concentrated Flow, B-C
					Woodland Kv= 5.0 fps
15.1	495	0.0120	0.55		Shallow Concentrated Flow, C-D
					Woodland Kv= 5.0 fps
28.3	995	Total			

Subcatchment E3: PreDev

Hydrograph

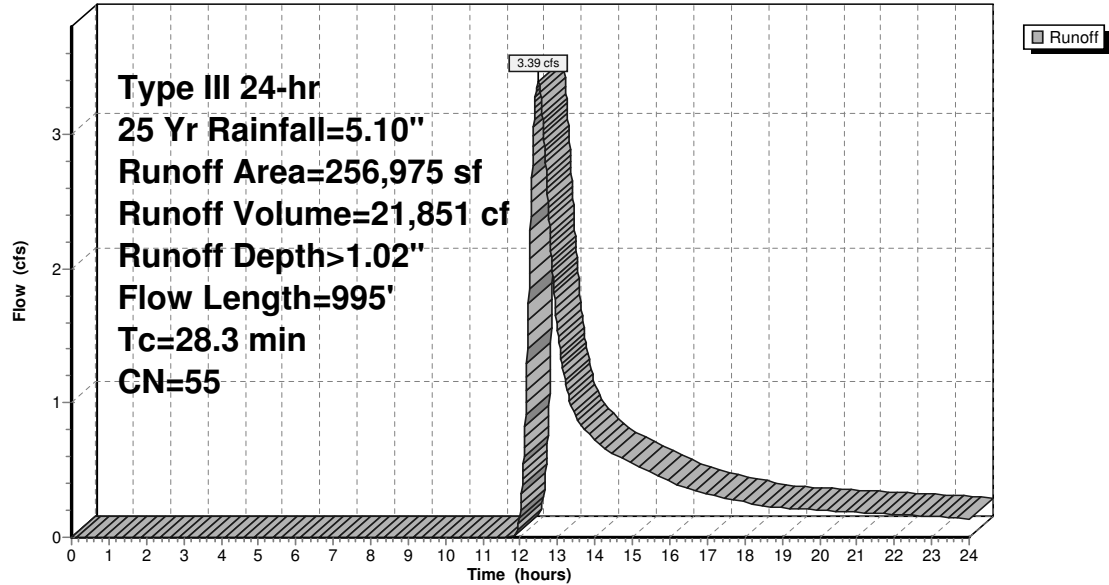

Summary for Subcatchment P1: Post Dev

Runoff = 1.11 cfs @ 12.18 hrs, Volume= 4,959 cf, Depth> 1.09"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
 Type III 24-hr 25 Yr Rainfall=5.10"

Area (sf)	CN	Description
848	98	Roofs, HSG B
4,300	61	>75% Grass cover, Good, HSG B
49,461	55	Woods, Good, HSG B
54,609	56	Weighted Average
53,761		98.45% Pervious Area
848		1.55% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.2	50	0.0200	0.10		Sheet Flow, A-B
					Grass: Dense n= 0.240 P2= 3.20"
0.2	60	0.0800	4.55		Shallow Concentrated Flow, B-C
					Unpaved Kv= 16.1 fps
2.9	235	0.0750	1.37		Shallow Concentrated Flow, C-D
					Woodland Kv= 5.0 fps
11.3	345				Total

Subcatchment P1: Post Dev

Hydrograph

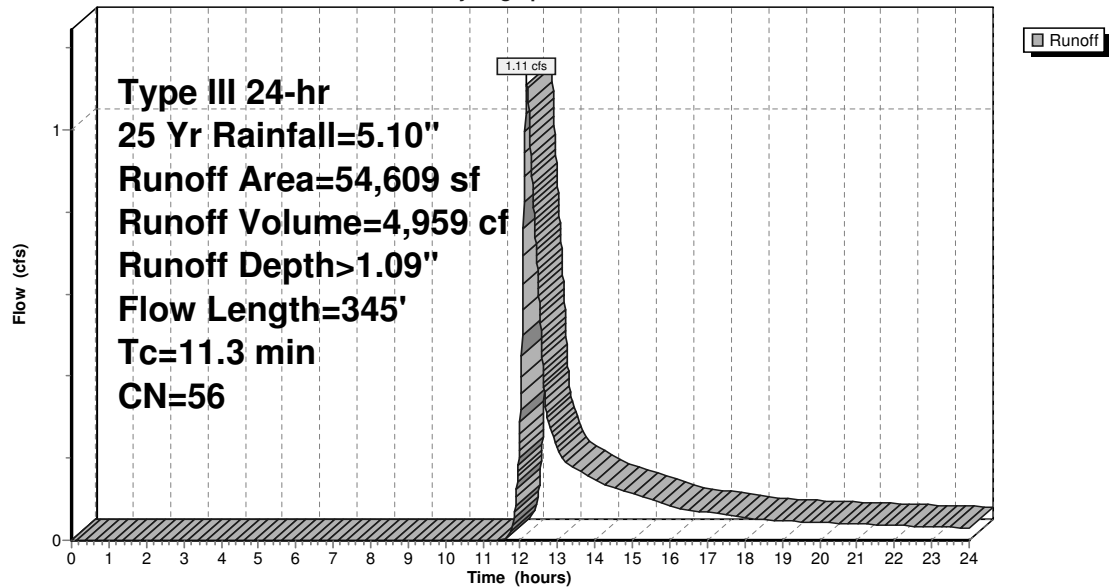

Summary for Subcatchment P2: Post Dev

Runoff = 15.65 cfs @ 12.18 hrs, Volume= 60,031 cf, Depth> 2.27"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
Type III 24-hr 25 Yr Rainfall=5.10"

Area (sf)	CN	Description
* 28,527	98	Paved Road, HSG B
* 7,666	98	Paved Sidewalk, HSG B
* 27,215	98	Paved Drives, HSG B
30,966	98	Roofs, HSG B
223,133	61	>75% Grass cover, Good, HSG B
317,507	72	Weighted Average
223,133		70.28% Pervious Area
94,374		29.72% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.8	50	0.0100	0.08		Sheet Flow, A-B Grass: Dense n= 0.240 P2= 3.20"
0.4	80	0.0500	3.60		Shallow Concentrated Flow, B-C Unpaved Kv= 16.1 fps
0.7	220	0.0700	5.37		Shallow Concentrated Flow, C-D Paved Kv= 20.3 fps
0.4	310	0.0800	12.83	10.08	Pipe Channel, C-D 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.013
12.3	660	Total			

Subcatchment P2: Post Dev

Hydrograph

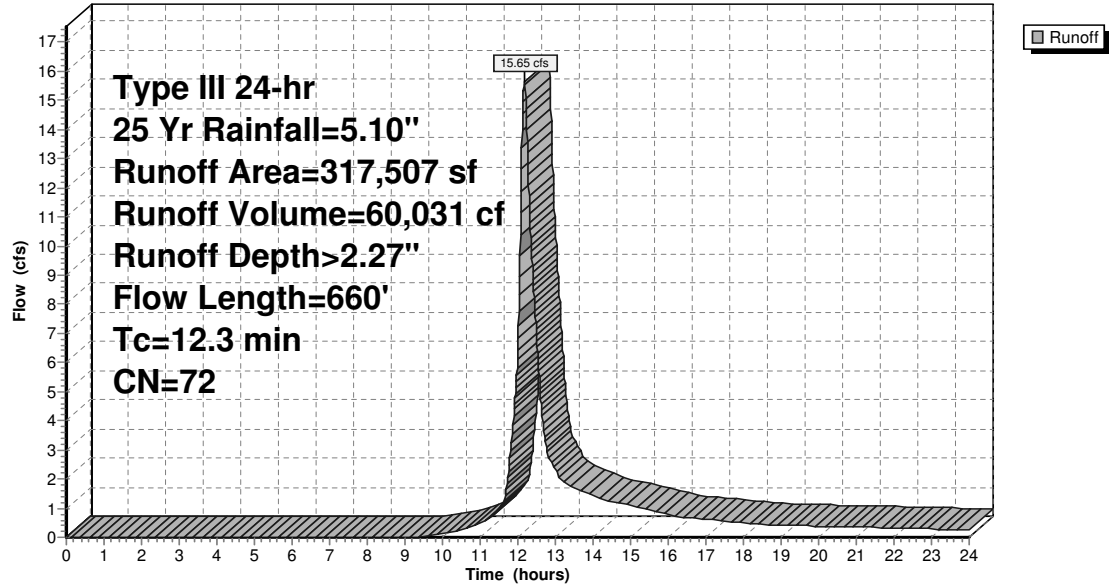

Summary for Subcatchment P3: Roof Front

Runoff = 3.55 cfs @ 12.47 hrs, Volume= 21,981 cf, Depth> 1.15"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
Type III 24-hr 25 Yr Rainfall=5.10"

Area (sf)	CN	Description
4,976	98	Roofs, HSG B
54,253	61	>75% Grass cover, Good, HSG B
170,616	55	Woods, Good, HSG B
229,845	57	Weighted Average
224,869		97.84% Pervious Area
4,976		2.16% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.2	50	0.0200	0.10		Sheet Flow, A-B Grass: Dense n= 0.240 P2= 3.20"
5.4	460	0.0800	1.41		Shallow Concentrated Flow, B-C Woodland Kv= 5.0 fps
15.1	495	0.0120	0.55		Shallow Concentrated Flow, C-D Woodland Kv= 5.0 fps
28.7	1,005	Total			

Subcatchment P3: Roof Front

Hydrograph

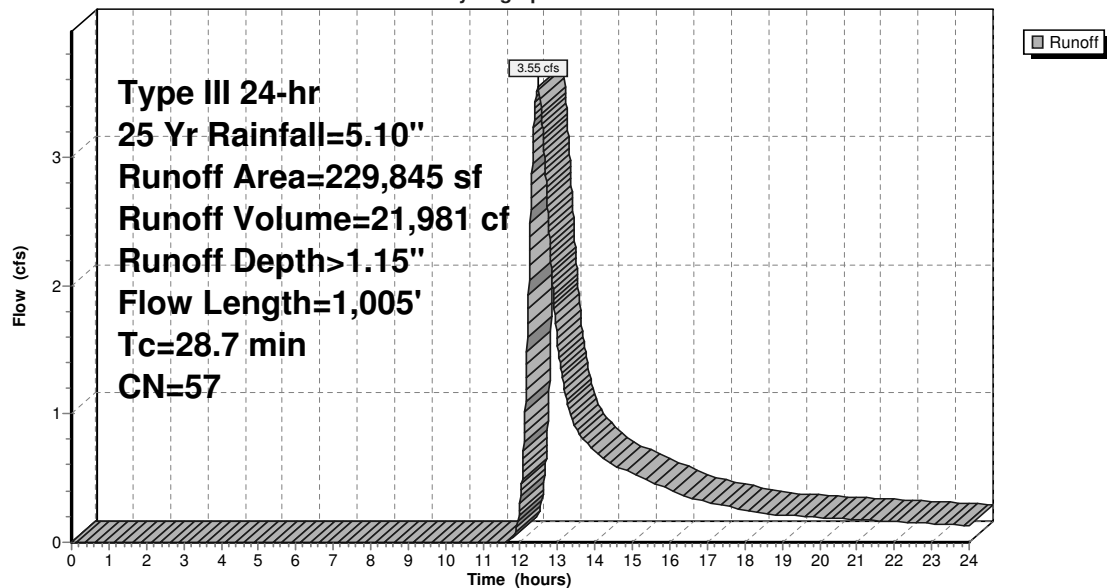

Summary for Reach 1R: Stream

Inflow Area = 63,319 sf, 0.00% Impervious, Inflow Depth > 1.02" for 25 Yr event
 Inflow = 1.04 cfs @ 12.26 hrs, Volume= 5,407 cf
 Outflow = 1.03 cfs @ 12.31 hrs, Volume= 5,395 cf, Atten= 1%, Lag= 3.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs

Max. Velocity= 3.20 fps, Min. Travel Time= 1.6 min

Avg. Velocity = 1.53 fps, Avg. Travel Time= 3.3 min

Peak Storage= 96 cf @ 12.29 hrs

Average Depth at Peak Storage= 0.27'

Bank-Full Depth= 1.00' Flow Area= 2.3 sf, Capacity= 16.68 cfs

3.50' x 1.00' deep Parabolic Channel, n= 0.040 Winding stream, pools & shoals


Length= 300.0' Slope= 0.0800 '/'

Inlet Invert= 298.00', Outlet Invert= 274.00'



Reach 1R: Stream

Hydrograph

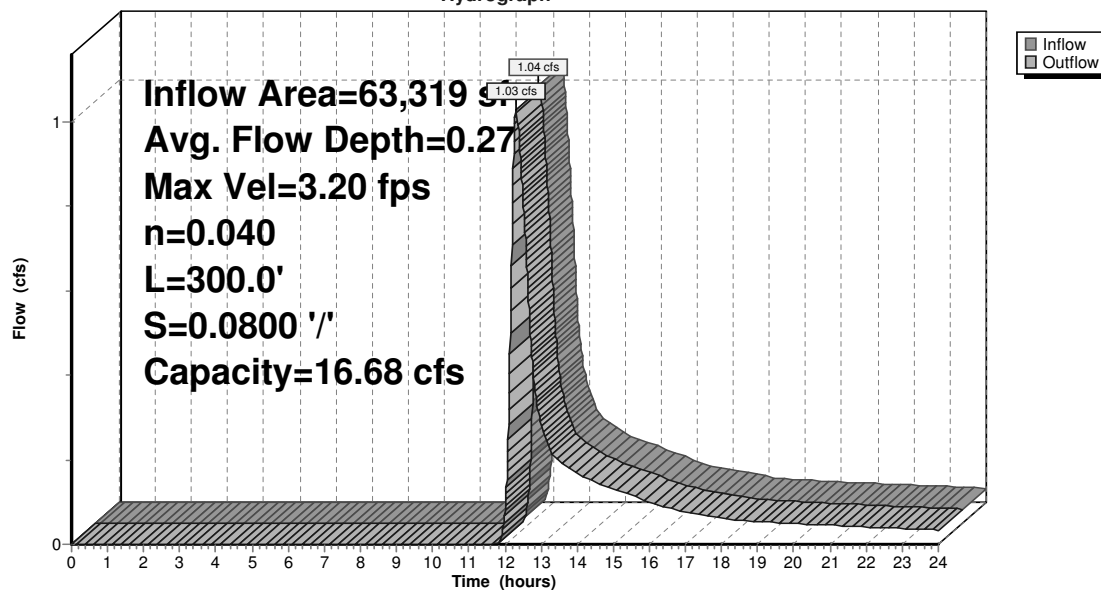

Summary for Reach 2R: Stream

Inflow Area = 336,527 sf, 0.00% Impervious, Inflow Depth > 1.02" for 25 Yr event
 Inflow = 4.90 cfs @ 12.37 hrs, Volume= 28,670 cf
 Outflow = 4.88 cfs @ 12.42 hrs, Volume= 28,590 cf, Atten= 0%, Lag= 3.2 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs

Max. Velocity= 3.79 fps, Min. Travel Time= 1.8 min

Avg. Velocity = 1.72 fps, Avg. Travel Time= 4.0 min

Peak Storage= 528 cf @ 12.39 hrs

Average Depth at Peak Storage= 0.39'

Bank-Full Depth= 2.00' Flow Area= 13.0 sf, Capacity= 118.99 cfs

2.50' x 2.00' deep channel, n= 0.040 Winding stream, pools & shoals

Side Slope Z-value= 2.0 '/' Top Width= 10.50'


Length= 410.0' Slope= 0.0512 '/'

Inlet Invert= 274.00', Outlet Invert= 253.00'



Reach 2R: Stream

Hydrograph

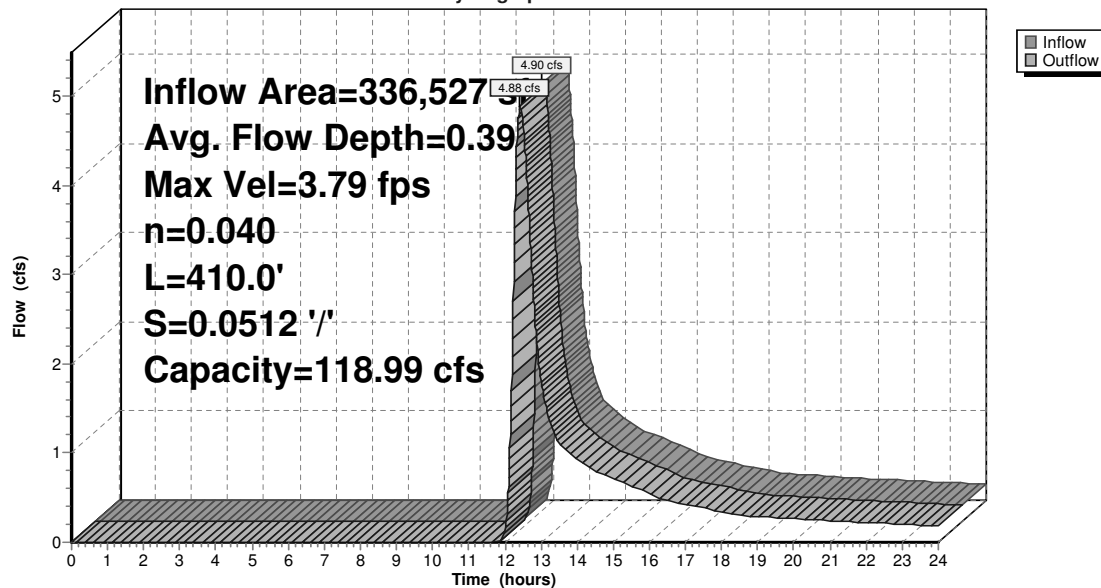

Summary for Reach 3R: Stream

Inflow Area = 54,609 sf, 1.55% Impervious, Inflow Depth > 1.09" for 25 Yr event
 Inflow = 1.11 cfs @ 12.18 hrs, Volume= 4,959 cf
 Outflow = 1.10 cfs @ 12.23 hrs, Volume= 4,948 cf, Atten= 1%, Lag= 2.7 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs

Max. Velocity= 3.27 fps, Min. Travel Time= 1.5 min

Avg. Velocity = 1.48 fps, Avg. Travel Time= 3.4 min

Peak Storage= 101 cf @ 12.20 hrs

Average Depth at Peak Storage= 0.27'

Bank-Full Depth= 1.00' Flow Area= 2.3 sf, Capacity= 16.68 cfs

3.50' x 1.00' deep Parabolic Channel, n= 0.040 Winding stream, pools & shoals


Length= 300.0' Slope= 0.0800 '/'

Inlet Invert= 298.00', Outlet Invert= 274.00'



Reach 3R: Stream

Hydrograph

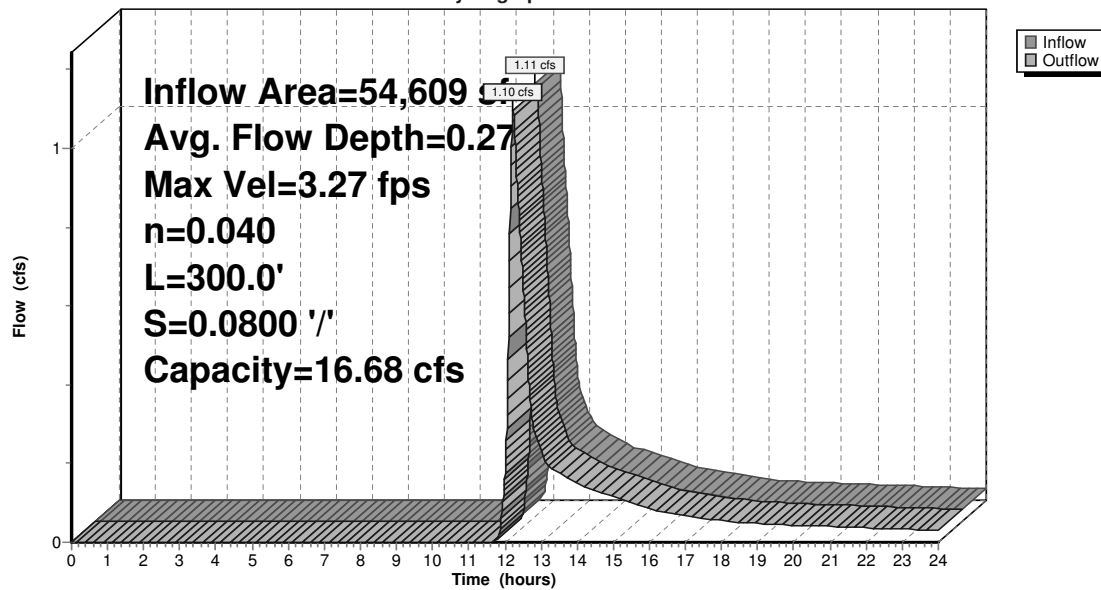

Summary for Reach 4R: Stream

Inflow Area = 54,609 sf, 1.55% Impervious, Inflow Depth > 1.09" for 25 Yr event
 Inflow = 1.10 cfs @ 12.23 hrs, Volume= 4,948 cf
 Outflow = 1.05 cfs @ 12.32 hrs, Volume= 4,922 cf, Atten= 4%, Lag= 5.3 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs

Max. Velocity= 2.29 fps, Min. Travel Time= 3.0 min

Avg. Velocity = 0.91 fps, Avg. Travel Time= 7.5 min

Peak Storage= 188 cf @ 12.27 hrs

Average Depth at Peak Storage= 0.16'

Bank-Full Depth= 2.00' Flow Area= 13.0 sf, Capacity= 118.99 cfs

2.50' x 2.00' deep channel, n= 0.040 Winding stream, pools & shoals

Side Slope Z-value= 2.0 '/' Top Width= 10.50'


Length= 410.0' Slope= 0.0512 '/'

Inlet Invert= 274.00', Outlet Invert= 253.00'



Reach 4R: Stream

Hydrograph

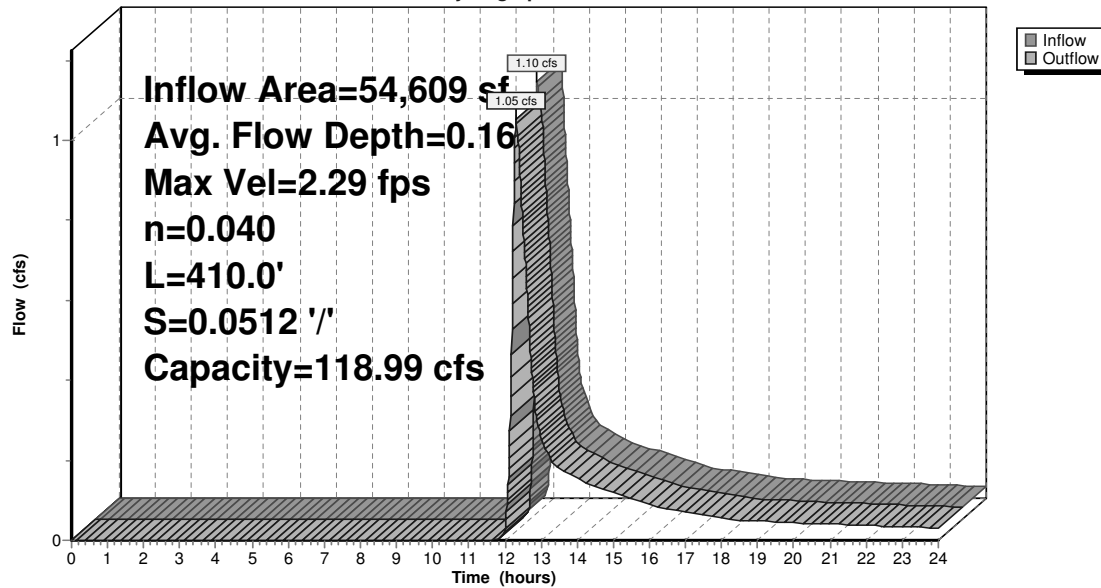

Summary for Pond 1P: Det Basin

Inflow Area = 317,507 sf, 29.72% Impervious, Inflow Depth > 2.27" for 25 Yr event
 Inflow = 15.65 cfs @ 12.18 hrs, Volume= 60,031 cf
 Outflow = 3.90 cfs @ 12.66 hrs, Volume= 52,863 cf, Atten= 75%, Lag= 29.3 min
 Discarded = 0.40 cfs @ 12.66 hrs, Volume= 11,485 cf
 Primary = 3.50 cfs @ 12.66 hrs, Volume= 41,378 cf

Routing by Stor-Ind method, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
 Peak Elev= 270.97' @ 12.66 hrs Surf.Area= 9,188 sf Storage= 23,740 cf

Plug-Flow detention time= 141.7 min calculated for 52,863 cf (88% of inflow)
 Center-of-Mass det. time= 86.6 min (932.3 - 845.7)

Volume	Invert	Avail.Storage	Storage Description		
#1	266.00'	46,058 cf	Custom Stage Data (Irregular) Listed below (Recalc)		
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
266.00	1,320	147.0	0	0	1,320
268.00	3,623	243.0	4,753	4,753	4,325
270.00	7,534	370.0	10,921	15,674	10,550
272.00	11,140	448.0	18,557	34,231	15,693
273.00	12,527	468.0	11,827	46,058	17,221

Device	Routing	Invert	Outlet Devices	
#1	Discarded	266.00'	1.020 in/hr Exfiltration over Surface area Conductivity to Groundwater Elevation = 264.00'	
#2	Primary	265.00'	24.0" Round Culvert L= 45.0' RCP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 265.00' / 259.00' S= 0.1333 '/ Cc= 0.900 n= 0.013, Flow Area= 3.14 sf	
#3	Device 2	268.20'	4.0" Vert. Orifice/Grate C= 0.600	
#4	Device 2	269.20'	0.7' long Sharp-Crested Rectangular Weir 2 End Contraction(s) 4.5' Crest Height	
#5	Device 2	272.30'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads	

16181

Prepared by Microsoft

HydroCAD® 10.00-18 s/n 07559 © 2016 HydroCAD Software Solutions LLC

Type III 24-hr 25 Yr Rainfall=5.10"

Printed 5/14/2020

Page 75

Discarded OutFlow Max=0.40 cfs @ 12.66 hrs HW=270.97' (Free Discharge)

1=Exfiltration (Controls 0.40 cfs)


Primary OutFlow Max=3.49 cfs @ 12.66 hrs HW=270.97' (Free Discharge)

2=Culvert (Passes 3.49 cfs of 33.71 cfs potential flow)

3=Orifice/Grate (Orifice Controls 0.68 cfs @ 7.76 fps)

4=Sharp-Crested Rectangular Weir (Weir Controls 2.82 cfs @ 4.55 fps)

5=Orifice/Grate (Controls 0.00 cfs)

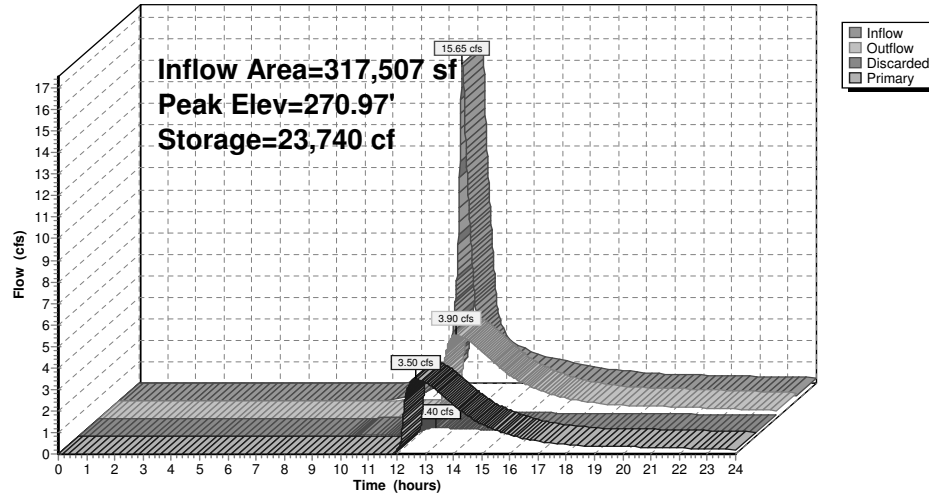Pond 1P: Det Basin**Hydrograph**

16181

Prepared by Microsoft

HydroCAD® 10.00-18 s/n 07559 © 2016 HydroCAD Software Solutions LLC

Type III 24-hr 25 Yr Rainfall=5.10"

Printed 5/14/2020

Page 76

Summary for Pond 6P: Det Pond #1

Volume	Invert	Avail. Storage	Storage Description			
#1	108.50'	18,111 cf	Custom Stage Data (Irregular) Listed below (Recalc)			
Elevation (feet)	Surf. Area (sq-ft)	Perim. (feet)	Inc. Store (cubic-feet)	Cum. Store (cubic-feet)	Wet. Area (sq-ft)	
108.50	50	100.0	0	0	50	
108.70	1,481	179.0	120	120	1,804	
109.00	4,194	326.0	817	937	7,712	
110.00	5,261	371.0	4,717	5,654	10,232	
111.00	6,223	387.0	5,735	11,390	11,269	
112.00	7,233	402.0	6,722	18,111	12,290	

Device	Routing	Invert	Outlet Devices			
#1	Primary	108.50'	18.0" Round Culvert L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 108.50' / 108.00' S= 0.0250' / Cc= 0.900 n= 0.013, Flow Area= 1.77 sf			
#2	Device 1	108.50'	2.0" Vert. Orifice/Grate C= 0.600			
#3	Device 1	111.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads			
#4	Device 1	110.00'	2.5' long Sharp-Crested Rectangular Weir 2 End Contraction(s) 1.0' Crest Height			

Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=0.00' (Free Discharge)

1=Culvert (Controls 0.00 cfs)

2=Orifice/Grate (Controls 0.00 cfs)

3=Orifice/Grate (Controls 0.00 cfs)

4=Sharp-Crested Rectangular Weir (Controls 0.00 cfs)

16181

Prepared by Microsoft

HydroCAD® 10.00-18 s/n 07559 © 2016 HydroCAD Software Solutions LLC


Type III 24-hr 25 Yr Rainfall=5.10"

Printed 5/14/2020

Page 77

Pond 6P: Det Pond #1

Hydrograph

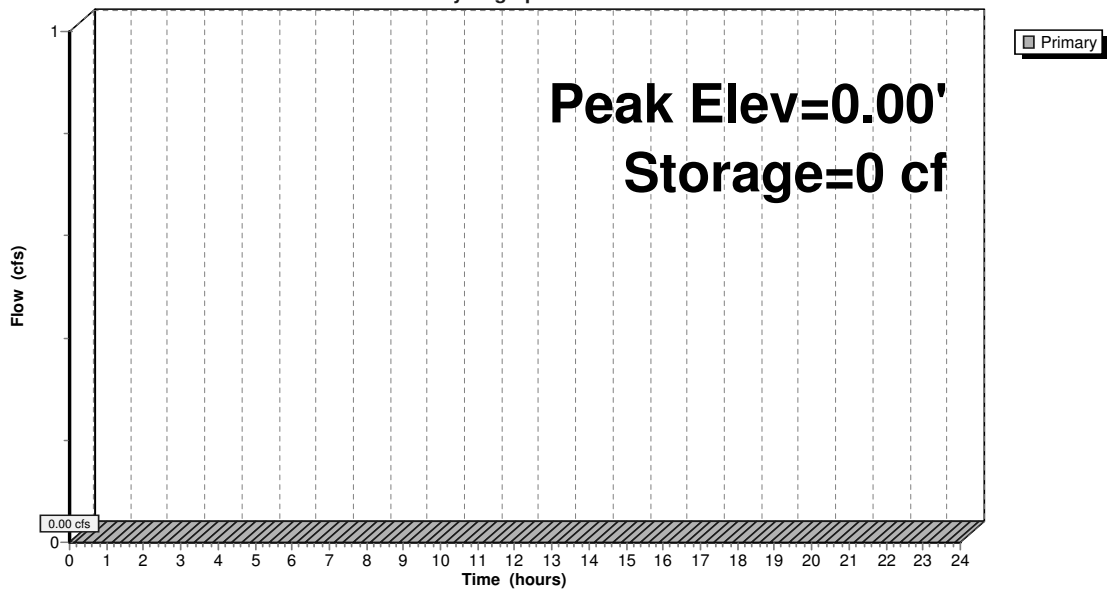

16181

Prepared by Microsoft

HydroCAD® 10.00-18 s/n 07559 © 2016 HydroCAD Software Solutions LLC

Type III 24-hr 25 Yr Rainfall=5.10"

Printed 5/14/2020

Page 78


Summary for Link DP1: PreDev

Inflow Area = 593,502 sf, 0.00% Impervious, Inflow Depth > 1.02" for 25 Yr event
Inflow = 8.23 cfs @ 12.44 hrs, Volume= 50,440 cf
Primary = 8.23 cfs @ 12.44 hrs, Volume= 50,440 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs

Link DP1: PreDev


Hydrograph

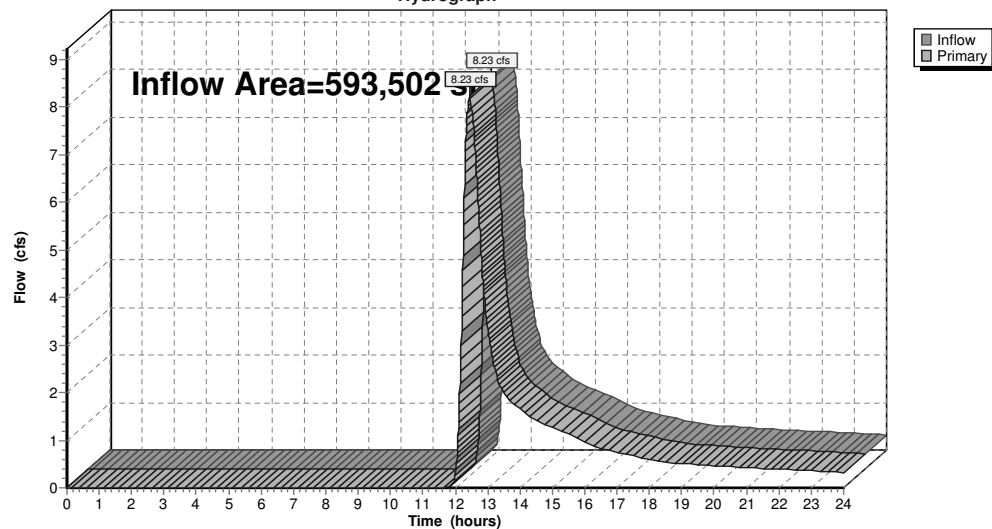

Summary for Link DP2: Post Offsite

Inflow Area = 601,961 sf, 16.65% Impervious, Inflow Depth > 1.36" for 25 Yr event
 Inflow = 7.70 cfs @ 12.47 hrs, Volume= 68,281 cf
 Primary = 7.70 cfs @ 12.47 hrs, Volume= 68,281 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs

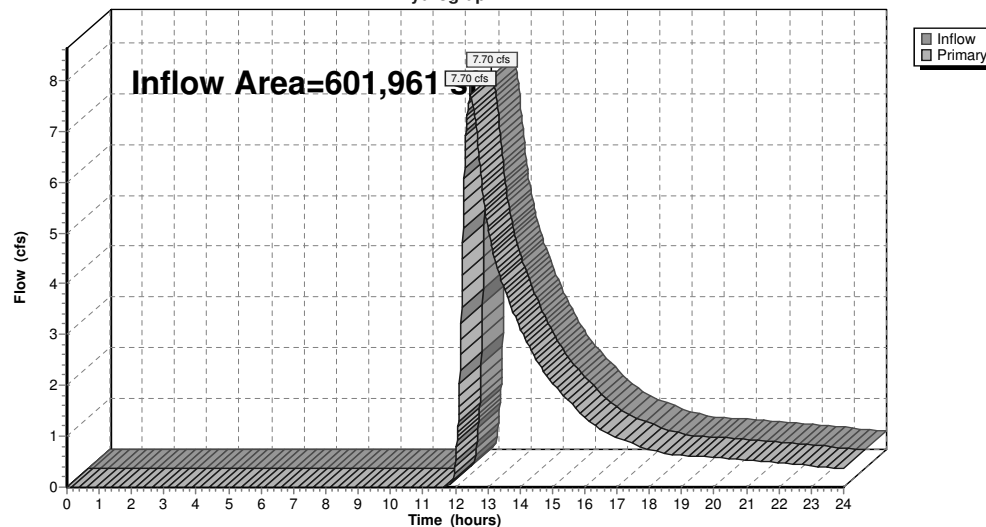Link DP2: Post Offsite**Hydrograph****Summary for Subcatchment E1: PreDev**

Runoff = 2.46 cfs @ 12.24 hrs, Volume= 11,157 cf, Depth> 2.11"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
 Type III 24-hr 100 Yr Rainfall=7.00"

Area (sf)	CN	Description
63,319	55	Woods, Good, HSG B
63,319		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.3	50	0.0200	0.07		Sheet Flow, A-B
					Woods: Light underbrush n= 0.400 P2= 3.20"
3.8	310	0.0750	1.37		Shallow Concentrated Flow, B-C
					Woodland Kv= 5.0 fps
16.1	360	Total			

Subcatchment E1: PreDev

Hydrograph

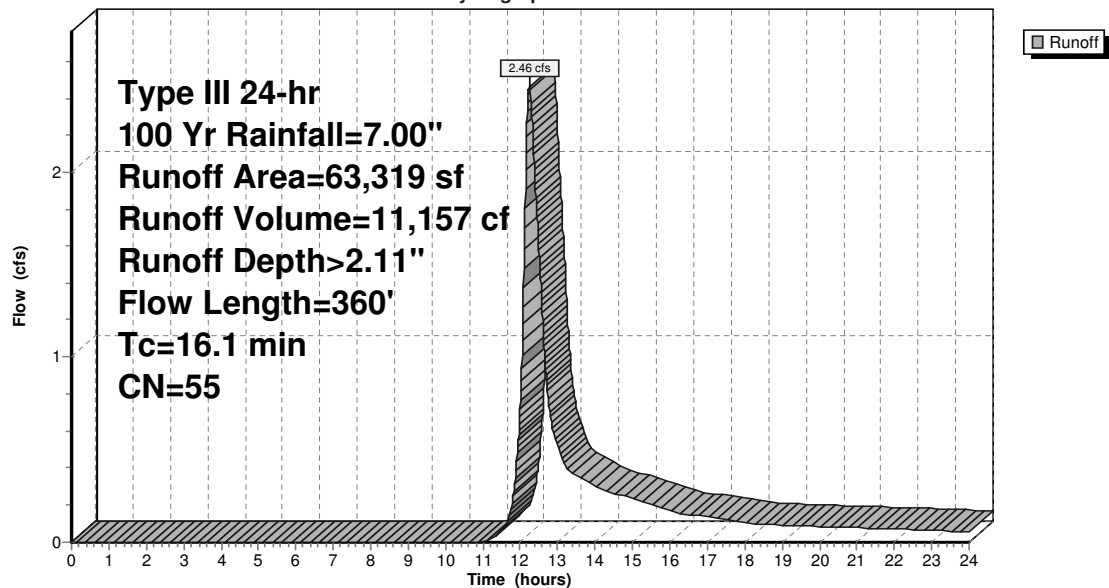

Summary for Subcatchment E2: PreDev

Runoff = 9.24 cfs @ 12.34 hrs, Volume= 48,046 cf, Depth> 2.11"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
Type III 24-hr 100 Yr Rainfall=7.00"

Area (sf)	CN	Description
273,208	55	Woods, Good, HSG B
273,208		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.5	50	0.0300	0.08		Sheet Flow, A-B
					Woods: Light underbrush n= 0.400 P2= 3.20"
12.4	790	0.0450	1.06		Shallow Concentrated Flow, B-C
					Woodland Kv= 5.0 fps
22.9	840	Total			

Subcatchment E2: PreDev

Hydrograph

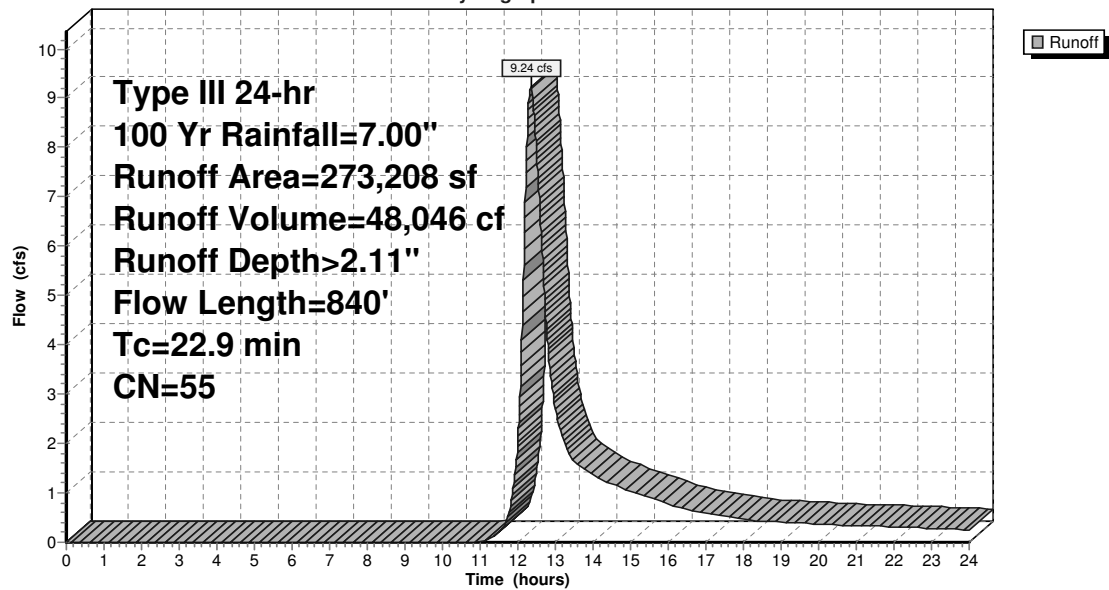

Summary for Subcatchment E3: PreDev

Runoff = 7.94 cfs @ 12.42 hrs, Volume= 45,120 cf, Depth> 2.11"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
 Type III 24-hr 100 Yr Rainfall=7.00"

Area (sf)	CN	Description
256,975	55	Woods, Good, HSG B
256,975		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.9	50	0.0600	0.10		Sheet Flow, A-B Woods: Light underbrush n= 0.400 P2= 3.20"
5.3	450	0.0800	1.41		Shallow Concentrated Flow, B-C Woodland Kv= 5.0 fps
15.1	495	0.0120	0.55		Shallow Concentrated Flow, C-D Woodland Kv= 5.0 fps
28.3	995	Total			

Subcatchment E3: PreDev

Hydrograph

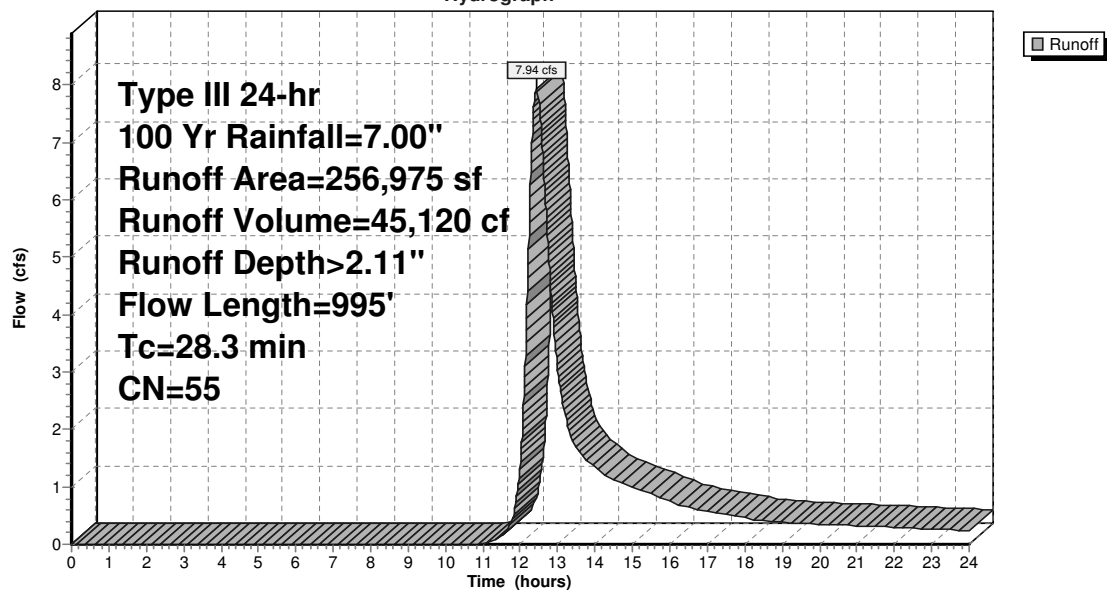

Summary for Subcatchment P1: Post Dev

Runoff = 2.56 cfs @ 12.17 hrs, Volume= 10,064 cf, Depth> 2.21"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
 Type III 24-hr 100 Yr Rainfall=7.00"

Area (sf)	CN	Description
848	98	Roofs, HSG B
4,300	61	>75% Grass cover, Good, HSG B
49,461	55	Woods, Good, HSG B
54,609	56	Weighted Average
53,761		98.45% Pervious Area
848		1.55% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.2	50	0.0200	0.10		Sheet Flow, A-B Grass: Dense n= 0.240 P2= 3.20"
0.2	60	0.0800	4.55		Shallow Concentrated Flow, B-C Unpaved Kv= 16.1 fps
2.9	235	0.0750	1.37		Shallow Concentrated Flow, C-D Woodland Kv= 5.0 fps
11.3	345	Total			

Subcatchment P1: Post Dev

Hydrograph

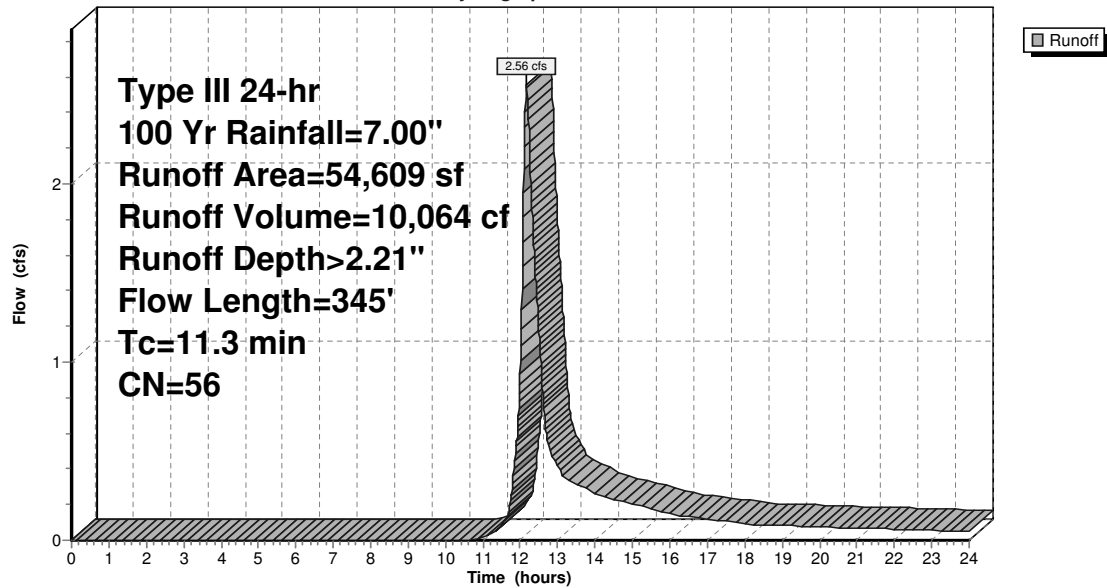

Summary for Subcatchment P2: Post Dev

Runoff = 26.64 cfs @ 12.17 hrs, Volume= 101,061 cf, Depth> 3.82"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
 Type III 24-hr 100 Yr Rainfall=7.00"

Area (sf)	CN	Description
* 28,527	98	Paved Road, HSG B
* 7,666	98	Paved Sidewalk, HSG B
* 27,215	98	Paved Drives, HSG B
30,966	98	Roofs, HSG B
223,133	61	>75% Grass cover, Good, HSG B
317,507	72	Weighted Average
223,133		70.28% Pervious Area
94,374		29.72% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.8	50	0.0100	0.08		Sheet Flow, A-B Grass: Dense n= 0.240 P2= 3.20"
0.4	80	0.0500	3.60		Shallow Concentrated Flow, B-C Unpaved Kv= 16.1 fps
0.7	220	0.0700	5.37		Shallow Concentrated Flow, C-D Paved Kv= 20.3 fps
0.4	310	0.0800	12.83	10.08	Pipe Channel, C-D 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.013
12.3	660	Total			

Subcatchment P2: Post Dev

Hydrograph

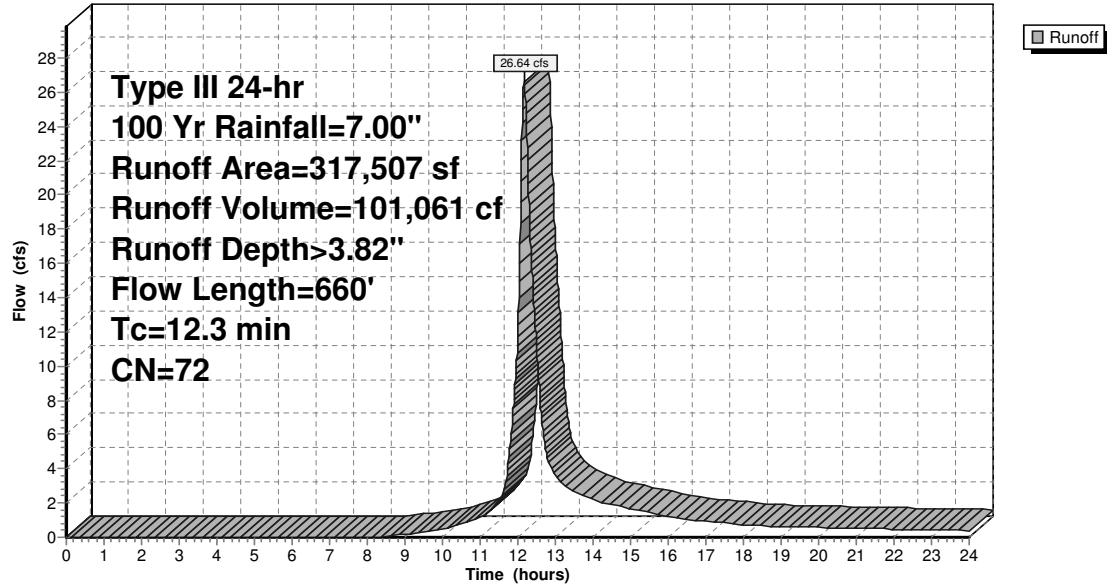

Summary for Subcatchment P3: Roof Front

Runoff = 7.82 cfs @ 12.43 hrs, Volume= 43,964 cf, Depth> 2.30"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
 Type III 24-hr 100 Yr Rainfall=7.00"

Area (sf)	CN	Description
4,976	98	Roofs, HSG B
54,253	61	>75% Grass cover, Good, HSG B
170,616	55	Woods, Good, HSG B
229,845	57	Weighted Average
224,869		97.84% Pervious Area
4,976		2.16% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.2	50	0.0200	0.10		Sheet Flow, A-B
					Grass: Dense n= 0.240 P2= 3.20"
5.4	460	0.0800	1.41		Shallow Concentrated Flow, B-C
					Woodland Kv= 5.0 fps
15.1	495	0.0120	0.55		Shallow Concentrated Flow, C-D
					Woodland Kv= 5.0 fps
28.7	1,005	Total			

Subcatchment P3: Roof Front

Hydrograph

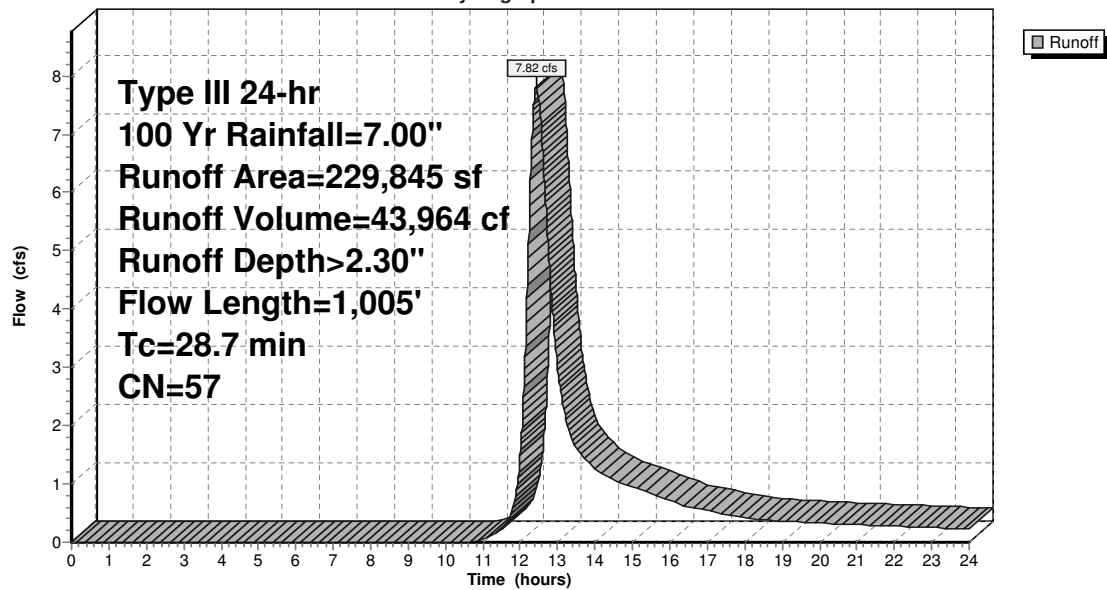

Summary for Reach 1R: Stream

Inflow Area = 63,319 sf, 0.00% Impervious, Inflow Depth > 2.11" for 100 Yr event
 Inflow = 2.46 cfs @ 12.24 hrs, Volume= 11,157 cf
 Outflow = 2.46 cfs @ 12.28 hrs, Volume= 11,140 cf, Atten= 0%, Lag= 2.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs

Max. Velocity= 4.14 fps, Min. Travel Time= 1.2 min

Avg. Velocity = 1.81 fps, Avg. Travel Time= 2.8 min

Peak Storage= 178 cf @ 12.26 hrs

Average Depth at Peak Storage= 0.40'

Bank-Full Depth= 1.00' Flow Area= 2.3 sf, Capacity= 16.68 cfs

3.50' x 1.00' deep Parabolic Channel, n= 0.040 Winding stream, pools & shoals


Length= 300.0' Slope= 0.0800 '/'

Inlet Invert= 298.00', Outlet Invert= 274.00'



Reach 1R: Stream

Hydrograph

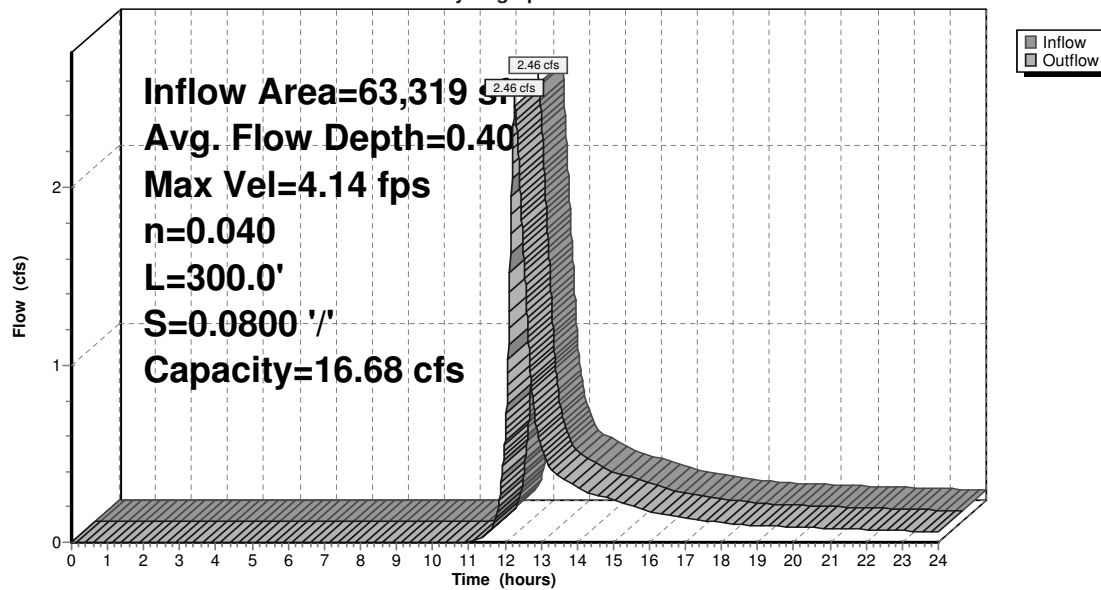

Summary for Reach 2R: Stream

Inflow Area = 336,527 sf, 0.00% Impervious, Inflow Depth > 2.11" for 100 Yr event
 Inflow = 11.55 cfs @ 12.34 hrs, Volume= 59,186 cf
 Outflow = 11.51 cfs @ 12.37 hrs, Volume= 59,074 cf, Atten= 0%, Lag= 2.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs

Max. Velocity= 4.89 fps, Min. Travel Time= 1.4 min

Avg. Velocity = 2.09 fps, Avg. Travel Time= 3.3 min

Peak Storage= 965 cf @ 12.35 hrs

Average Depth at Peak Storage= 0.63'

Bank-Full Depth= 2.00' Flow Area= 13.0 sf, Capacity= 118.99 cfs

2.50' x 2.00' deep channel, n= 0.040 Winding stream, pools & shoals

Side Slope Z-value= 2.0 '/' Top Width= 10.50'


Length= 410.0' Slope= 0.0512 '/'

Inlet Invert= 274.00', Outlet Invert= 253.00'



Reach 2R: Stream

Hydrograph

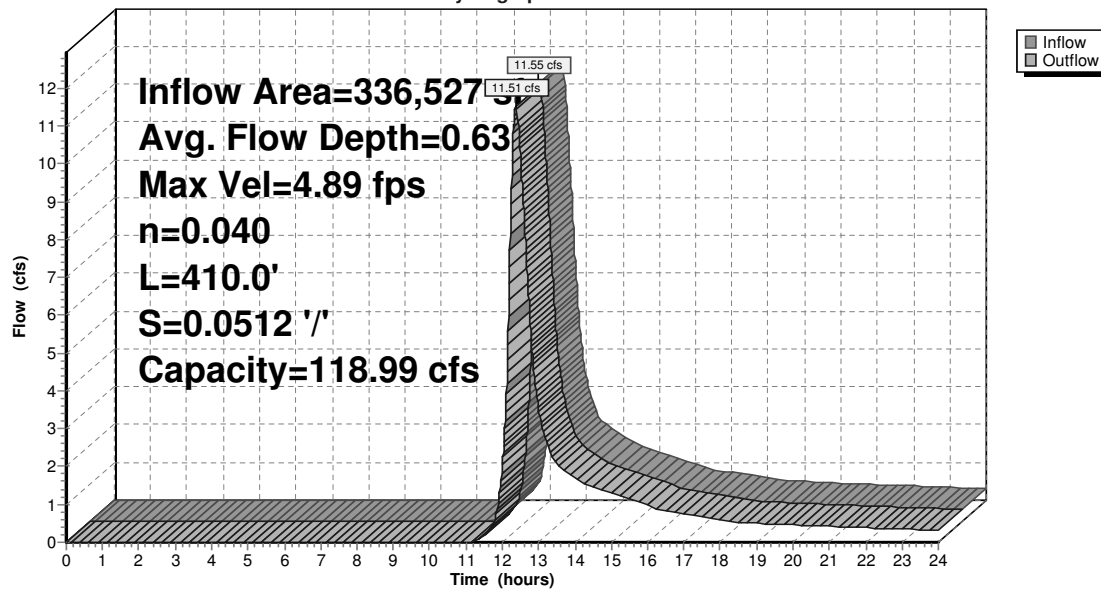

Summary for Reach 3R: Stream

Inflow Area = 54,609 sf, 1.55% Impervious, Inflow Depth > 2.21" for 100 Yr event
 Inflow = 2.56 cfs @ 12.17 hrs, Volume= 10,064 cf
 Outflow = 2.54 cfs @ 12.20 hrs, Volume= 10,049 cf, Atten= 1%, Lag= 2.1 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs

Max. Velocity= 4.18 fps, Min. Travel Time= 1.2 min

Avg. Velocity = 1.74 fps, Avg. Travel Time= 2.9 min

Peak Storage= 182 cf @ 12.18 hrs

Average Depth at Peak Storage= 0.41'

Bank-Full Depth= 1.00' Flow Area= 2.3 sf, Capacity= 16.68 cfs

3.50' x 1.00' deep Parabolic Channel, n= 0.040 Winding stream, pools & shoals


Length= 300.0' Slope= 0.0800 '/'

Inlet Invert= 298.00', Outlet Invert= 274.00'



Reach 3R: Stream

Hydrograph

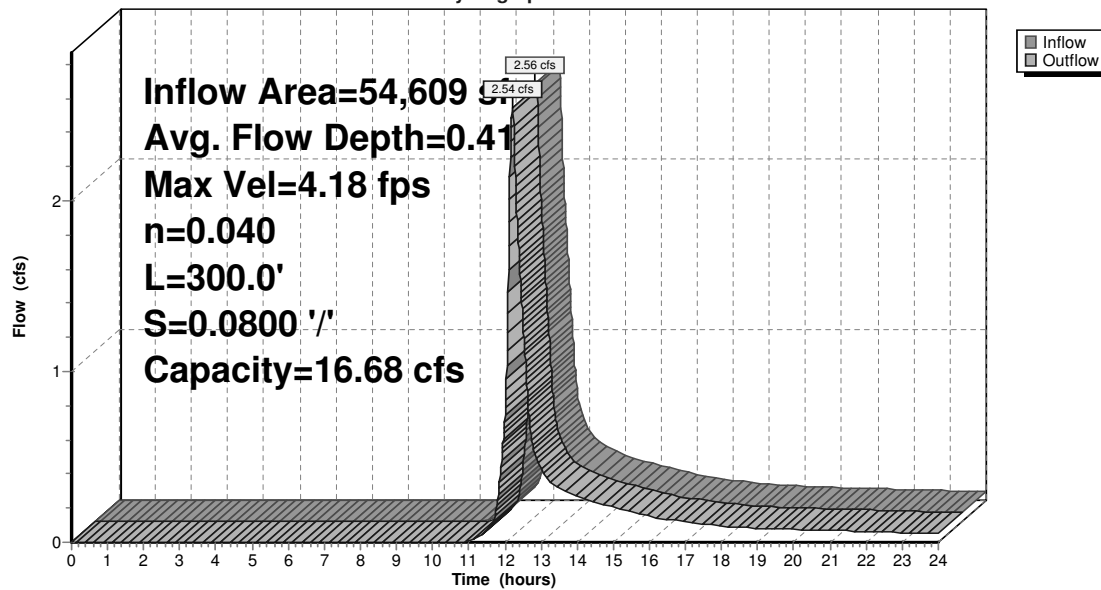

Summary for Reach 4R: Stream

Inflow Area = 54,609 sf, 1.55% Impervious, Inflow Depth > 2.21" for 100 Yr event
 Inflow = 2.54 cfs @ 12.20 hrs, Volume= 10,049 cf
 Outflow = 2.48 cfs @ 12.27 hrs, Volume= 10,015 cf, Atten= 2%, Lag= 3.9 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs

Max. Velocity= 3.06 fps, Min. Travel Time= 2.2 min

Avg. Velocity = 1.12 fps, Avg. Travel Time= 6.1 min

Peak Storage= 332 cf @ 12.23 hrs

Average Depth at Peak Storage= 0.27'

Bank-Full Depth= 2.00' Flow Area= 13.0 sf, Capacity= 118.99 cfs

2.50' x 2.00' deep channel, n= 0.040 Winding stream, pools & shoals

Side Slope Z-value= 2.0 '/ Top Width= 10.50'


Length= 410.0' Slope= 0.0512 '/

Inlet Invert= 274.00', Outlet Invert= 253.00'



Reach 4R: Stream

Hydrograph

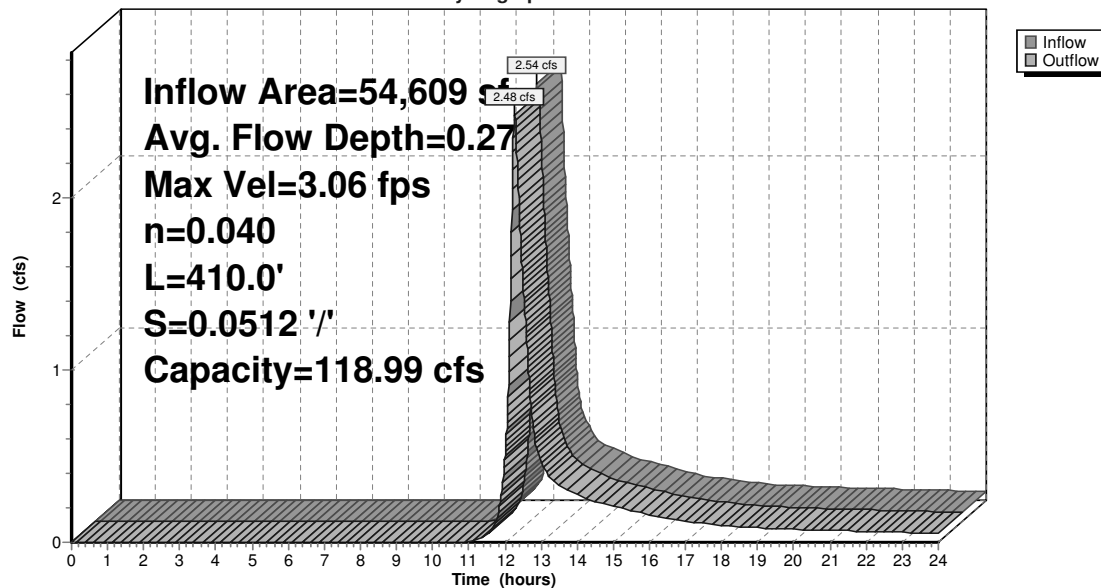

Summary for Pond 1P: Det Basin

Inflow Area = 317,507 sf, 29.72% Impervious, Inflow Depth > 3.82" for 100 Yr event
 Inflow = 26.64 cfs @ 12.17 hrs, Volume= 101,061 cf
 Outflow = 9.20 cfs @ 12.56 hrs, Volume= 92,034 cf, Atten= 65%, Lag= 23.2 min
 Discarded = 0.55 cfs @ 12.56 hrs, Volume= 14,167 cf
 Primary = 8.65 cfs @ 12.56 hrs, Volume= 77,867 cf

Routing by Stor-Ind method, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs
 Peak Elev= 272.39' @ 12.56 hrs Surf.Area= 11,669 sf Storage= 38,664 cf

Plug-Flow detention time= 113.7 min calculated for 92,034 cf (91% of inflow)
 Center-of-Mass det. time= 69.8 min (900.6 - 830.7)

Volume	Invert	Avail.Storage	Storage Description		
#1	266.00'	46,058 cf	Custom Stage Data (Irregular) Listed below (Recalc)		
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
266.00	1,320	147.0	0	0	1,320
268.00	3,623	243.0	4,753	4,753	4,325
270.00	7,534	370.0	10,921	15,674	10,550
272.00	11,140	448.0	18,557	34,231	15,693
273.00	12,527	468.0	11,827	46,058	17,221

Device	Routing	Invert	Outlet Devices	
#1	Discarded	266.00'	1.020 in/hr Exfiltration over Surface area Conductivity to Groundwater Elevation = 264.00'	
#2	Primary	265.00'	24.0" Round Culvert L= 45.0' RCP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 265.00' / 259.00' S= 0.1333 '/ Cc= 0.900 n= 0.013, Flow Area= 3.14 sf	
#3	Device 2	268.20'	4.0" Vert. Orifice/Grate C= 0.600	
#4	Device 2	269.20'	0.7' long Sharp-Crested Rectangular Weir 2 End Contraction(s) 4.5' Crest Height	
#5	Device 2	272.30'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads	

16181

Prepared by Microsoft

HydroCAD® 10.00-18 s/n 07559 © 2016 HydroCAD Software Solutions LLC

Type III 24-hr 100 Yr Rainfall=7.00"

Printed 5/14/2020

Page 101

Discarded OutFlow Max=0.55 cfs @ 12.56 hrs HW=272.39' (Free Discharge)

1=Exfiltration (Controls 0.55 cfs)


Primary OutFlow Max=8.61 cfs @ 12.56 hrs HW=272.39' (Free Discharge)

2=Culvert (Passes 8.61 cfs of 38.23 cfs potential flow)

3=Orifice/Grate (Orifice Controls 0.84 cfs @ 9.66 fps)

4=Sharp-Crested Rectangular Weir (Weir Controls 7.08 cfs @ 6.35 fps)

5=Orifice/Grate (Weir Controls 0.69 cfs @ 0.97 fps)

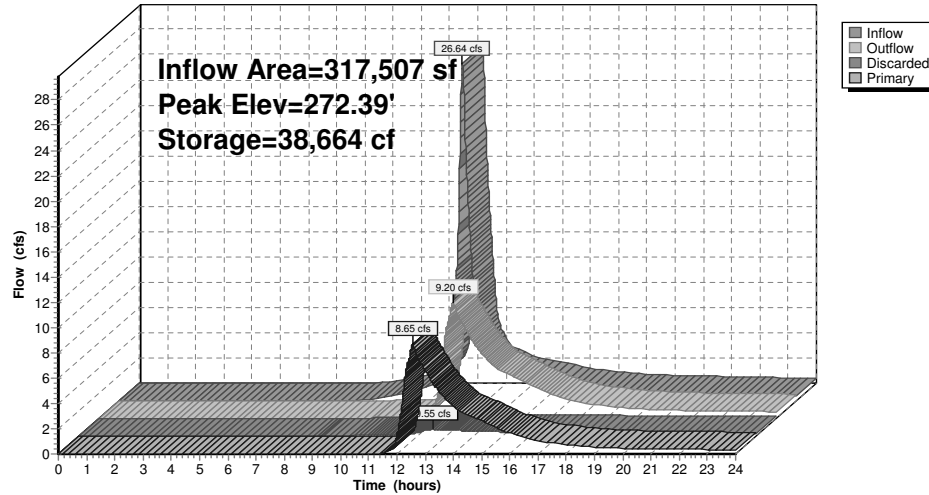Pond 1P: Det Basin**Hydrograph**

16181

Prepared by Microsoft

HydroCAD® 10.00-18 s/n 07559 © 2016 HydroCAD Software Solutions LLC

Type III 24-hr 100 Yr Rainfall=7.00"

Printed 5/14/2020

Page 102

Summary for Pond 6P: Det Pond #1

Volume	Invert	Avail. Storage	Storage Description			
#1	108.50'	18,111 cf	Custom Stage Data (Irregular) Listed below (Recalc)			
Elevation (feet)	Surf. Area (sq-ft)	Perim. (feet)	Inc. Store (cubic-feet)	Cum. Store (cubic-feet)	Wet. Area (sq-ft)	
108.50	50	100.0	0	0	50	
108.70	1,481	179.0	120	120	1,804	
109.00	4,194	326.0	817	937	7,712	
110.00	5,261	371.0	4,717	5,654	10,232	
111.00	6,223	387.0	5,735	11,390	11,269	
112.00	7,233	402.0	6,722	18,111	12,290	

Device	Routing	Invert	Outlet Devices			
#1	Primary	108.50'	18.0" Round Culvert L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 108.50' / 108.00' S= 0.0250' / Cc= 0.900 n= 0.013, Flow Area= 1.77 sf			
#2	Device 1	108.50'	2.0" Vert. Orifice/Grate C= 0.600			
#3	Device 1	111.00'	24.0" x 24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads			
#4	Device 1	110.00'	2.5' long Sharp-Crested Rectangular Weir 2 End Contraction(s) 1.0' Crest Height			

Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=0.00' (Free Discharge)

1=Culvert (Controls 0.00 cfs)


2=Orifice/Grate (Controls 0.00 cfs)

3=Orifice/Grate (Controls 0.00 cfs)

4=Sharp-Crested Rectangular Weir (Controls 0.00 cfs)

Pond 6P: Det Pond #1

Hydrograph

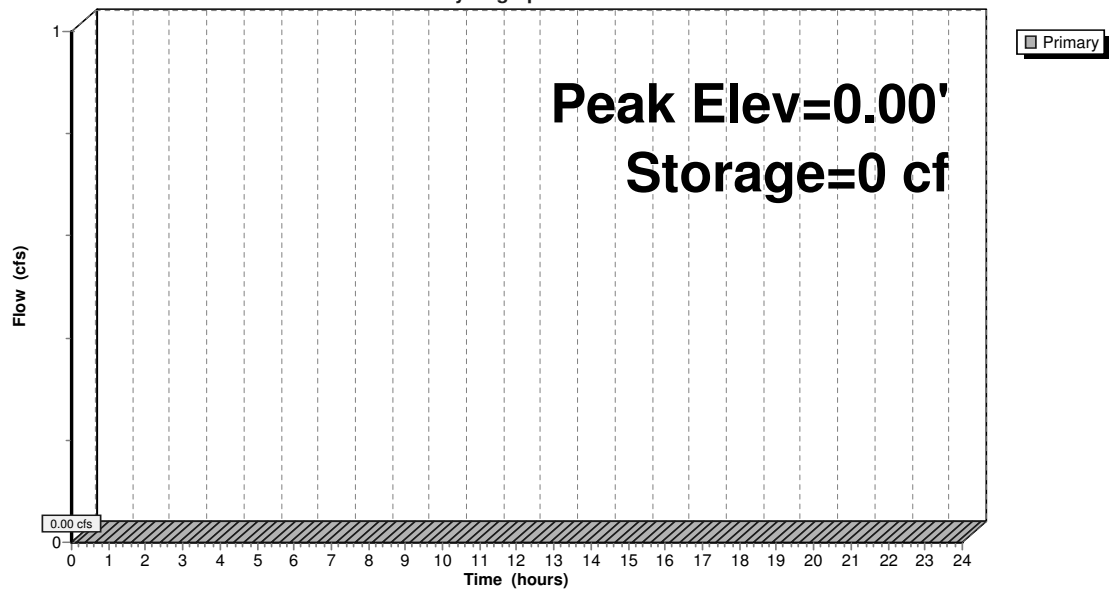


Summary for Link DP1: PreDev

Inflow Area = 593,502 sf, 0.00% Impervious, Inflow Depth > 2.11" for 100 Yr event
Inflow = 19.29 cfs @ 12.39 hrs, Volume= 104,194 cf
Primary = 19.29 cfs @ 12.39 hrs, Volume= 104,194 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs

Link DP1: PreDev


Hydrograph

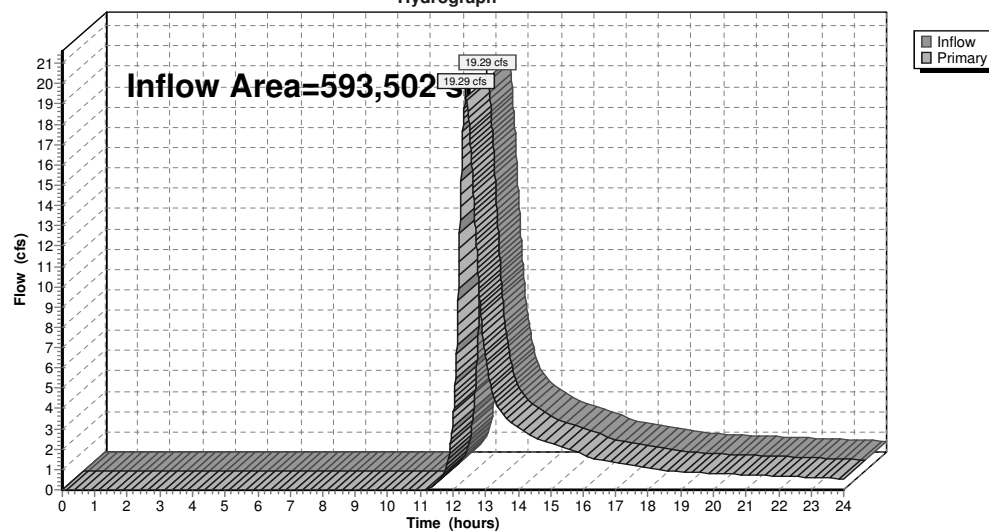

Summary for Link DP2: Post Offsite

Inflow Area = 601,961 sf, 16.65% Impervious, Inflow Depth > 2.63" for 100 Yr event
Inflow = 17.47 cfs @ 12.49 hrs, Volume= 131,845 cf
Primary = 17.47 cfs @ 12.49 hrs, Volume= 131,845 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-24.00 hrs, dt= 0.01 hrs

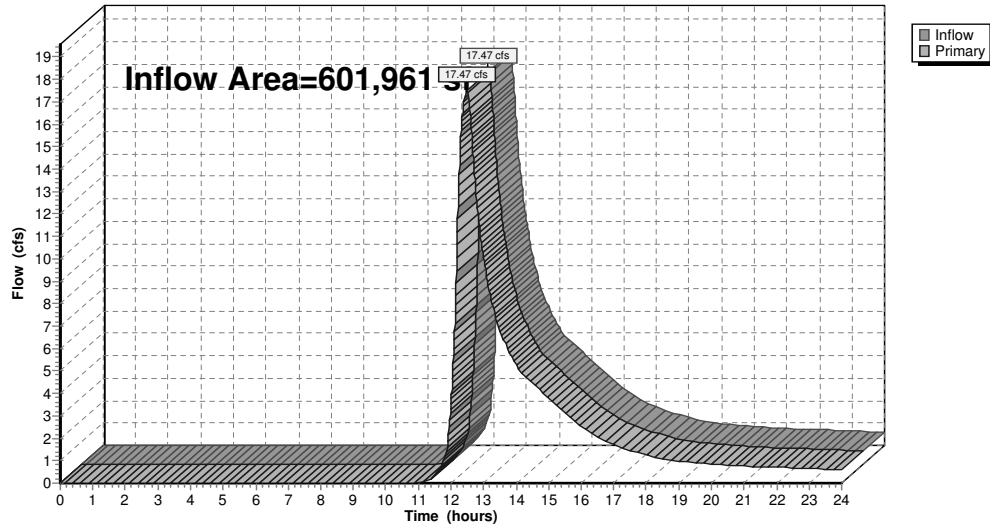Link DP2: Post Offsite**Hydrograph**

APPENDIX – B

Hydraulic Design (Manning's Equation)

Time of Flow, Average CN values

Groundwater Mounding Calculations

Standard 2

i = Rainfall Intensity at 25 Year Storm

Date: 5/13/20
Revised:
Job No: 16,181
Calc. by: rst

Line			Length (Feet)	Drain Area (Ac)	Total Area (Ac)	Runoff "C"	Time of Concentration (min.)				Rainfall i (in./hr.)	Required Capacity Q(cfs)			Pipe Diameter (in.)	Slope (ft./ft.)	Design Conditions			Rim Elev.
From	To	Upper End					In Pipe	Total	Inlet	Pipe		Velocity (f.p.s.)	Depth (in.)	Invert Elevation			Lower	Upper	n	
	CB 1	DWH 3	11	0.90		0.43	19.78	0.03	19.81	3.97	1.51		12	0.018		269.70	269.50		272.79	0.013
	CB 2	DWH 3	5	0.19		0.49	9.95	0.02	9.97	5.19	0.49		12	0.040		269.70	269.50		272.79	0.013
	DWH 3	DWH 4	56		1.09	0.44	19.81	0.21	20.02	3.96	1.89		12	0.009	6.40	269.40	268.90		273.50	0.013
	DWH 4	HW 5	22		1.09	0.44	20.02	0.08	20.11	3.94		1.88	12	0.009	6.40	268.70	268.50		288.12	0.013
	CB 20	DMH 19	10	0.26		0.46	13.59	0.03	13.62	4.63	0.55		12	0.050	2.10	305.30	304.80		309.39	0.013
	CB 21	DMH 19	15	0.83		0.67	15.21	0.03	15.25	4.43	2.46		12	0.033	5.10	305.30	304.80		309.39	0.013
	DMH 19	DMH 18	45		1.09	0.62	15.25	0.08	15.33	4.43		2.98	12	0.049	5.10	304.70	302.80		308.83	0.013
	DMH 18	DMH 17	36		1.09	0.62	15.33	0.07	15.39	4.42	2.98		12	0.044	5.20	302.40	300.50		306.61	0.013
	DMH 17	DMH 16	36		1.09	0.62	15.39	0.07	15.46	4.41	2.97		12	0.047	5.20	300.70	299.00		304.84	0.013
	DMH 16	DMH 13	110		1.09	0.62	15.46	0.20	15.66	4.40		2.97	12	0.045	5.20	298.90	293.90		303.06	0.013
	CB 14	DMH 13	11	0.37		0.50	16.04	0.02	16.06	4.34	0.81		12	0.091	2.20	294.90	293.90		298.31	0.013
	CB 15	DMH 13	5	0.86		0.52	14.87	0.01	14.88	4.47	2.02		12	0.200	2.90	294.90	293.90		298.31	0.013
	DMH 13	DMH 12	185		1.23	0.52	14.88	0.34	15.22	4.47		2.85	12	0.047	5.10	293.80	285.10		297.96	0.013

AVERAGE 'c' VALUE FOR STRUCTURES

STORM RUNOFF DATA

Date: **5/13/20**

Revised:

Project: **Geoffrey Park**
Town: **Holliston, MA**

Job No: **16,181**

Calc. by: **RST**

Structure	Total Area (SF)	Ground Cover	Area (SF)	c	$\Sigma(\text{Area} \cdot c)$	Average c	Total Area (Ac)
CB#1	39,042	imp	7,539	0.95	7,162.05	0.43	0.896
		lawn	31,503	0.30	9,450.90		
		wooded	0	0.20	0.00		
CB#2	8,359	imp	2,494	0.95	2,369.30	0.49	0.192
		lawn	5,865	0.30	1,759.50		
		wooded	0	0.20	0.00		
CB#10	35,825	imp	8,950	0.95	8,502.50	0.46	0.822
		lawn	26,875	0.30	8,062.50		
		wooded	0	0.20	0.00		
CB#11	15,656	imp	8,792	0.95	8,352.40	0.67	0.359
		lawn	6,864	0.30	2,059.20		
		wooded	0	0.20	0.00		
CB#14	16,127	imp	5,048	0.95	4,795.60	0.50	0.370
		lawn	11,079	0.30	3,323.70		
		wooded	0	0.20	0.00		
CB#15	37,649	imp	12,870	0.95	12,226.50	0.52	0.864
		lawn	24,779	0.30	7,433.70		
		wooded	0	0.20	0.00		
CB#20	11,208	imp	3,604	0.95	3,423.80	0.51	0.257
		lawn	7,604	0.30	2,281.20		
		wooded	0	0.20	0.00		
CB#21	36,311	imp	7,673	0.95	7,289.35	0.44	0.834
		lawn	28,638	0.30	8,591.40		
		wooded	0	0.20	0.00		
CB#27	13,608	imp	6,104	0.95	5,798.80	0.59	0.312
		lawn	7,504	0.30	2,251.20		
		wooded	0	0.20	0.00		
CB#28	38,293	imp	14,234	0.95	13,522.30	0.54	0.879
		lawn	24,059	0.30	7,217.70		
		wooded	0	0.20	0.00		
CB#23	15,412	imp	4,940	0.95	4,693.00	0.51	0.354
		lawn	10,472	0.30	3,141.60		
		wooded	0	0.20	0.00		
CB#24	25,304	imp	9,100	0.95	8,645.00	0.53	0.581
		lawn	16,204	0.30	4,861.20		
		wooded	0	0.20	0.00		

OVERLAND FLOW TRAVEL TIME

STORM RUNOFF DATA

Project: **Geoffrey Park**
Town: **Holliston, MA**

Date: **5/7/20**

Revised:

Job No: **16,181**

Calc. by: **rst**

Structure	Impervious			Lawn			Wooded			Total
	Length (ft)	Slope ('/')	Time (min.)	Length (ft)	Slope ('/')	Time (min.)	Length (ft)	Slope ('/')	Time (min.)	Travel Time (min.)
1	20	0.080	0.21	325	0.090	19.57				19.78
2	240	0.080	1.40	45	0.060	8.55				9.95
10	200	0.044	1.54	210	0.075	16.66				18.19
11	190	0.044	1.48	45	0.030	10.06				11.54
14	140	0.015	1.77	110	0.040	14.28				16.04
15	170	0.044	1.35	120	0.060	13.52				14.87
20	175	0.040	1.44	55	0.020	12.16				13.59
21	175	0.040	1.44	125	0.060	13.78				15.21
23	140	0.065	1.00	120	0.080	12.63				13.64
24	200	0.065	1.32	180	0.050	17.05				18.37
27	220	0.035	1.80	45	0.030	10.06				11.87
28	220	0.035	1.80	125	0.055	14.06				15.87

APPENDIX – C

Stormwater Recharge Calculations, Water Quality Volumes, TSS Removal & Infiltration BMP Drain Time Groundwater Mounding Calculations

Standards 3 & 4:

APPENDIX – B
Stormwater Recharge, Water Quality & Forebay Calculations
Standard 3 & 4:

Project:

Geofrey Park
Holliston, Massachusetts
Date: May 14, 2020

Water Quality Volume (WQV): Based on 0.5 inch rainfall

Recharge Volume(Rv): Based on Soil Classification

$R_v = F * \text{Impervious Area}$

Rv = Required Recharge Volume

F = Depth Factor

Soil Type A – 0.60 inch

Soil Type B – 0.35 inch

Soil Type C – 0.25 inch

Soil Type D – 0.00 inch

Total Impervious Area:

Roadway/Drives: 63,408 s.f. (To drainage basin)

Roof: (to basins) 30,966 s.f.

Roof:(bypass basin) 5,824 s.f.

Total Imp. Area: 100,198 s.f.

Total Impervious to Recharge Basins: 94,374 s.f.

Total Impervious Area Uncaptured: 5,824 s.f.

Capture Adjustment:

$94,374 \text{ s.f.} / 100,198 \text{ s.f.} = 94.2\% > 65\%$

$100,198 \text{ s.f.} / 94,374 \text{ s.f.} = 1.06 \text{ capture adjustment}$

Drainage Basin #1 :

Imp. Area Pavement: 63,408 s.f.

$WQV = (63,408 \text{ sf} * 0.5 \text{ in}) / 12 = \underline{2642 \text{ c.f.}}$

Recharge Volume Required: (Soil Type B – 0.35 inch)

Tot. Imp Area: 94,374 s.f.

$R_v = (94,374 \text{ sf} * 0.35 \text{ in}) / 12 = \underline{2752 \text{ c.f.}} * \text{Capture Adjustment (1.06)} = \underline{2,918 \text{ c.f.}}$

Storage Volume below outlet

"Static" Storage Volume Provided:

Volume (Outlet 268.2) provided = 5,510 c.f.

5,510 > 2,918 c.f. **OK**

Time to drain:

Drawdown time = Volume/(K*Bottom Area)

Volume = 2918 cf

K=1.02 in/hr = 0.085 ft/hr

Bottom Area = 3620 sf (El.268.0)

Drawdown time = $2918 / (0.085 \text{ ft/hr} * 3620 \text{ sf})$

Drawdown time = 9.5 hr < 72 hr **ok**

This spreadsheet will calculate the height of a groundwater mound beneath a stormwater infiltration basin. More information can be found in the U.S. Geological Survey Scientific Investigations Report 2010-5102 "Simulation of groundwater mounding beneath hypothetical stormwater infiltration basins".

The user must specify infiltration rate (R), specific yield (Sy), horizontal hydraulic conductivity (Kh), basin dimensions (x, y), duration of infiltration period (t), and the initial thickness of the saturated zone (hi(0), height of the water table if the bottom of the aquifer is the datum). For a square basin the half width equals the half length (x = y). For a rectangular basin, if the user wants the water-table changes perpendicular to the long side, specify x as the short dimension and y as the long dimension. Conversely, if the user wants the values perpendicular to the short side, specify y as the short dimension, x as the long dimension. All distances are from the center of the basin. Users can change the distances from the center of the basin at which water-table aquifer thickness are calculated.

Cells highlighted in yellow are values that can be changed by the user. Cells highlighted in red are output values based on user-specified inputs. **The user MUST click the blue "Re-Calculate Now" button each time ANY of the user-specified inputs are changed** otherwise necessary iterations to converge on the correct solution will not be done and values shown will be incorrect. Use consistent units for all input values (for example, feet and days)


Input Values		use consistent units (e.g. feet & days or inches & hours)	Conversion Table		
			inch/hour	feet/day	
1.2100	R	Recharge (infiltration) rate (feet/day)	0.67	1.33	
0.210	Sy	Specific yield, Sy (dimensionless, between 0 and 1)			
20.40	K	Horizontal hydraulic conductivity, Kh (feet/day)*	2.00	4.00	
76.000	x	1/2 length of basin (x direction, in feet)			
37.000	y	1/2 width of basin (y direction, in feet)	hours	days	
1.000	t	duration of infiltration period (days)	36	1.50	
25.000	hi(0)	initial thickness of saturated zone (feet)			
28.055	h(max)	maximum thickness of saturated zone (beneath center of basin at end of infiltration period)			
3.055	Δh(max)	maximum groundwater mounding (beneath center of basin at end of infiltration period)			

Ground-water Mounding, in feet

Distance from center of basin in x direction, in feet	
0	3.055
20	2.985
40	2.756
50	2.565
60	2.308
70	1.967
80	1.540
90	1.169
100	0.881
120	0.486



Re-Calculate Now

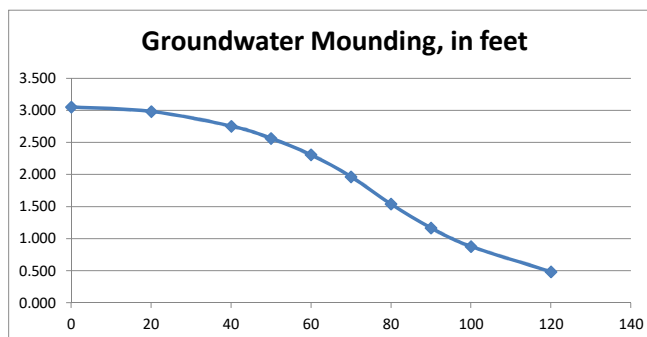

Disclaimer

This spreadsheet solving the Hantush (1967) equation for ground-water mounding beneath an infiltration basin is made available to the general public as a convenience for those wishing to replicate values documented in the USGS Scientific Investigations Report 2010-5102 "Groundwater mounding beneath hypothetical stormwater infiltration basins" or to calculate values based on user-specified site conditions. Any changes made to the spreadsheet (other than values identified as user-specified) after transmission from the USGS could have unintended, undesirable consequences. These consequences could include, but may not be limited to: erroneous output, numerical instabilities, and violations of underlying assumptions that are inherent in results presented in the accompanying USGS published report. The USGS assumes no responsibility for the consequences of any changes made to the spreadsheet. If changes are made to the spreadsheet, the user is responsible for documenting the changes and justifying the results and conclusions.

APPENDIX – D

Stormwater Operation and Maintenance Plan
and
Long Term Pollution Prevention Plan

Standard 9

Stormwater Management Operation and Maintenance Plan
And Long Term Pollution Prevention Plan

Maintenance Agreement
Geoffrey Park
Holliston, Massachusetts

May 14, 2020

In accordance with Standard 9 of the Massachusetts Department of Environmental Protection Stormwater Handbook (February 2008), the attached on-site maintenance program for the proposed stormwater management system has been developed to ensure the Best Management Practices (BMP's) in place will remain functioning as designed. The landowner/operator, or its successors, of the Project Site, Geoffrey Park shall be responsible for financing maintenance and emergency repairs of the entire storm-water management system on the property. The Plan contains both construction period operations and maintenance as well as post construction responsibilities that shall "run" with the property if ownership is transferred.

Responsible Operator:

Indian Ridge Realty Trust
Attn: David Adams
223 Courtland Street
Holliston, MA 01746
Office: 508-561-4197

David Adams

Date

Estimated Maintenance Yearly Budget:

Annual Catch Basin and Stormceptor Cleaning:	\$ 1,500.00
Mowing, vegetation maintenance of Drainage Basin:	\$ 480.00
Repairs:	<u>\$ 250.00</u>
Total	\$ 2,230.00

Construction Period Operation and Maintenance:

Good Housekeeping Practices:

- Remove all debris from site and dispose of in trash dumpsters
- Plan for adequate disposal of scrap, waste and surplus materials
- Keep work area clean
- Secure loose or light material that is stored on the site
- Store flammable materials apart from other materials
- Secure all materials at the end of each work day
- Maintain a clean neat and orderly site

Safety:

Keep safety considerations at the forefront of inspection procedures at all times. Likely hazards should be anticipated and avoided. Never enter a confined space (outlet structure, manhole, etc) without proper training or equipment. A confined space should never be entered without at least one additional person present. If a toxic or flammable substance is discovered, leave the immediate area and contact the local authorities at 911.

All cast iron storm water structure grates and covers shall be kept in good condition and kept closed at all times. Any damaged or broken structures will be replaced immediately upon discovery.

Construction Entrances:

The purpose of stabilizing entrances to a construction site is to minimize the amount of sediment leaving the area as mud and sediment attached to vehicles. The entrances shall be sized according to the Massachusetts DEP and US EPA guidelines and will be maintained on a weekly basis during construction. A Detail is included in the Site Plans prepared for the Project.

Dust Control:

Soils information for the site indicates that it is comprised of sandy soils. Therefore, Dust control BMPs to reduce surface activities and air movement that causes dust to be generated from disturbed soil surfaces will be required. The preferred measure for dust control is sprinkling/irrigation. This is an on-going/as-needed requirement until surfaces have been stabilized. There shall be a water truck on-site available as needed.

Catch Basin Protection:

Temporary inlet protection barriers consisting of Silt Sacks® will be placed within all constructed inlets to prevent inflow of sediments into the constructed drainage system. The barriers shall remain in place until a permanent cover is established or diversions away from the inlets are constructed. The barriers shall be observed and maintained as necessary on a weekly basis and after every rainfall of 0.5 inches or more.

Spill Control:

A contingency plan to address the spillage/release of petroleum products and any hazardous materials will be implemented for the site during construction. The plan will include the following measures:

- Equipment necessary to quickly attend to inadvertent spills or leaks shall be on-site in a secure but accessible location. Such equipment will include, but not be limited to, the following: urethane drain cover seals (mats), a spill containment kit which includes sand and shovels, suitable absorbent materials, storage containers, safety goggles, chemically resistant gloves and overshoe boots, water and chemical fire extinguishers, and first aid equipment.
- Spills or leaks will be treated properly according to material type, volume of spillage and location of spill. Mitigation will include preventing further spillage, containing the spilled material to the smallest practical area, removing spilled material in a safe and environmentally friendly manner, and remediating any damage to the environment.
- The contractor shall be familiar with the reporting requirements of the Massachusetts Contingency Plan (310 CMR 40.00) as issued by the Massachusetts Department of Environmental Protection (DEP); specifically Subpart C Notification of Releases and Threats of Release of Oil and Hazardous Materials and Subpart D Preliminary Response Activities and Risk Reduction Measures.
- For any large spills. The Massachusetts DEP Hazardous Waste Incident Response Group shall be notified immediately at 1-617-792-7653 and an emergency response contractor will be called in.

Post-Construction Period Operation and Maintenance:

Pavement Sweeping:

Sweeping has been shown to be an effective initial treatment for reducing contaminants in stormwater runoff. Sweeping is not required to meet TSS removal goals in this case but should be performed at least once per year, in the spring to remove winter accumulations or at other when warranted.

Stormceptor STC450i Treatment Catch Basin Units:

Sediments, associated pollutants and trash are removed only when inlets or sumps are cleaned out, so regular maintenance is essential. Cleaning includes removal of accumulated oil and grease and sediment using a vacuum truck or other ordinary catch basin cleaning device. In areas of high sediment loading, inspect and clean inlets after every major storm. At a minimum, inspect oil grit separators and clean them out at least twice per year. Cleaning of a Stormceptor systems should be done during dry weather conditions when no flow is entering the system. The use of a vacuum truck is generally the most effective and convenient method of removing pollutants from the system.

Stormceptor Treatment Units:

<u>Activity</u>	<u>Inspection Frequency</u>
Inspect Inlet and Outlet	2 times per yr. After a heavy rain event 1" storm or larger
Sediment buildup & Clean	2 times per yr. (minimum) Accumulated sediment buildup shall be Vacuumed cleaned as necessary

Detention/Retention Basin:

Vehicle access if necessary will be via the access around the top of the retention basin. The drainage easement shall be mowed twice a year and kept clear of any trees. The easement will be used for access to the basin.

Inspect it after every major storm for the first few months to ensure it is stabilized and functioning properly and if necessary to take corrective action. Also inspect the basin every time there is a discharge through the high outlet weir. A major storm is defined as a storm that is equal to or greater than the 2.5 inches in a 24-hour storm. Note how long the water remains standing after a storm. If longer than 72 hours, there may be clogging of the infiltrative surfaces. Inspect the basin and mow it as needed. When mowing keep the grass height no greater than 6 inches. Set mower blades no lower than 3 to 4 inches. Remove grass clippings, organic matter and trash. Use deep tilling to break up compacted or clogged surfaces.

Check for signs of gullyng and repair as needed. After removing the sediment, replace any vegetation damaged during the clean-out by reseeding.

Retention Basin:

<u>Activity</u>	<u>Inspection Frequency</u>
Sediment Removal	Inspect Monthly Remove accumulated sediment buildup Grass Mowing during growing season (Keep grasses no greater than 6 inches & no lower than 3 to 4 inches)

Snow Removal and De-icing:


Snow shall be stored in the designated areas shown on the site plans. If snow accumulation exceeds the limits of the storage areas, excess snow shall be removed from the site and disposed of in a proper manner.

The use of Sodium Chloride ("rock salt") for de-icing of paved surfaces will be limited; except when found to be necessary for safety of the residents. Sand will be the primary icing control agent. Alternative de-icing products such as calcium chloride may be used as temperatures or other conditions warrant.

Fertilizer:

Slow release organic fertilizers will be used in landscape areas to limit nutrient transport to groundwater and wetland areas. Application will be limited to 3 lbs. per 1000 sf of lawn area.

SCALE: 1"=100' MAY 14, 2014

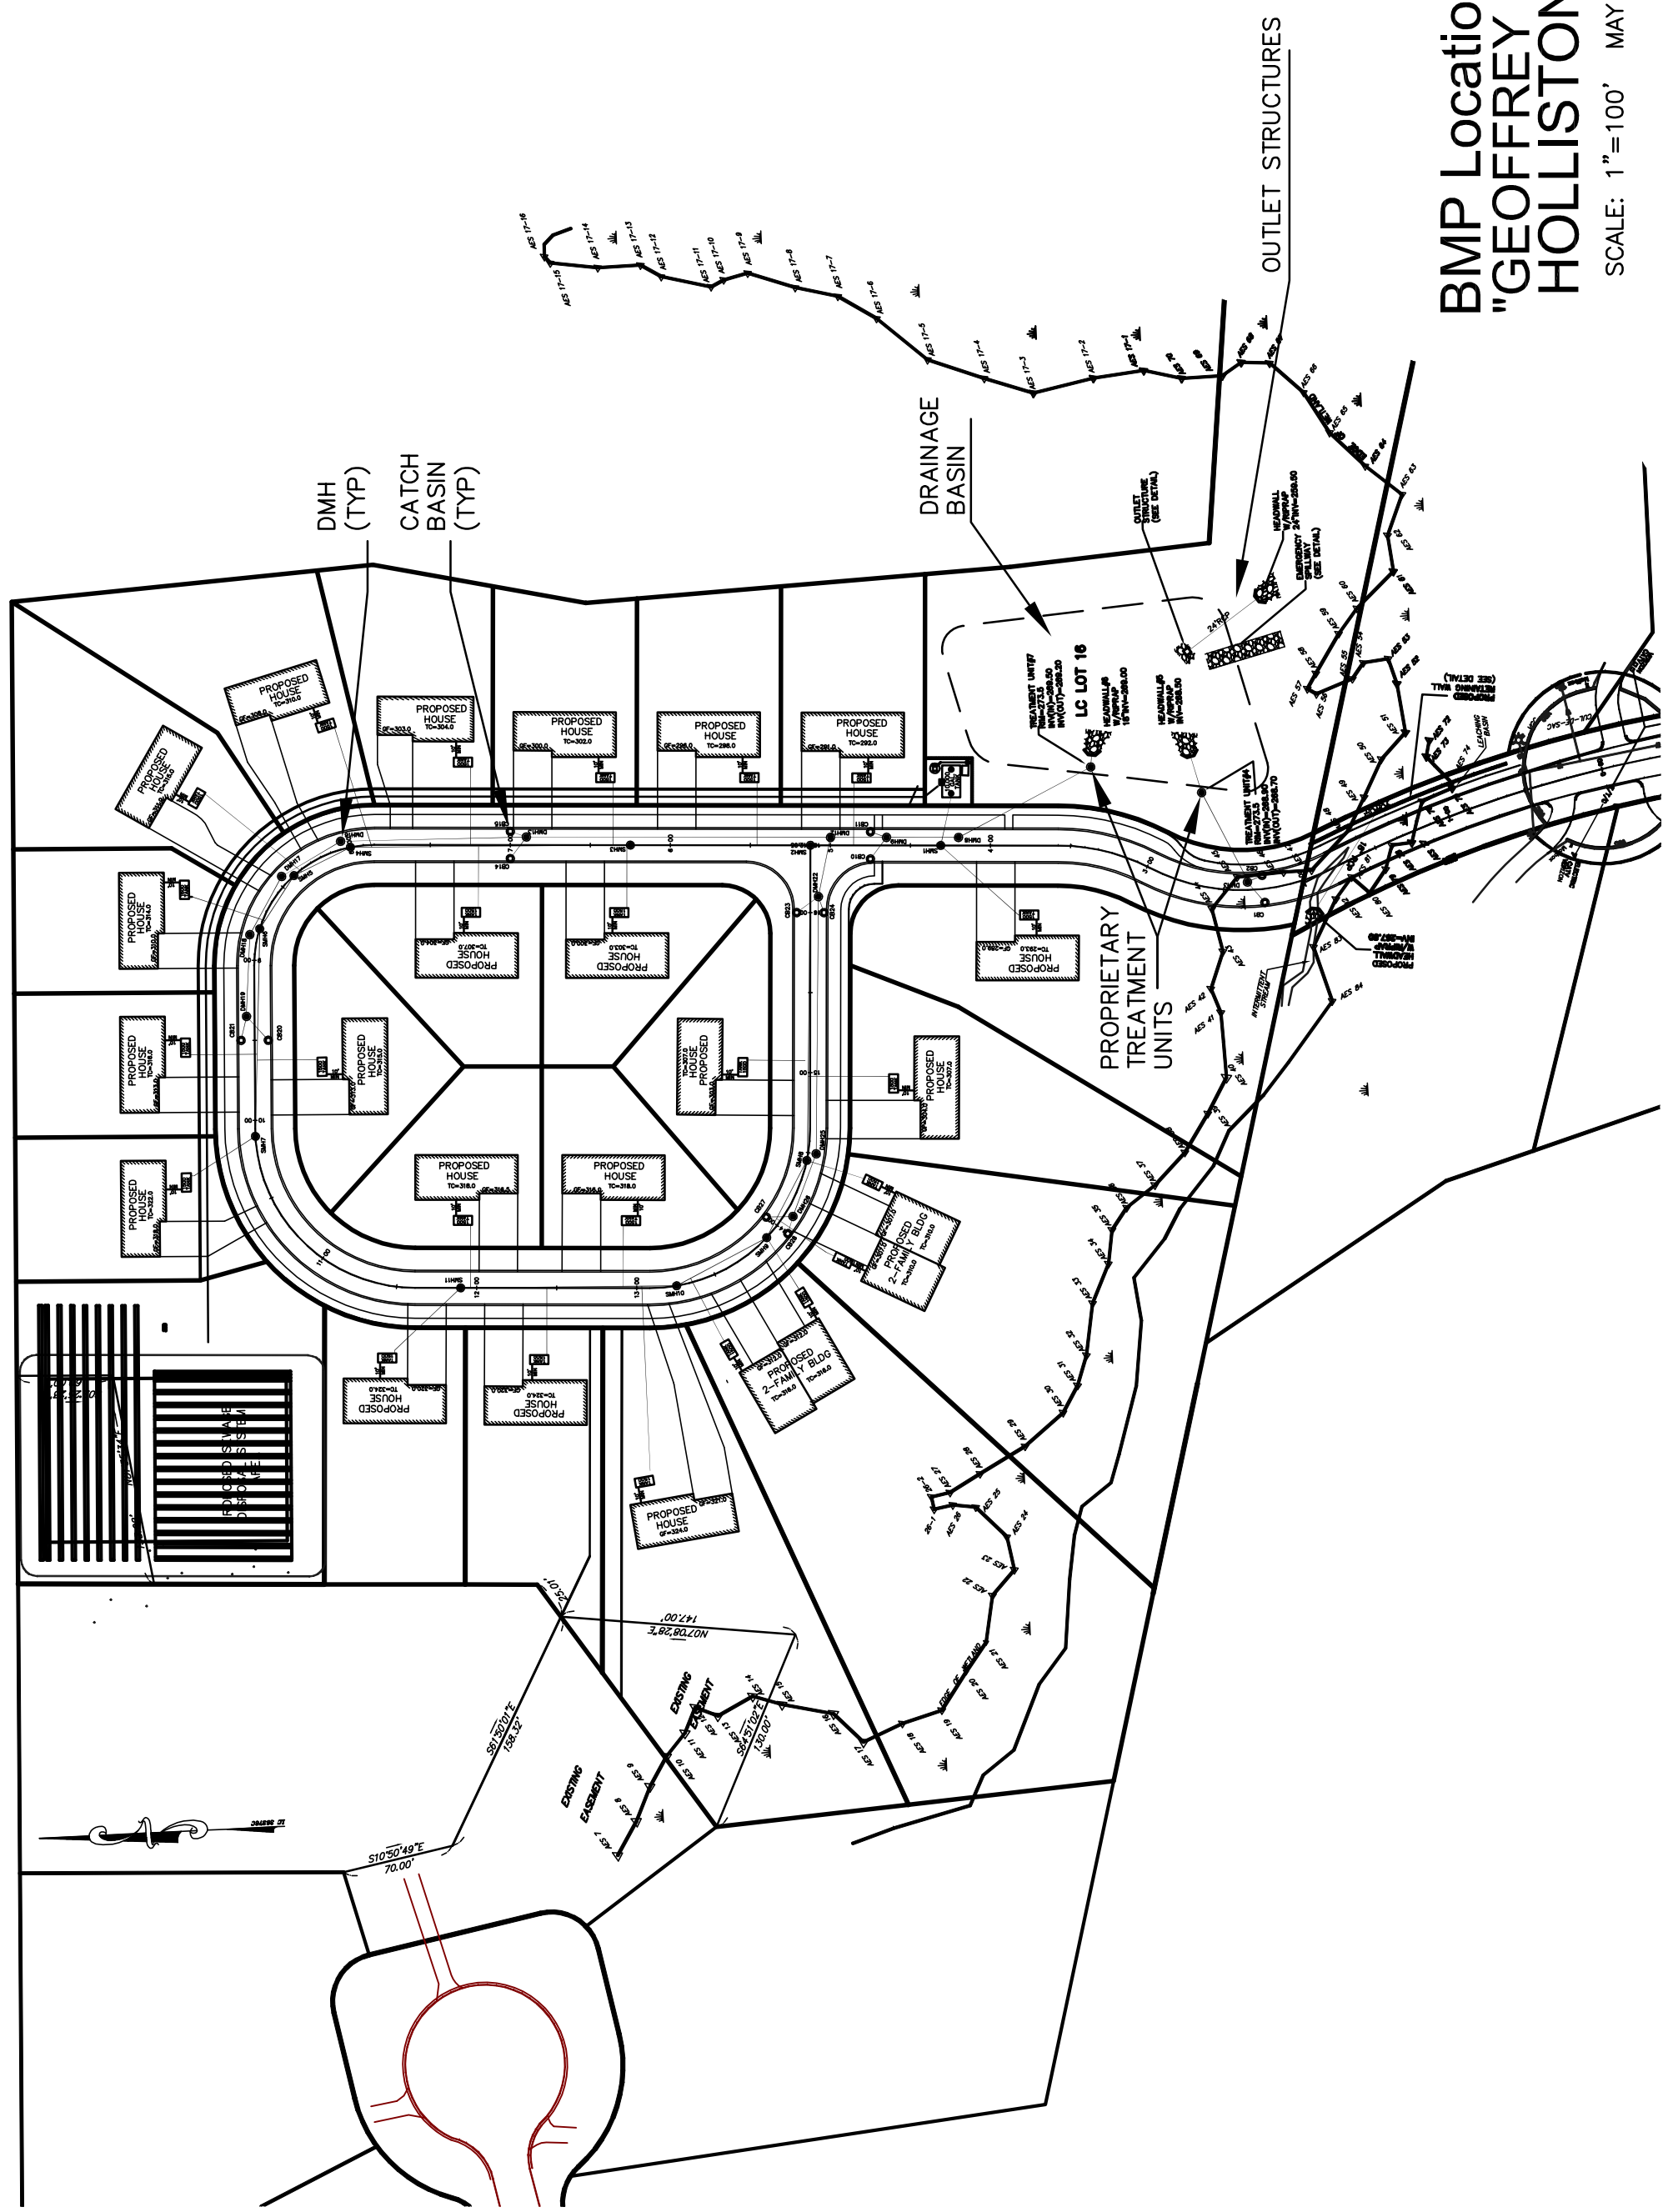

Stormwater Construction Site Inspection Report

General Information			
Project Name	Geoffrey Park		
MA DEP File No.		Location	Holliston, MA
Date of Inspection		Start/End Time	
Inspector's Name(s)			
Inspector's Title(s)			
Inspector's Contact Information			
Inspector's Qualifications			
Describe present phase of construction			
Type of Inspection: <input type="checkbox"/> Regular <input type="checkbox"/> Pre-storm event <input type="checkbox"/> During storm event <input type="checkbox"/> Post-storm event			
Weather Information			
Has there been a storm event since the last inspection? <input type="checkbox"/> Yes <input type="checkbox"/> No			
If yes, provide: Storm Start Date & Time: Storm Duration (hrs): Approximate Amount of Precipitation (in):			
Weather at time of this inspection? <input type="checkbox"/> Clear <input type="checkbox"/> Cloudy <input type="checkbox"/> Rain <input type="checkbox"/> Sleet <input type="checkbox"/> Fog <input type="checkbox"/> Snowing <input type="checkbox"/> High Winds <input type="checkbox"/> Other: Temperature:			
Have any discharges occurred since the last inspection? <input type="checkbox"/> Yes <input type="checkbox"/> No If yes, describe:			
Are there any discharges at the time of inspection? <input type="checkbox"/> Yes <input type="checkbox"/> No If yes, describe:			

Site-specific BMPs

- Number the structural and non-structural BMPs identified in your SWPPP on your site map and list them below (add as many BMPs as necessary). Carry a copy of the numbered site map with you during your inspections. This list will ensure that you are inspecting all required BMPs at your site.
- Describe corrective actions initiated, date completed, and note the person that completed the work in the Corrective Action Log.

	BMP	BMP Installed?	BMP Maintenance Required?	Corrective Action Needed and Notes
1		<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No	
2		<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No	
3		<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No	
4		<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No	
5		<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No	
6		<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No	

Non-Compliance

Describe any incidents of non-compliance not described above:

CERTIFICATION STATEMENT

"I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gathered and evaluated the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations."

Print name and title: _____

Signature: _____ **Date:** _____

APPENDIX – E

Illicit Discharge Statement

Standard 10

Illicit Discharge Compliance Statement

Geoffrey Park
Holliston, Massachusetts

May 14, 2020

This statement is provided in accordance with the provisions of the Massachusetts Stormwater Management Standard #10.

To the best of the applicant's/owners knowledge there are no illicit discharges to the site's stormwater management system.

All proposed uses on the site will not generate, store or discharge any pollutants to the groundwater and/or wetland resource areas.

Any illicit discharges identified during or after construction will be terminated immediately.

Applicant/Owner:

Indian Ridge Realty Trust
Attn: David Adams
232 Courtland Street
Holliston, MA 01746
Phone: 508-561-4197


David Adams

Date

APPENDIX – F

Supplemental Stormwater Plans

Pre-Development Subcatchment Areas
Post-Development Subcatchment Areas
Hydraulic Subcatchment Areas

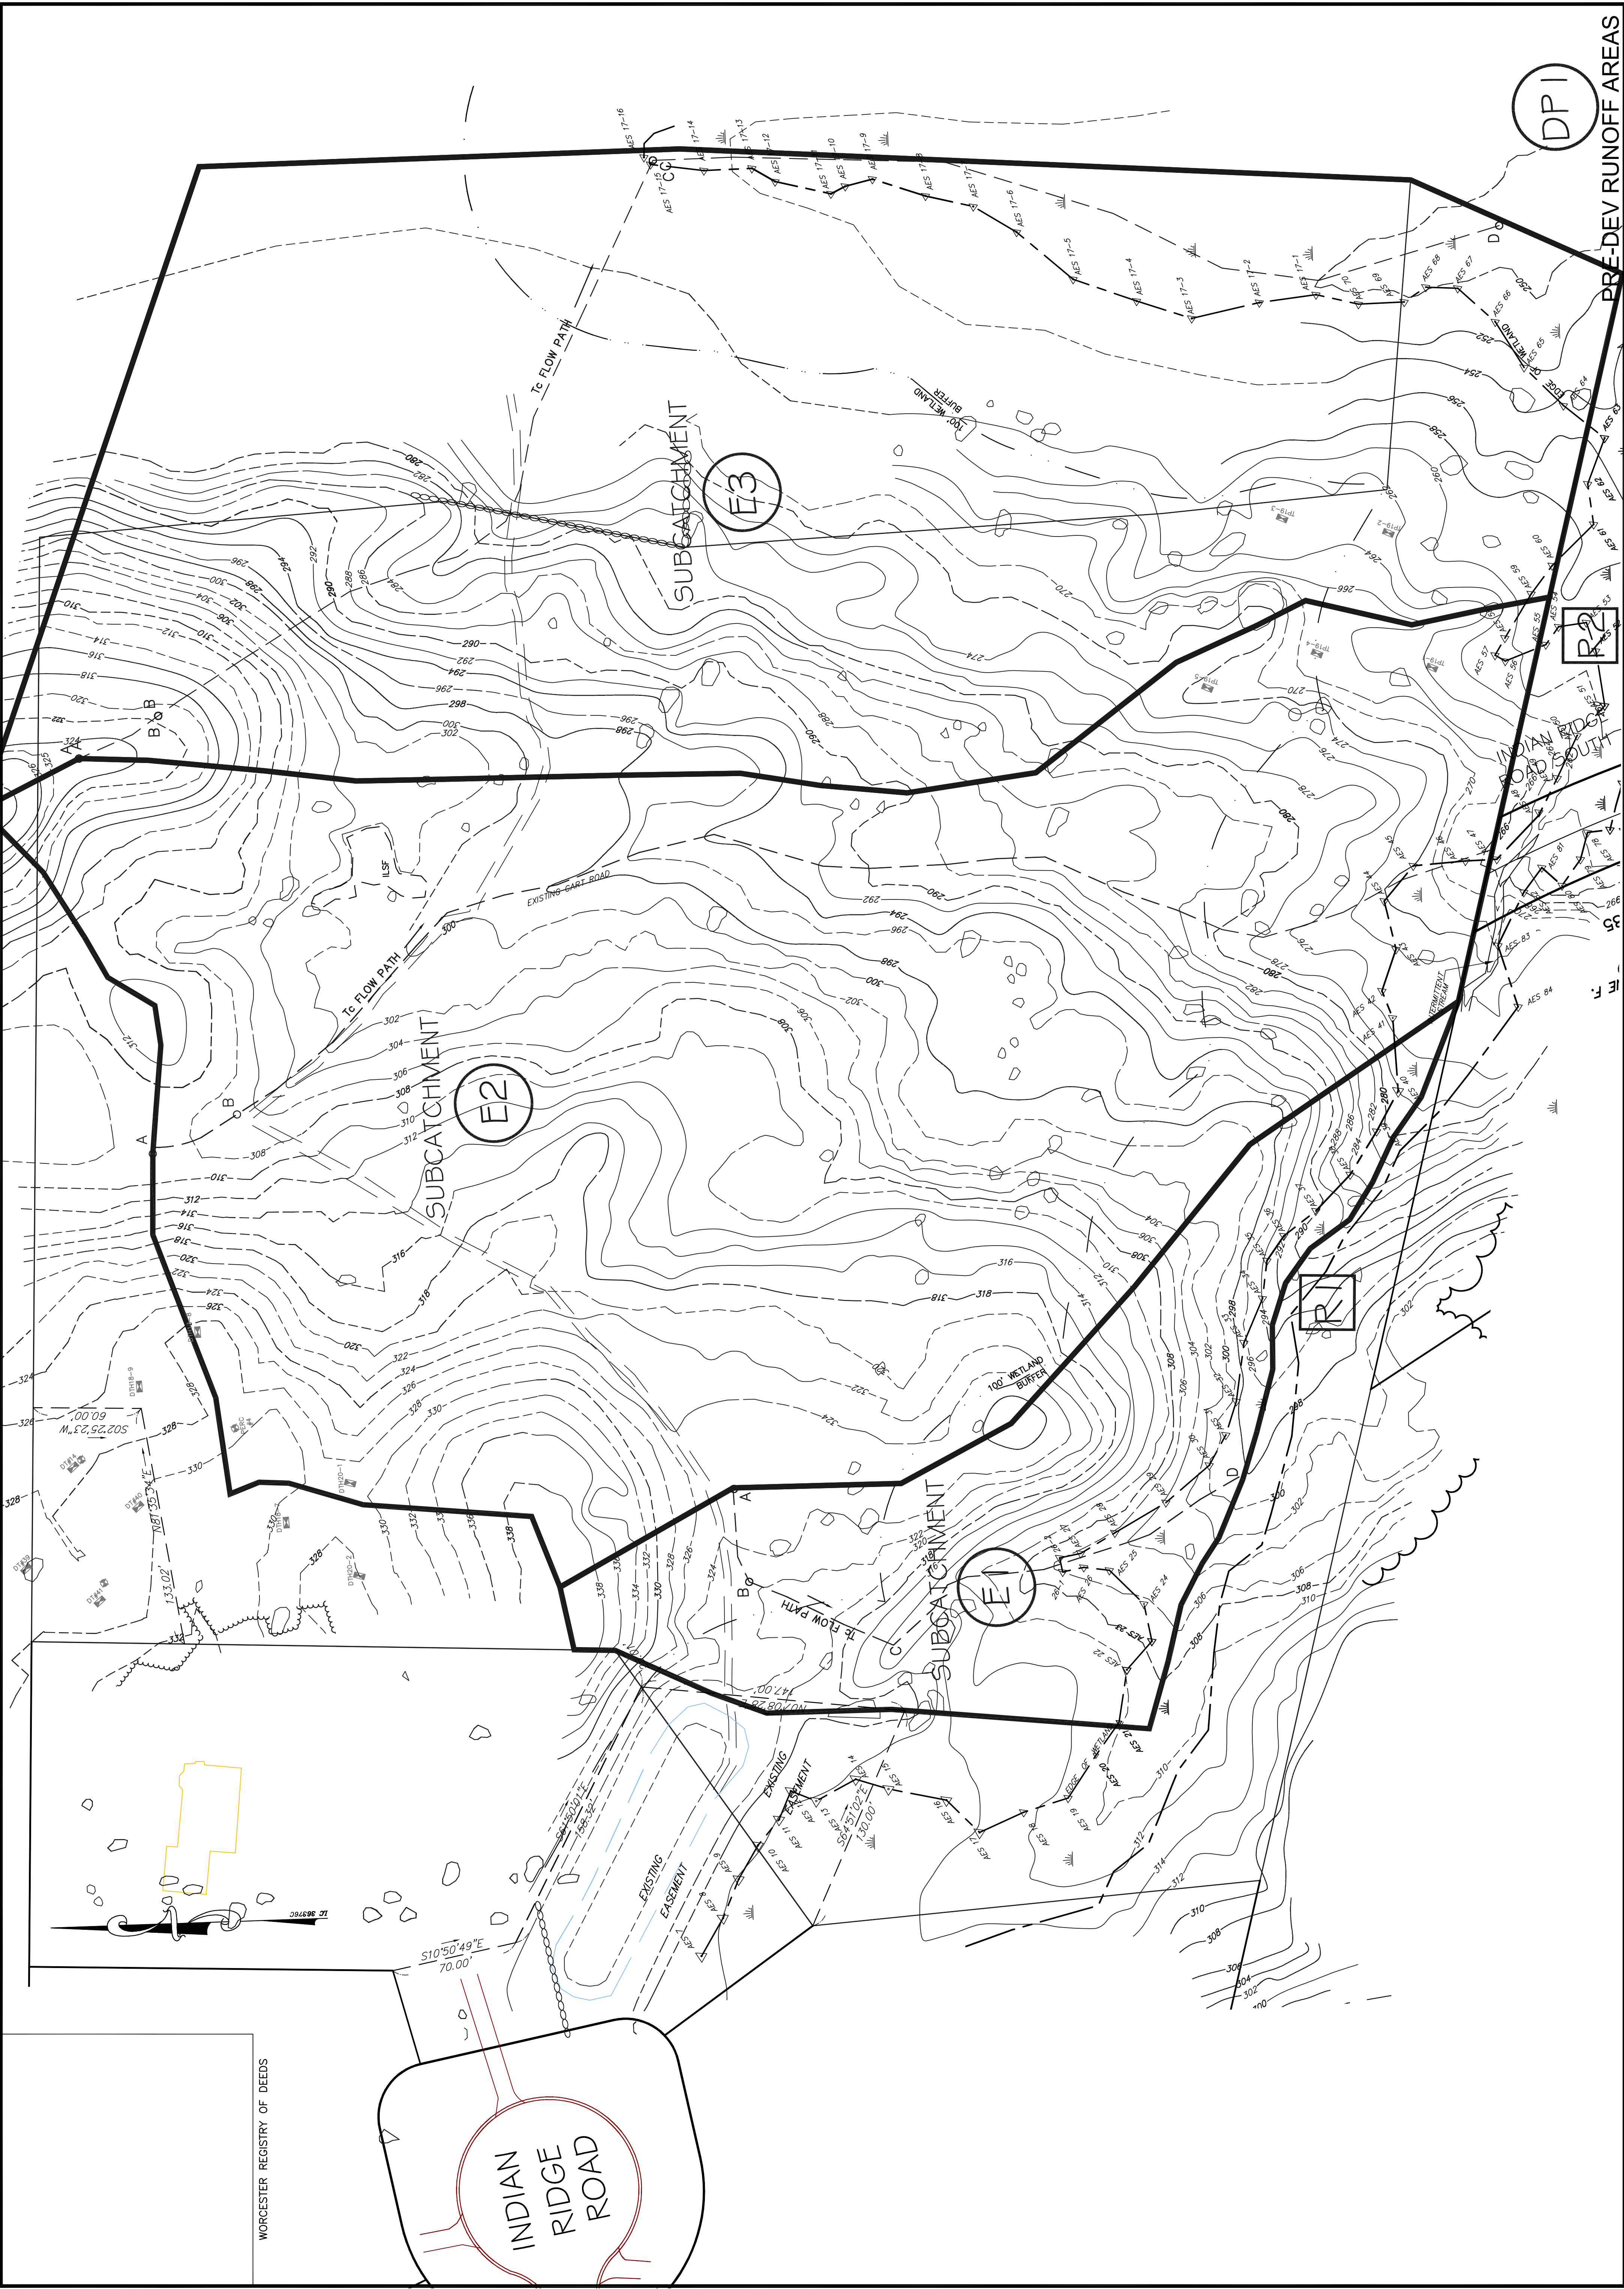

INDIAN RIDGE ROAD		Worcester Registry of Deeds	
INDIAN RIDGE REALTY TRUST		223 COURTLAND STREET	
HOLLISTON, MA 01746		HOLLISTON, MA 01746	
PREPARED FOR:		GLM Engineering Consultants, Inc.	
HOLLISTON, MASSACHUSETTS		19 EXCHANGE STREET	
A 40B Comprehensive Permit Project		HOLLISTON, MA 01746	
SHEET: 1 of 3		P: 508-429-1100	
SCALE: 1"=40'		F: 508-429-7160	
DATE: MAY 14, 2020		www.GLMengineering.com	
JOB No. 16,181		PLAN #: 27,337	
NO. DATE		REVISIONS	
DESCRIPTION			

